




Radial grating (Siemens-star) N-W



Radial grating (Siemens-star) W-N




Radial grating (Siemens-star) N-Z



Radial grating (Siemens-star) W-Z

Picture C1: Radial gratings (Siemens-stars) N-W, W-N, N-Z and W-Z; PS operator: *nnn0* setcmykcolor*

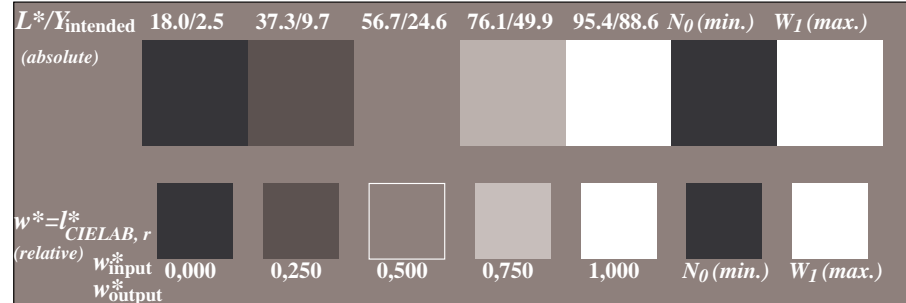


Picture C2: 5 visual equidistant L^* -grey steps + N_0 + W_I ; PS operator: *cmy0* setcmykcolor*




Picture C3: 16 visual equidistant L^* -grey steps; PS operator: *nnn0* setcmykcolor*; use file www.bam.de/FE88/10L/L88E0iSA.PS or [L88E0iSP.PS/.PDF](http://www.bam.de/L88E0iSP.PS/.PDF) (i=0,7) for PDF systems to complete the figure

ISO/IEC-test chart no. 3 according to ISO/IEC 15775 and input: *nnn0*lin 1.0 exp setcmykcolor*
DIS ISO/IEC 19839-X; output: *Startup (S) data dependend*

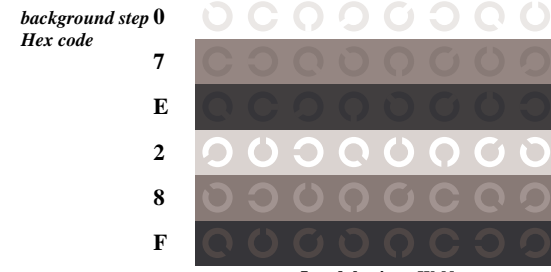


Landolt-rings W-N

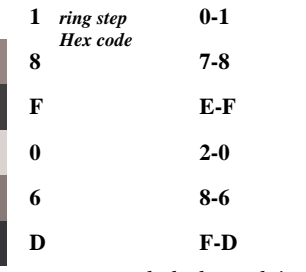


code: background-ring

Picture C4: Landolt-rings W-N; PS operator: *nnn0* setcmykcolor*

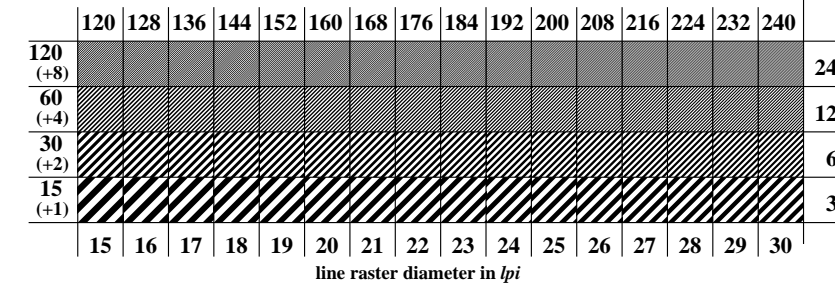

line raster diameter in lpi

Picture C5: Line raster under 45° (or 135°); PS operator: *nnn0* setcmykcolor*

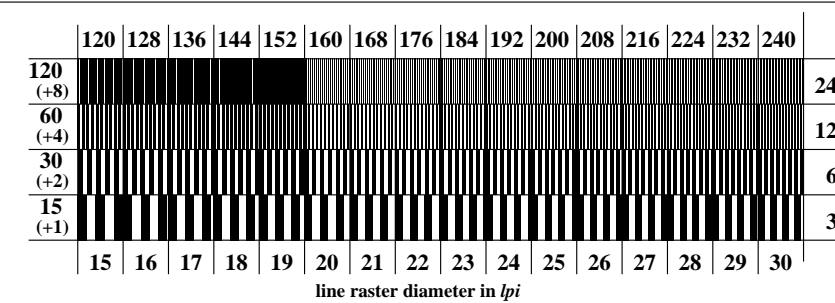

line raster diameter in lpi

Picture C6: Line raster under 90° (or 0°); Use of the PS operator *nnn0* setcmykcolor*