




Radial grating (Siemens-star) N-W



Radial grating (Siemens-star) W-N




Radial grating (Siemens-star) N-Z




Radial grating (Siemens-star) W-Z

Picture C1: Radial gratings (Siemens-stars) N-W, W-N, N-Z and W-Z; PS operator: `www* setrgbcolor`

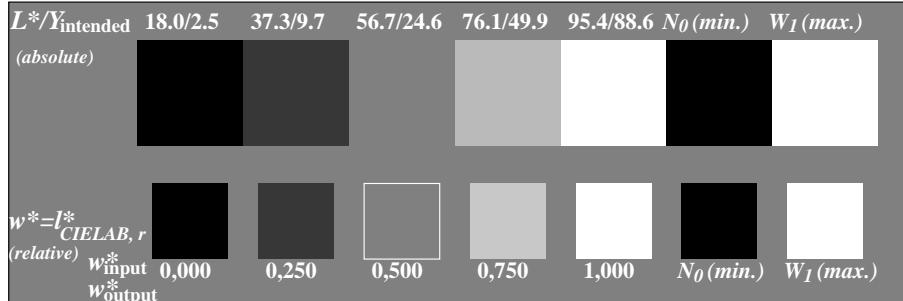


Picture C2: 5 visual equidistant  $L^*$ -grey steps +  $N_0$  +  $W_I$ ; PS operator: `www* setrgbcolor`



Picture C3: 16 visual equidistant  $L^*$ -grey steps; PS operator: `www* setrgbcolor`; use file `www.bam.de/KE89/10S/S89E00SA.PS` or `/S89E00SP.PS/.PDF` for DPS or PDF systems to complete the figure

ISO/IEC-test chart no. 3 according to


ISO/IEC 15775 and input: `www*lin 1.0 exp setrgbcolor`  
DIS ISO/IEC 19839-X; output: *Startup (S) data dependend*

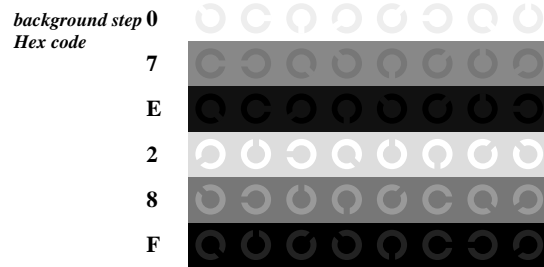


Landolt-rings W-N

code: background-ring

Picture C4: Landolt-rings W-N; PS operator: `www* setrgbcolor`

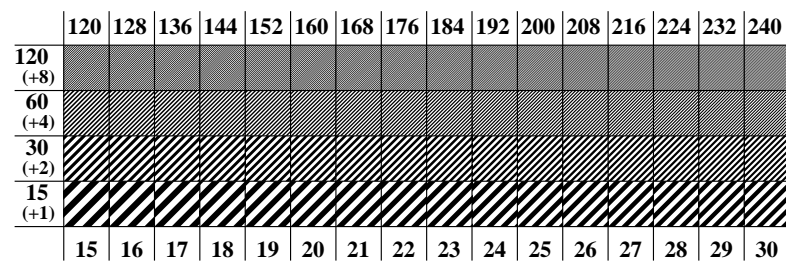

Picture C5: Line raster under 45° (or 135°); PS operator: `www* setrgbcolor`

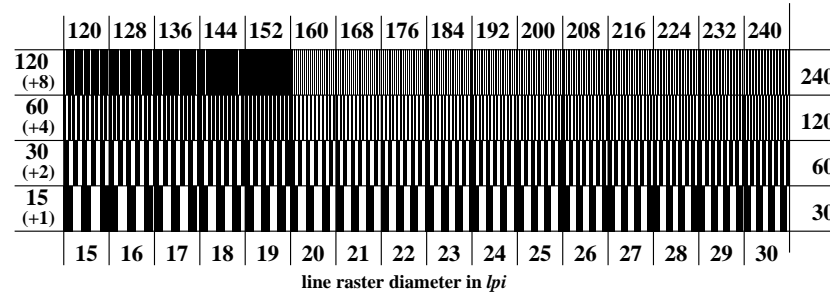

Picture C6: Line raster under 90° (or 0°); Use of the PS operator `www* setrgbcolor`