

See for similar files: <http://www.ps.bam.de/FE95/FE95.HTM>
 Information and Order: <http://www.ps.bam.de> Version 2.0, io=5,2; iORS; oORS, CIELAB

C
 LAB^*

M
 LAB^*

Y
 LAB^*

N
 LAB^*

O
 LAB^*

L
 LAB^*

V
 LAB^*

N
 LAB^*

BAM registration: 20030101-FE95/10S/S95E02FP.PS/.PDF BAM material: code=rha4ta application for measurement of monitor (Yr=2.5) and printer output

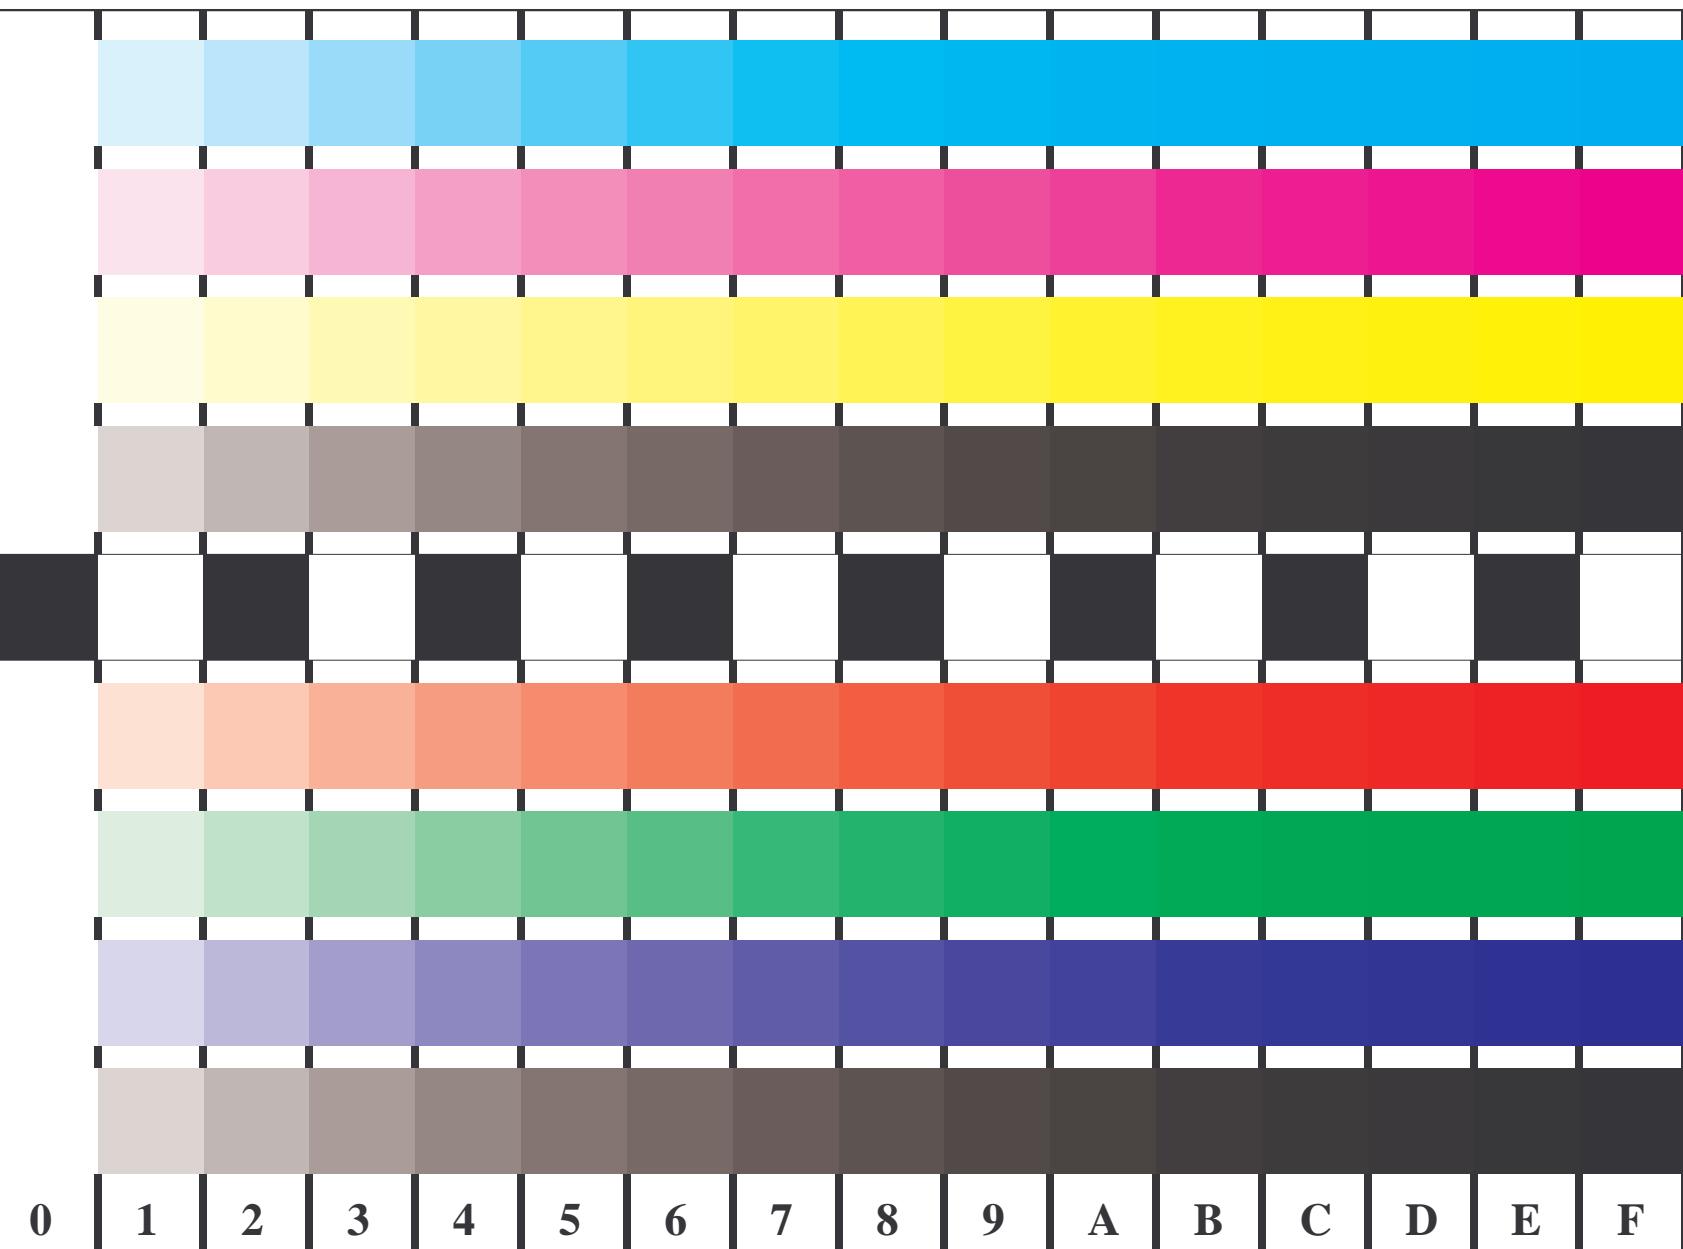


Figure B4 and D4 of the ISO/IEC-test charts no. 2 and 4; 16 visual equidistant steps of colour series; Use of the PS operator $LAB^* setcolor$



Fig. B4 of ISO/IEC-test chart 2 and
 Fig. D4 of ISO/IEC-test chart no. 4;

ISO/IEC 15775 and
 TR ISO/IEC 24705;

input: $LAB^* setcolor$
 output: $cmy0*/nnn0* setcmykcolor$

