

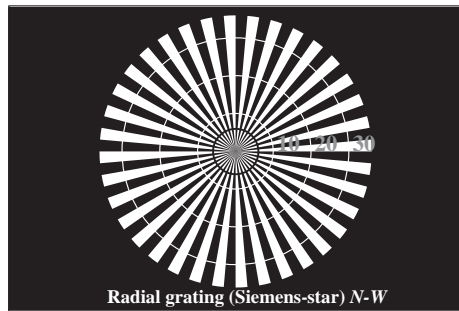



www.ps.bam.de/IE91/10B/B91E06FP.PS/.PDF; linearized output
F: Output Linearization (OL) data IE91/10B/B91E06FP.DAT in File (F)




Radial grating (Siemens-star) N-W



Radial grating (Siemens-star) W-N

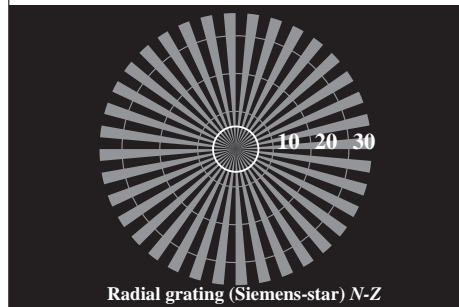


Radial grating (Siemens-star) N-Z




Radial grating (Siemens-star) W-Z

Picture C1: Radial gratings (Siemens-stars) N-W, W-N, N-Z and W-Z; Use of the PS operator *LAB* setcolor*

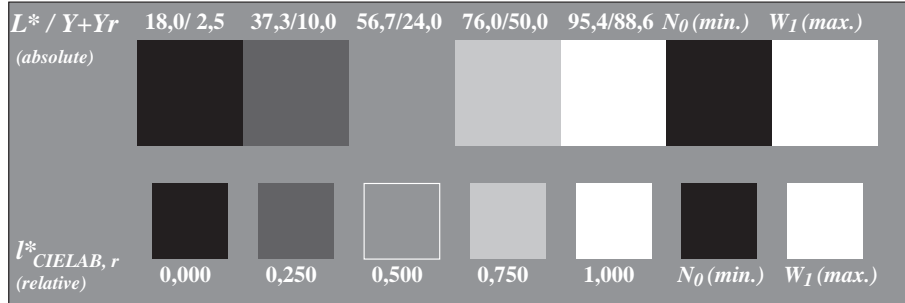

Picture C2: 5 visual equidistant L^* -grey steps + N_0 + W_1 ; Use of the PS operator *LAB* setcolor*

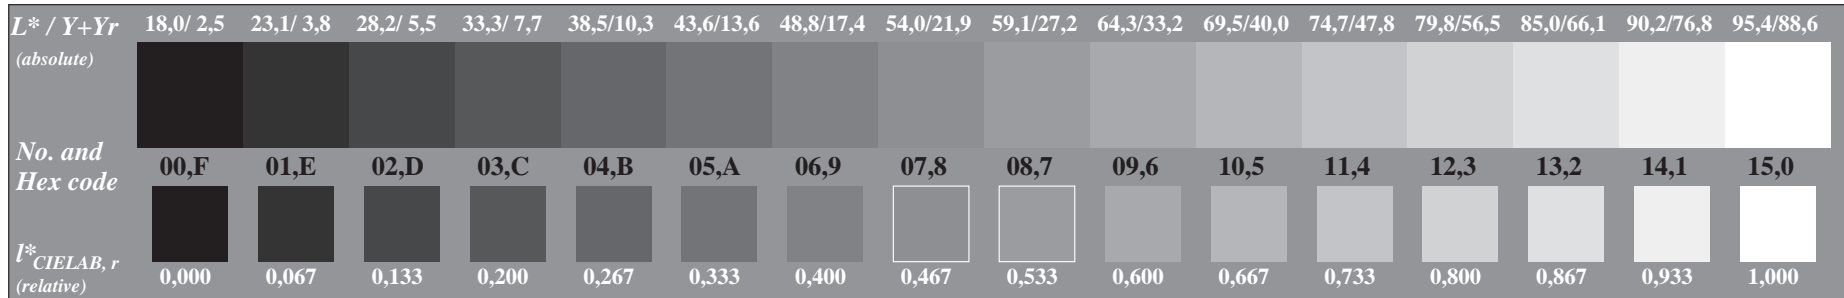


Picture C3: 16 visual equidistant L^* -grey steps; Use of the PS operator *LAB* setcolor*




Fig. A1 to A6 of ISO/IEC-test chart 1;


ISO/IEC 15775 and input: *LAB* setcolor*
DIS ISO/IEC 19839-X; output: *000n* setcmykcolor*

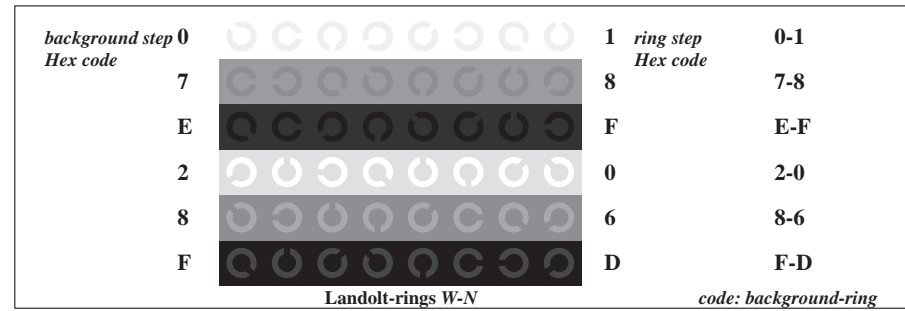

Picture C4: Landolt-rings W-N; Use of the PS operator *LAB* setcolor*

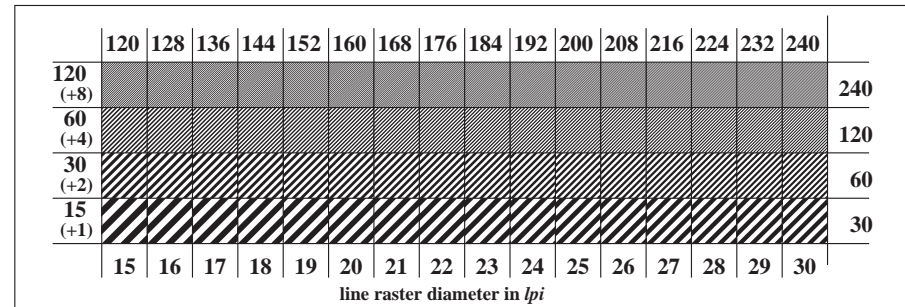

Picture C5: Line raster under 45° (or 135°); Use of the PS operator *LAB* setcolor*

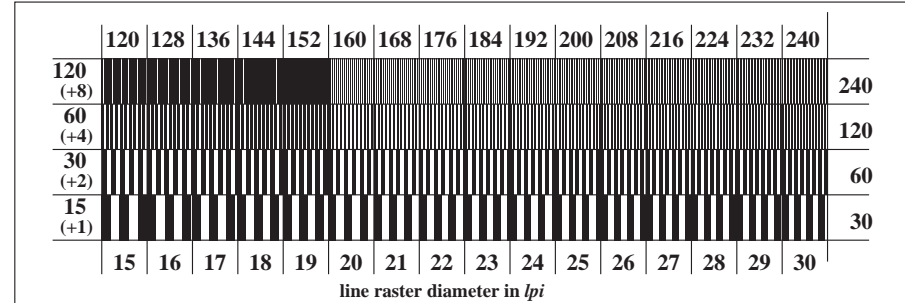

Picture C6: Line raster under 90° (or 0°); Use of the PS operator *LAB* setcolor*