


See for similar files: <http://www.ps.bam.de/IE95/IE95.HTM>
Information and Order: <http://www.ps.bam.de> Version 2.0, io=0,7; iOLS; oOLS, CIEXYZ

BAM registration: 20030101-IE95/10A/A95E07FP.PS/.PDF BAM material: code=rha4ta
application for monitors, Yr=0.0, XYZ

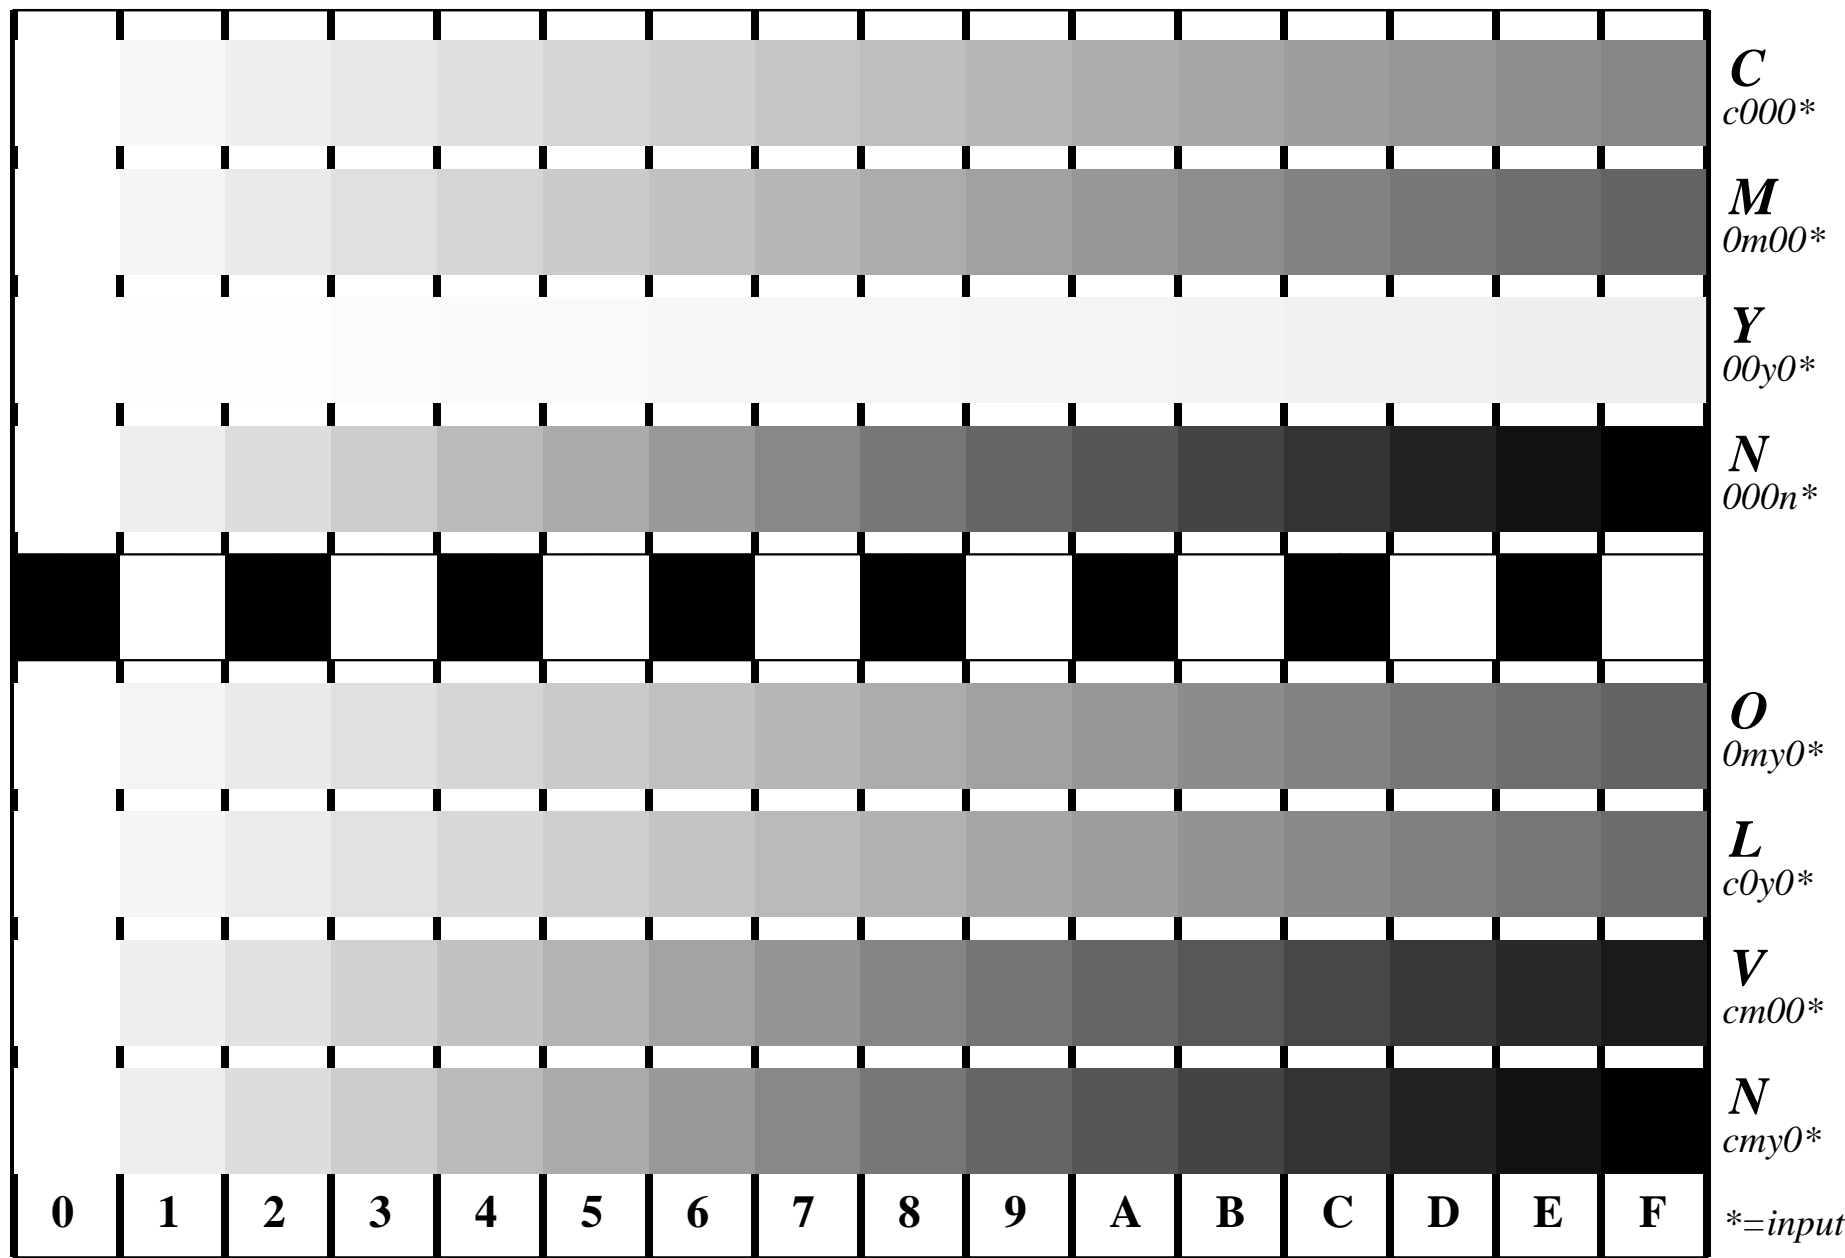

Picture B4 and D4: 16 equidistant steps **B4**: W-C, W-M, W-Y and W-N; **D4**: W-O, W-L, W-V and W-N(CMY); Use of PS operator; B4: $cmy0^* / 000n^* \text{ setcmykcolor}$; D4: $cmy0^* \text{ setcmykcolor}$ (only)





Fig. B4/D4 of ISO/IEC-test chart 2/4;

ISO/IEC 15775 and
TR ISO/IEC 24705;

input: $cmy0^* \text{ setcmykcolor}$
output: $w^* \text{ setgray}$