

See for similar files: <http://www.ps.bam.de/KE95/KE95.HTM>
Information and Order: <http://www.ps.bam.de> Version 2.0, io=5,1; iOLS; oOLS, CIEXYZ

BAM registration: 20030101-KE95/10C/C95E01FP.PS/.PDF BAM material: code=rha4ta
application for monitors, Yr=5.0, XYZ

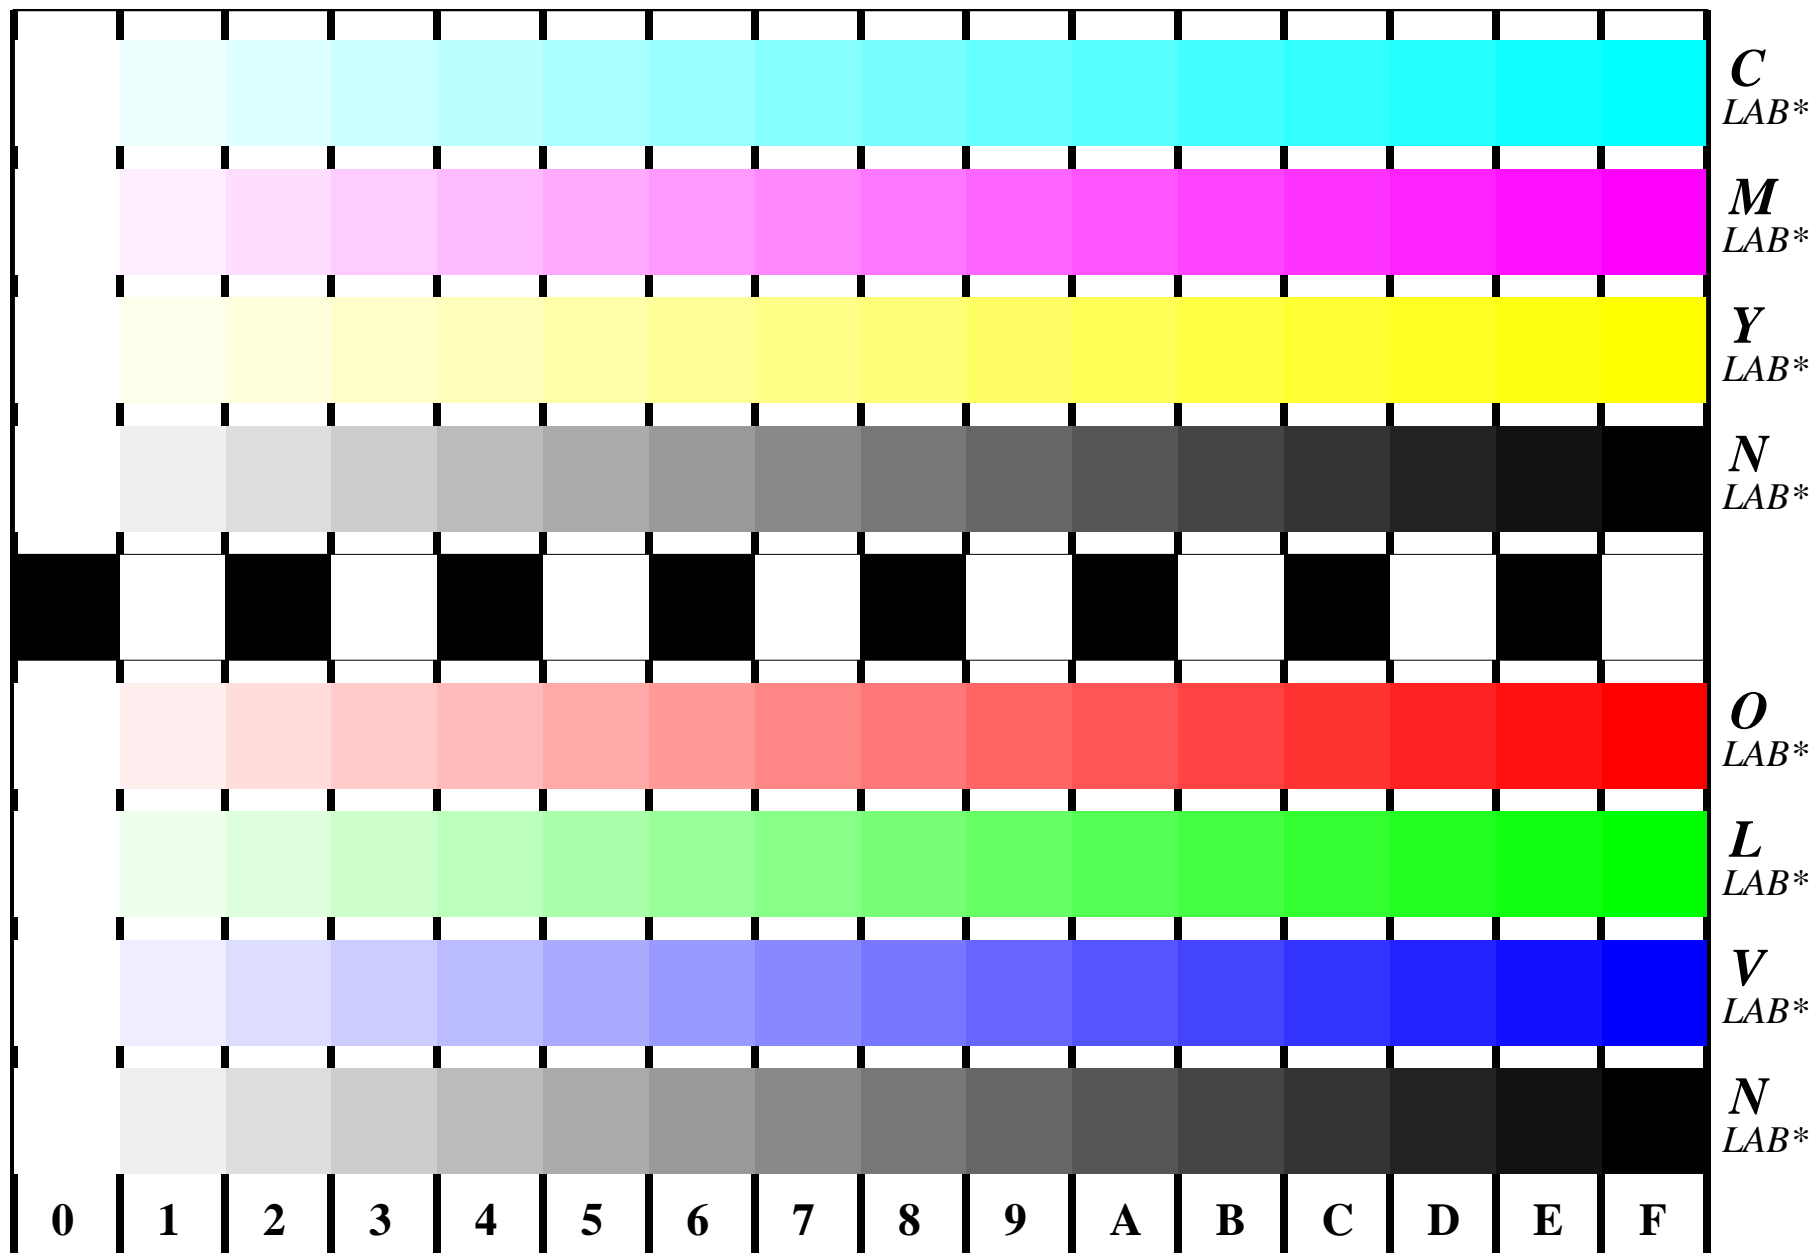


Figure B4 and D4 of the ISO/IEC-test charts no. 2 and 4; 16 visual equidistant steps of colour series; Use of the PS operator $LAB^*_{setcolor}$

Fig. B4/D4 of ISO/IEC-test chart 2/4;

ISO/IEC 15775 and
TR ISO/IEC 24705;

input: $LAB^*_{setcolor}$
output: $olv^*_{setrgbcolor} / w^*_{setgray}$