

See for similar files: <http://www.ps.bam.de/KE95/KE95.HTM>
 Information and Order: <http://www.ps.bam.de> Version 2.0, io=5,7; iOLS; oOLS, CIEXYZ

C
 LAB^*

M
 LAB^*

Y
 LAB^*

N
 LAB^*

O
 LAB^*

L
 LAB^*

V
 LAB^*

N
 LAB^*

BAM registration: 20030101-KE95/10D/D95E07FP.PS/.PDF BAM material: code=rha4ta
 application for monitors, Yr=7.5, XYZ

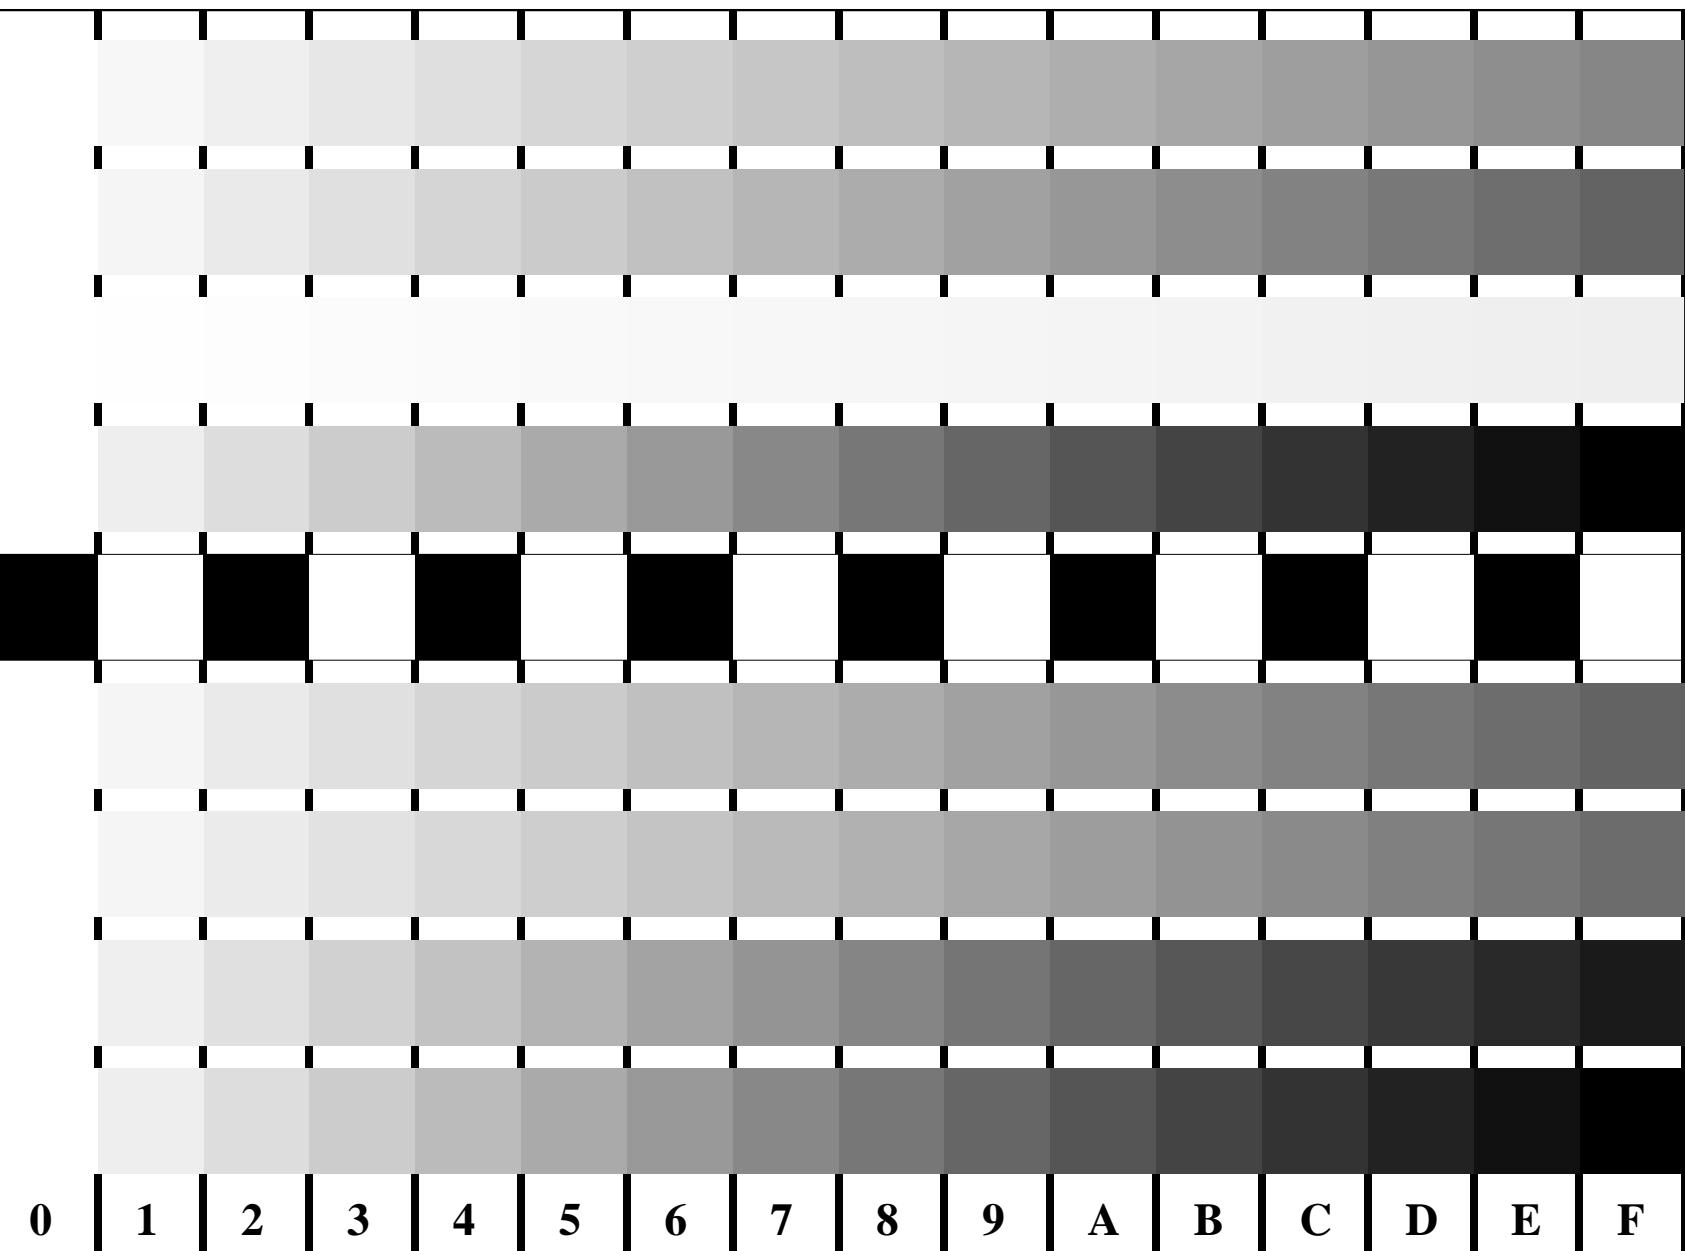


Figure B4 and D4 of the ISO/IEC-test charts no. 2 and 4; 16 visual equidistant steps of colour series; Use of the PS operator $LAB^* setcolor$

Fig. B4/D4 of ISO/IEC-test chart 2/4;

ISO/IEC 15775 and
 TR ISO/IEC 24705;

input: $LAB^* setcolor$
 output: $w^* setgray$

