




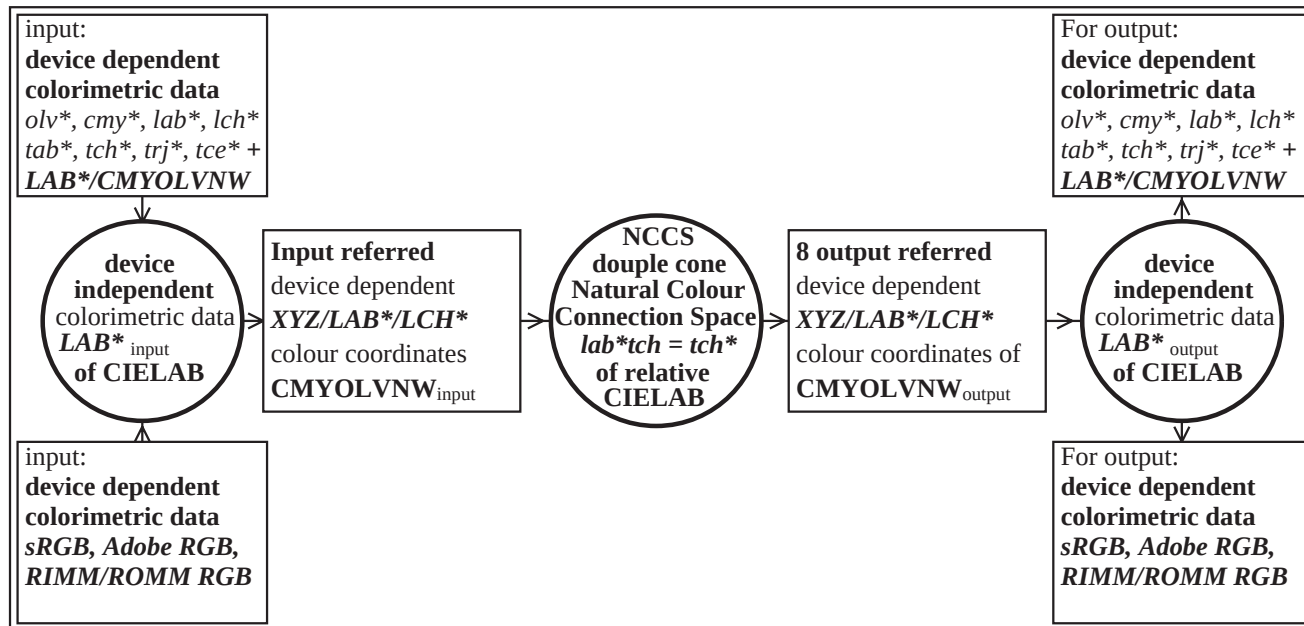

LE450-3, Transfer to device independent LAB^*/LCH^* data; output via the Natural Colour Connection Space tab^*/tch^*

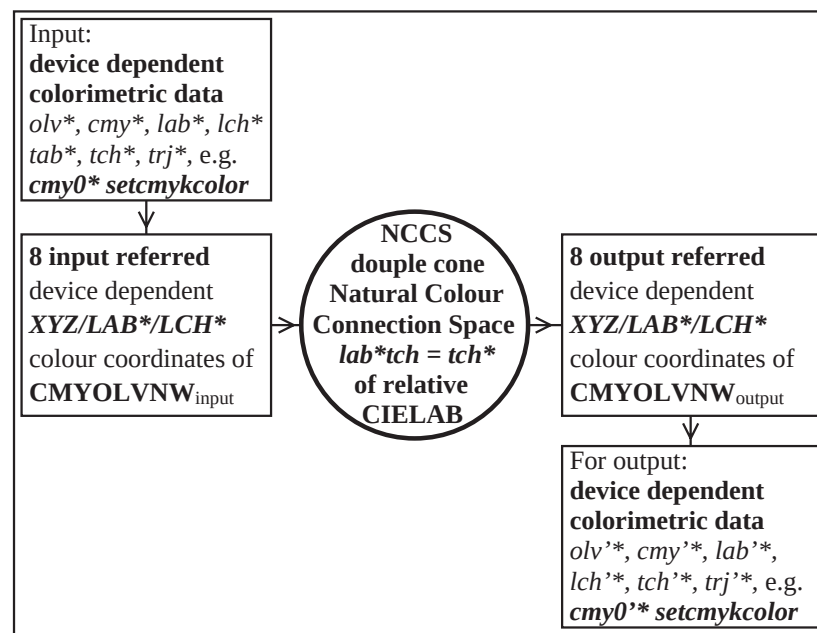

LE450-7, Transfer from device dependent $cmy0^*$ data; output via NCCS with new $cmy0^*$ data

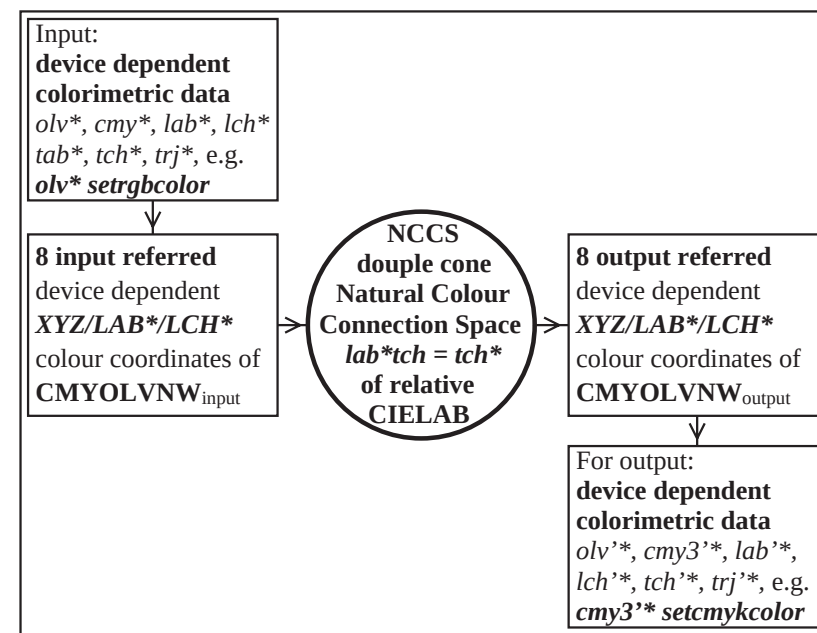

LE451-7, Transfer from device dependent olv^* data; output via NCCS with $cmy0^*$ data

BAM-test chart no. LE45; colour transfer and workflow
Connection: input and output referred colour spaces

input: $cmy0^* setcmykcolor$
output: no change compared to input