
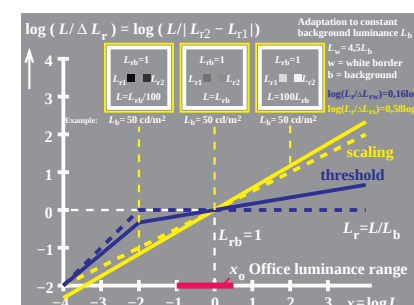
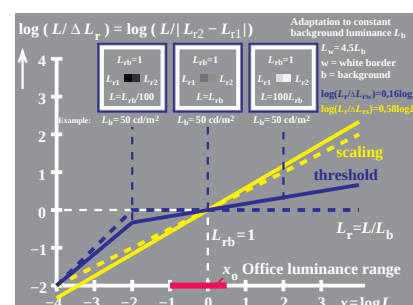
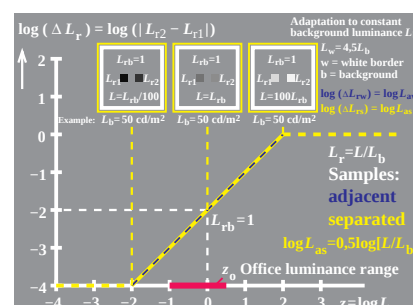
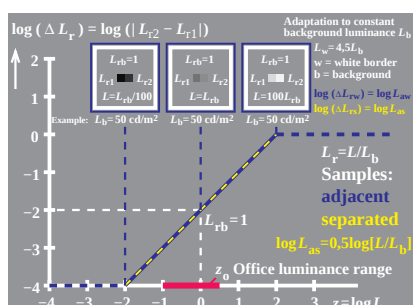
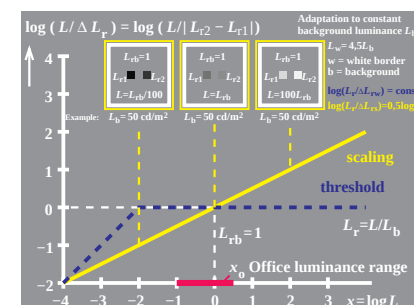
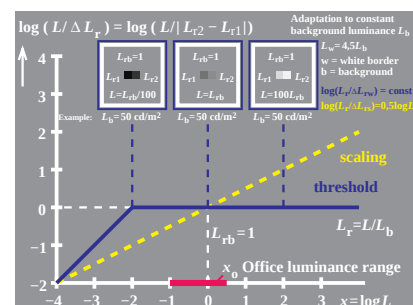
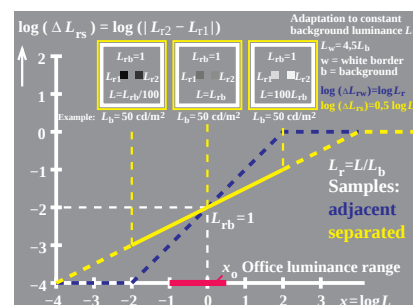
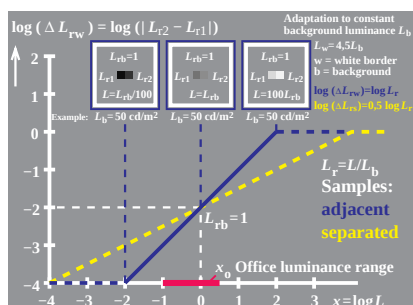
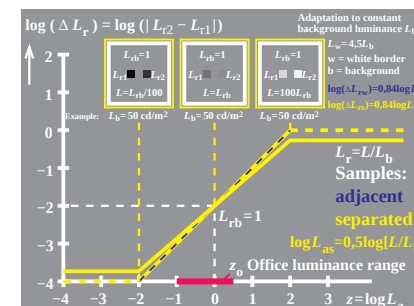
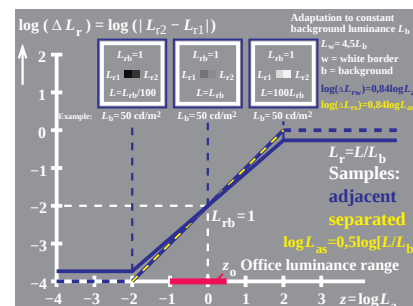
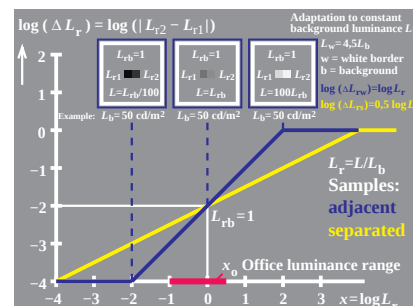
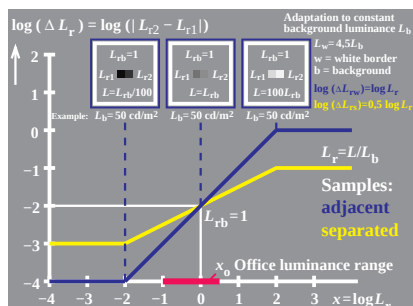
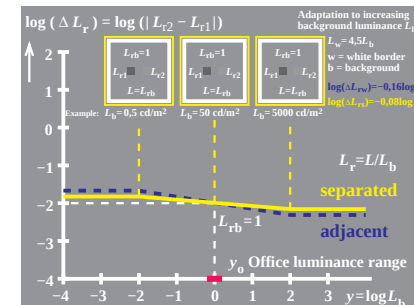
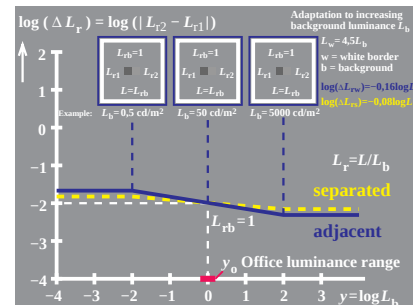
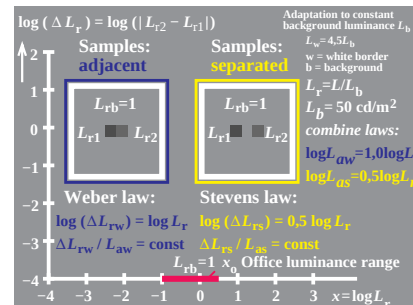


http://farbe.li.tu-berlin.de/AEQ3/AEQ3L0NP.PDF /.PS; only vector graphic VG; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S)

see similar files: <http://farbe.li.tu-berlin.de/AEQ3/AEQ3.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmnetik>

TUB registration: 20201101-AEQ3/AEQ3L0NP.PDF /.PS
TUB material: code=rha4ta
application for evaluation and measurement of display or print output

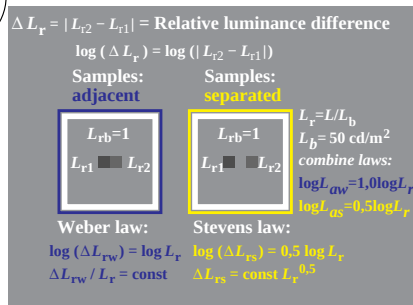

TUB-test chart AEQ3; Luminance discrimination

Model for separate and adjacent samples Relations of Weber and Stevens law at threshold

input: rgb/cmy0/000k/n