


vedi file simili: <http://standards.iso.org/iso/9241/306/ed-2/AI18/AI18L0FA.TXT> /PS
informazioni tecniche: <http://farbe.li.tu-berlin.de/> o <http://farbe.li.tu-berlin.de/AE.HTM>





AI180-3, Fig. D1Wdd: Flower motif, 14 prova colori CIE e 2 + 16 grigio passi (sf); PS operator: settransfer, 3 colorimage

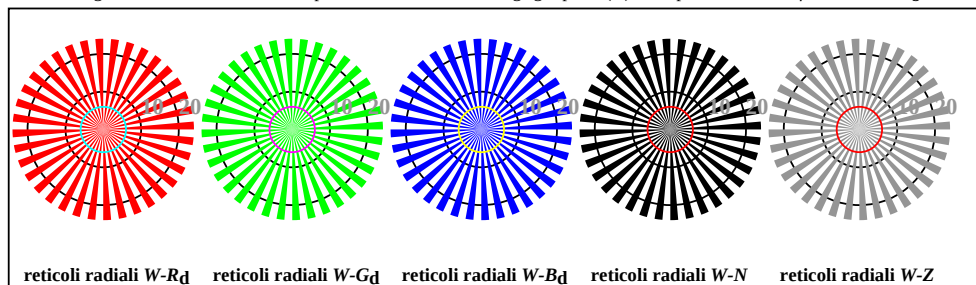


AI180-5, Fig. D2Wdd: reticoli radiali W-R_d; W-G_d; W-B_d; W-N; PS operator: rgb->rgb_{dd} setrgbcolor




AI180-7, Fig. D3Wdd: 14 prova colori CIE i 2 + 16 grigio passi (sf); rgb/cmy0->rgb_{dd} setrgbcolor

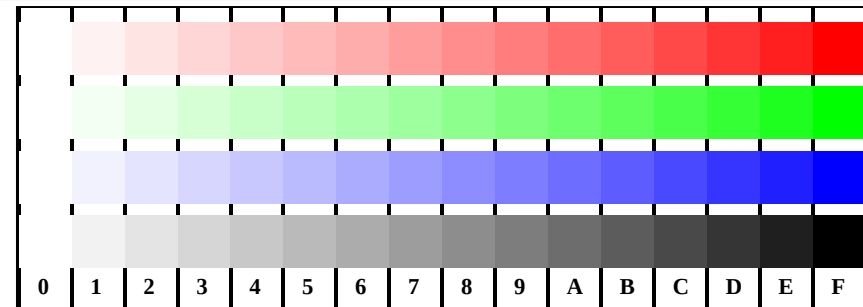


AI181-1, Fig. D4Wdd: 16 equidistante passi W-R_d; W-G_d; W-B_d; W-N; rgb/cmy0->rgb_{dd} setrgbcolor

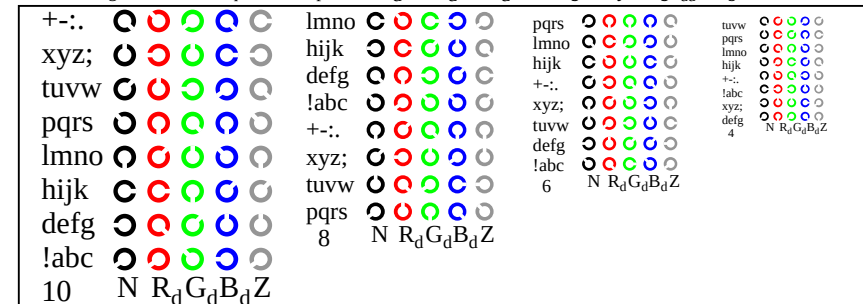

AI181-3, Fig. D5Wdd: codice i Landolt anelli N; R_d; G_d; B_d; Z; PS operator: rgb->rgb_{dd} setrgbcolor

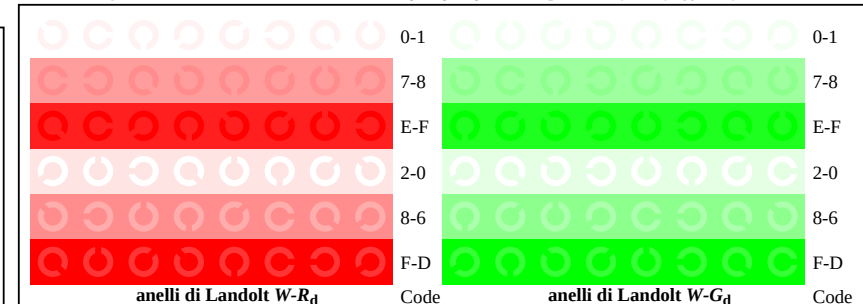

AI181-5, Fig. D6Wdd: anelli di Landolt W-R_d; W-G_d; PS operator: rgb->rgb_{dd} setrgbcolor

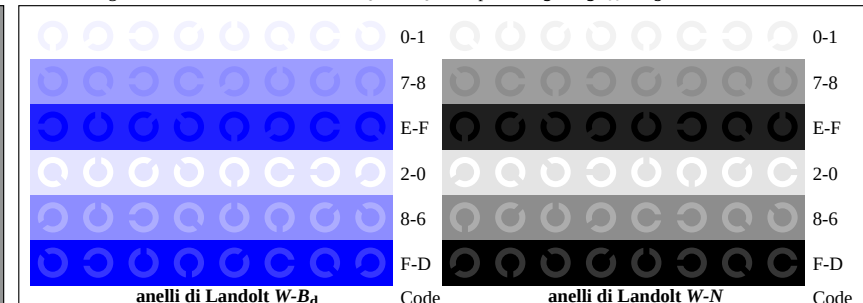

AI181-7, Fig. D7Wdd: anelli di Landolt W-B_d; W-N; PS operator: rgb->rgb_{dd} setrgbcolor

Input: rgb/cmy0/000n/w set...
Output: ->rgb_{dd} setrgbcolor

iscrizione TUB: 20190301-AI18/AI18L0FA.TXT /PS
Applicazione per la misurazione e la visualizzazione dell'output su display e stampa
TUB materiale: code=rh4ta