


See for similar files: <http://www.ps.bam.de/Ee59/>; <http://www.ps.bam.de/Ee59/10L/L59E00NP.PS/.PDF>; [http://www.ps.bam.de/Version 2.1, io=1, ColSpX=1](http://www.ps.bam.de/Version%201.1%20io11%20ColSpX1.html)

www.ps.bam.de/Ee59/10L/L59E00NP.PS/.PDF; ORS19_96a; start output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)



BAM registration: 20080901-Ee59/10L/L59E00NP.PS/.PDF
application for evaluation and measurement of printer or monitor systems

BAM material: code=rha4ta

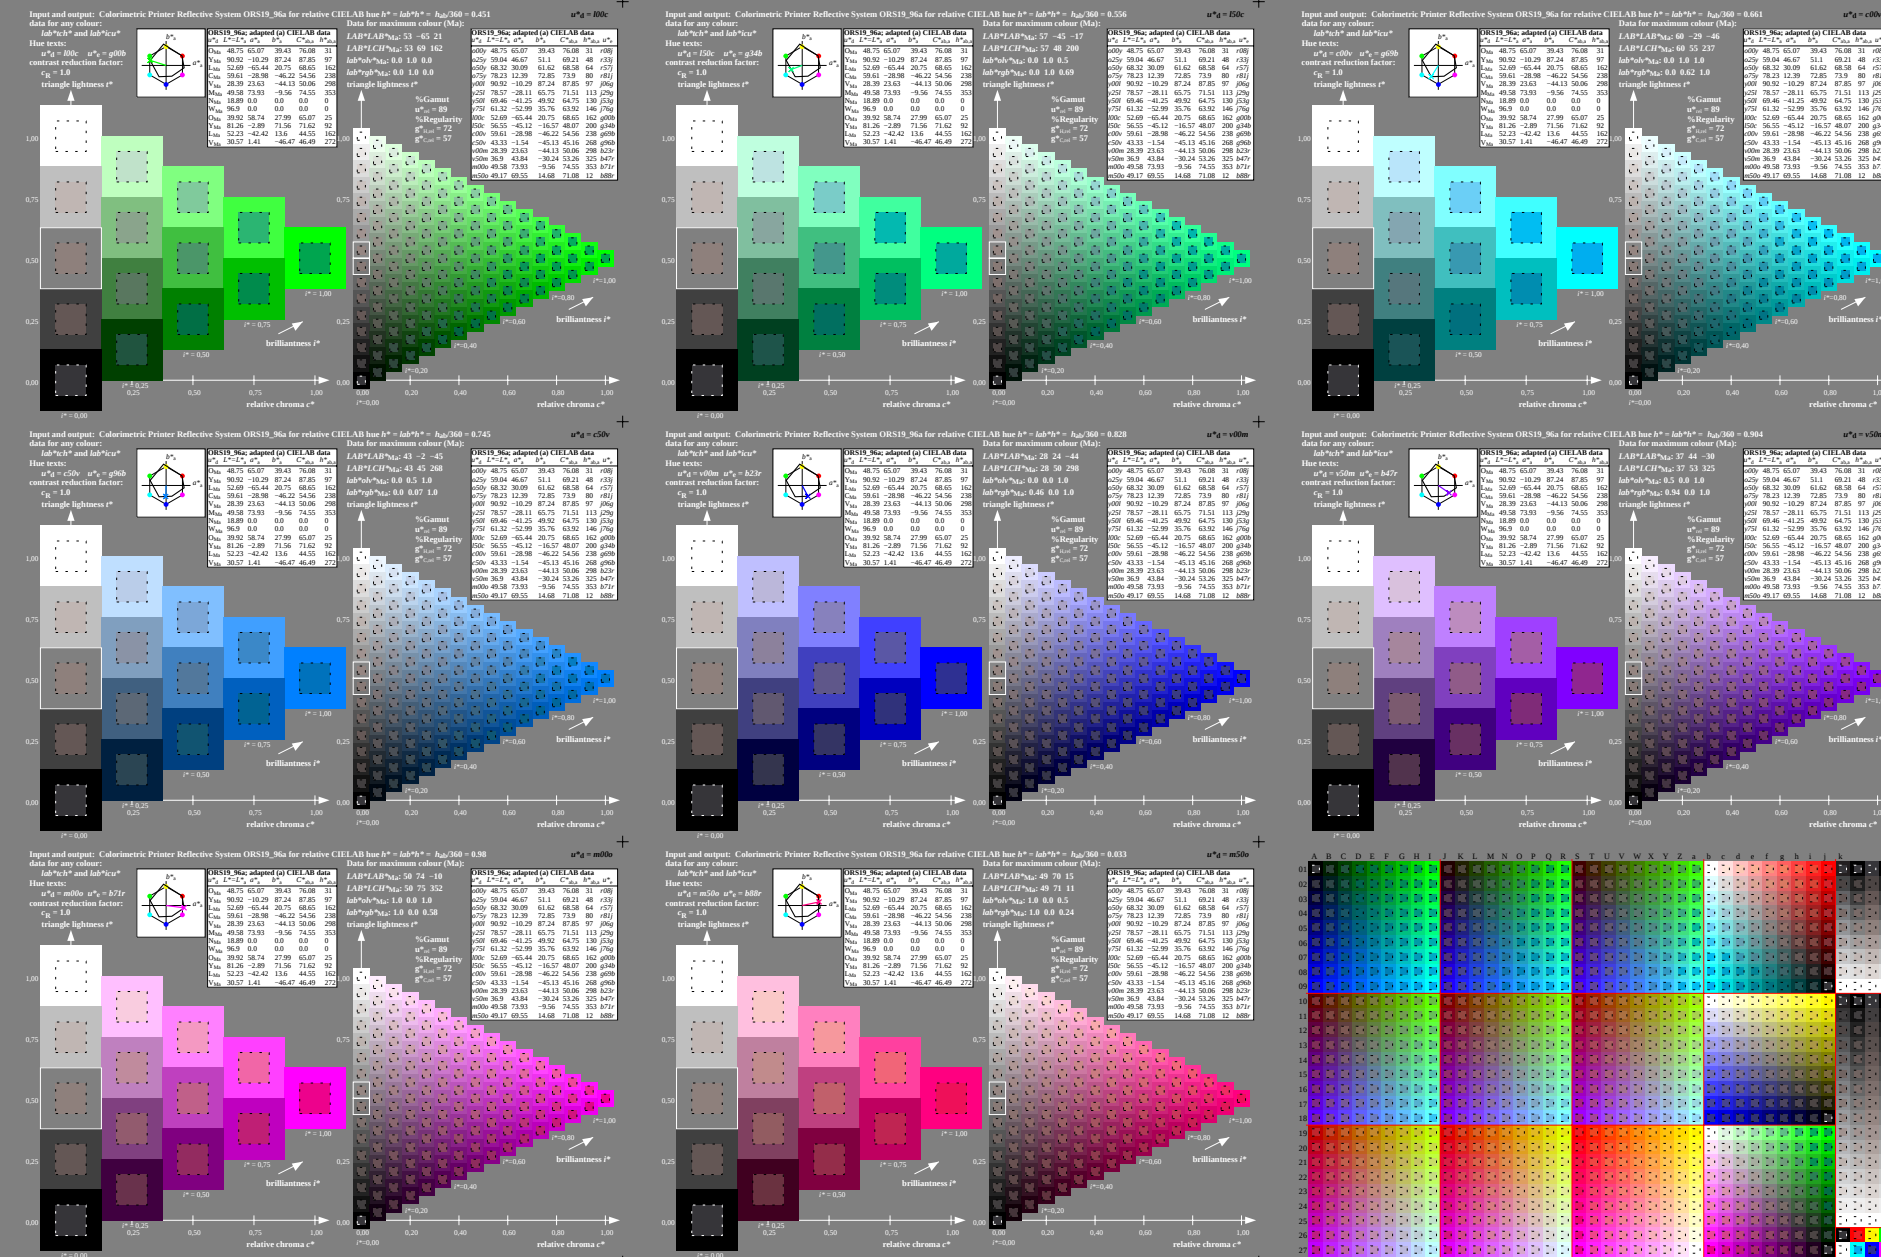


BAM-test chart Ee59; Colorimetric systems, Page 1/6
D65: colour scales and 4 separations for 16 hues 100c to m50o

input: 000n / w / nnn0 / www set...
output: no change compared to input

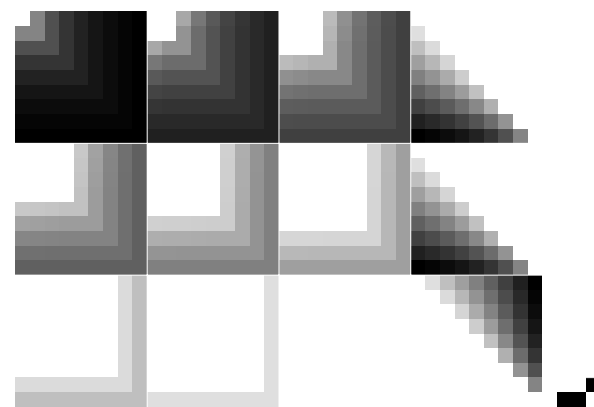


input: 000n / w / nnn0 / www set...
output: ->cmyn6* setcmykcolor


www.ps.bam.de/Ee59/10L/L59E00NP.PS/.PDF; ORS19_96a; transfer and output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D); Separation: cmyn

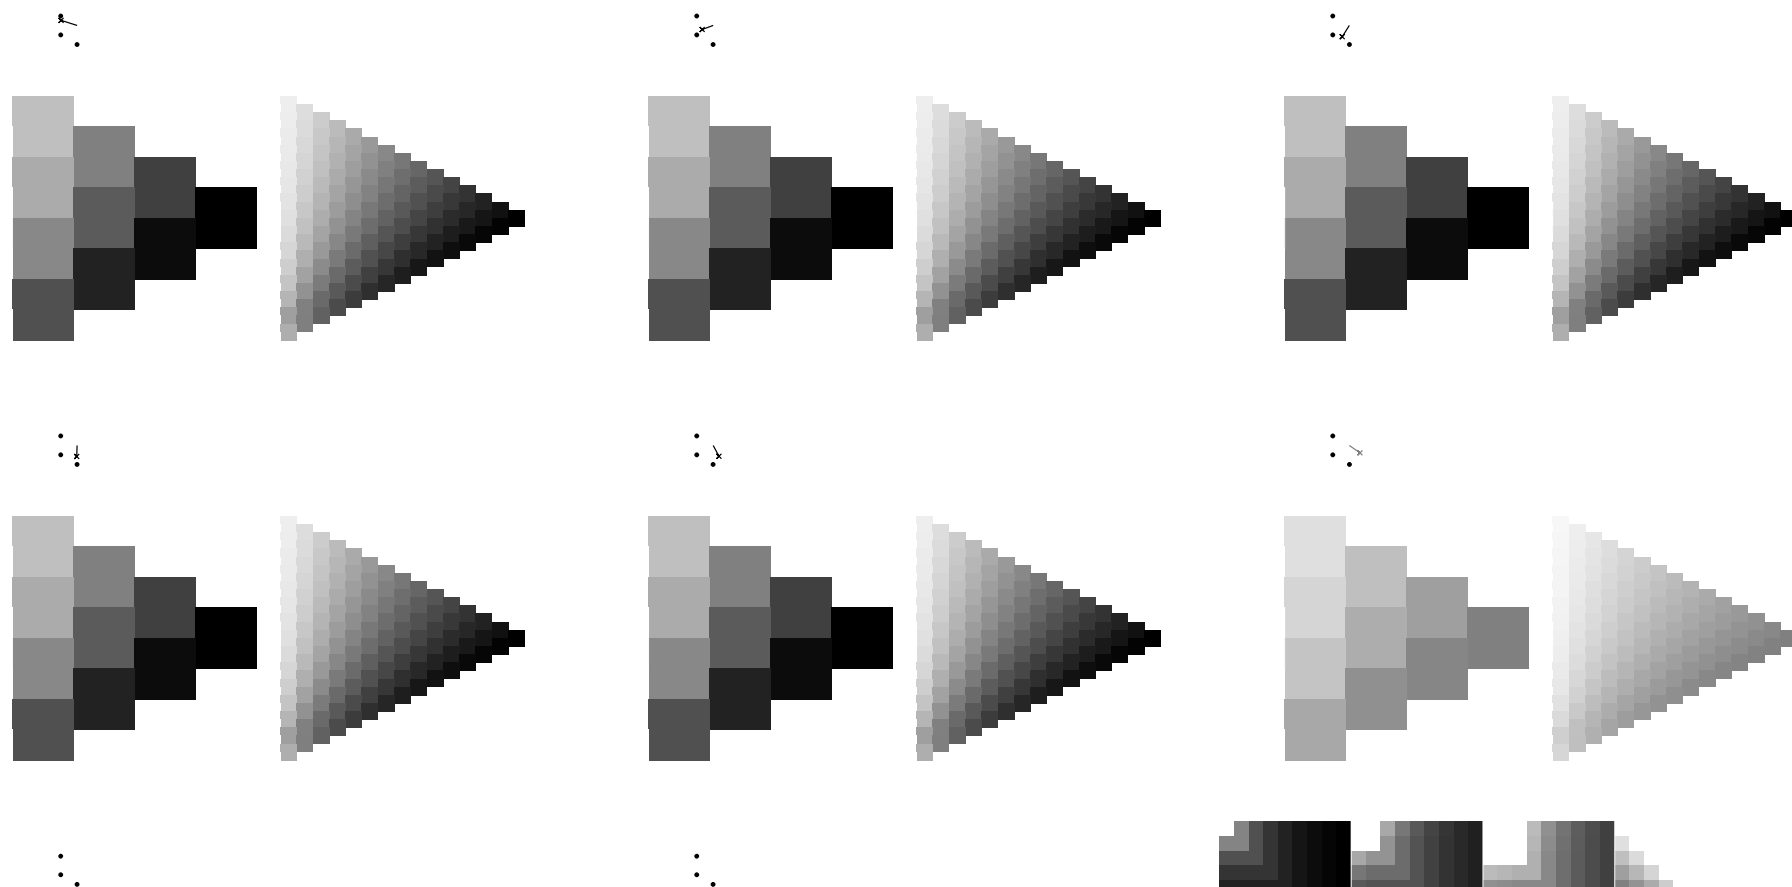

BAM-test chart Ee59; Colorimetric systems, Page 3/6
D65: colour scales and 4 separations for 16 hues l00c to m50o






See for similar files: <http://www.ps.bam.de/Ee59/>; www.ps.bam.de/Ee.HTM
Technical information: <http://www.ps.bam.de> Version 2.1, io=1,1, ColSpx=1



www.ps.bam.de/Ee59/10L/L59E00NP.PS/.PDF; ORS19_96a; transfer and output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D); Separation: **cmyn**

See for similar files: <http://www.ps.bam.de/Ee59/>; www.ps.bam.de/Ee.HTM
Technical information: <http://www.ps.bam.de> Version 2.1, io=1,1, ColSpx=1

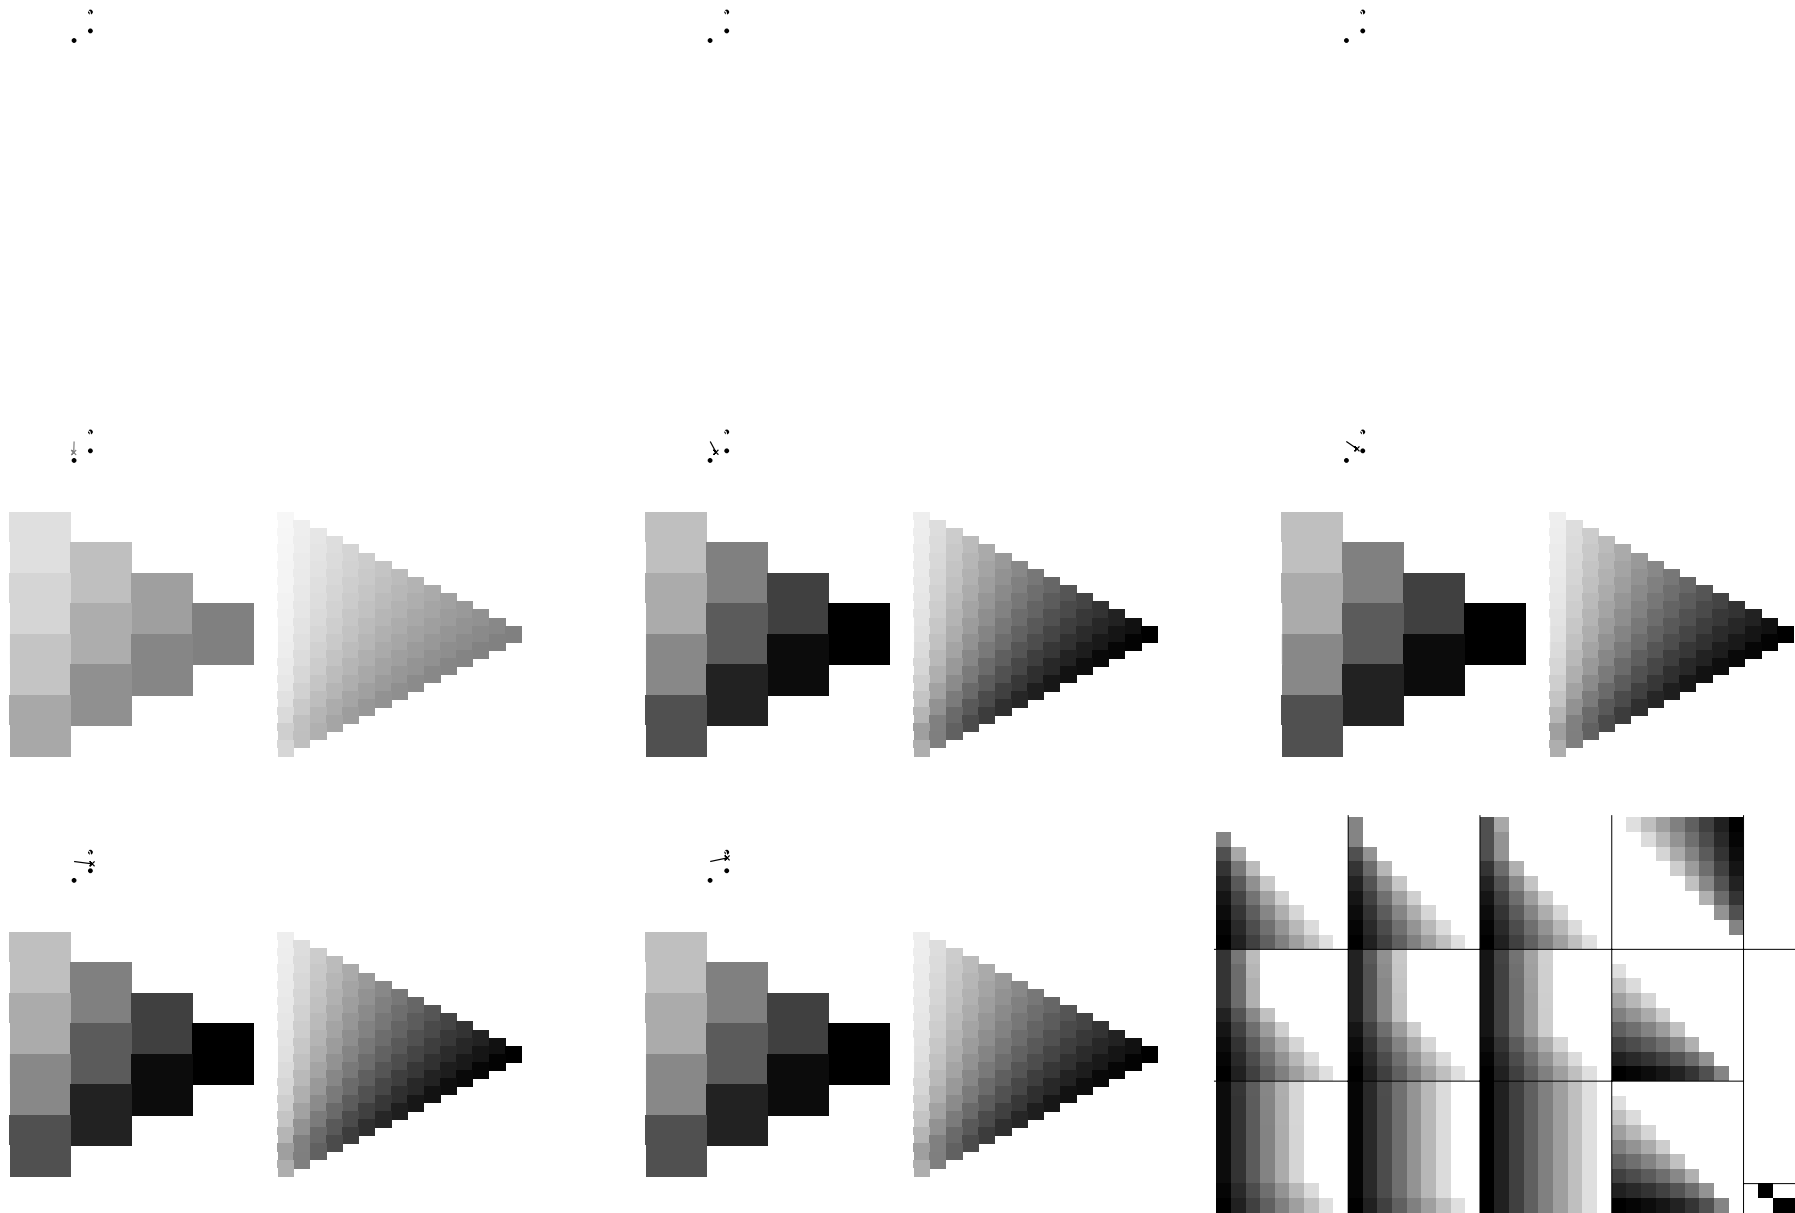



input: 000n / w / nnn0 / www set...
output: ->cmyn6* setcmykcolor

www.ps.bam.de/Ee59/10L/L59E00NP.PS/.PDF; ORS19_96a; transfer and output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D); Separation: cmyn

