


http://130.149.60.45/~farbmetrik/IE01/IE01L0NP.PDF /.PS; start output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)

See original or copy: <http://web.me.com/klaus.richter/IE01/IE01L0NP.PDF> /.PS
Technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

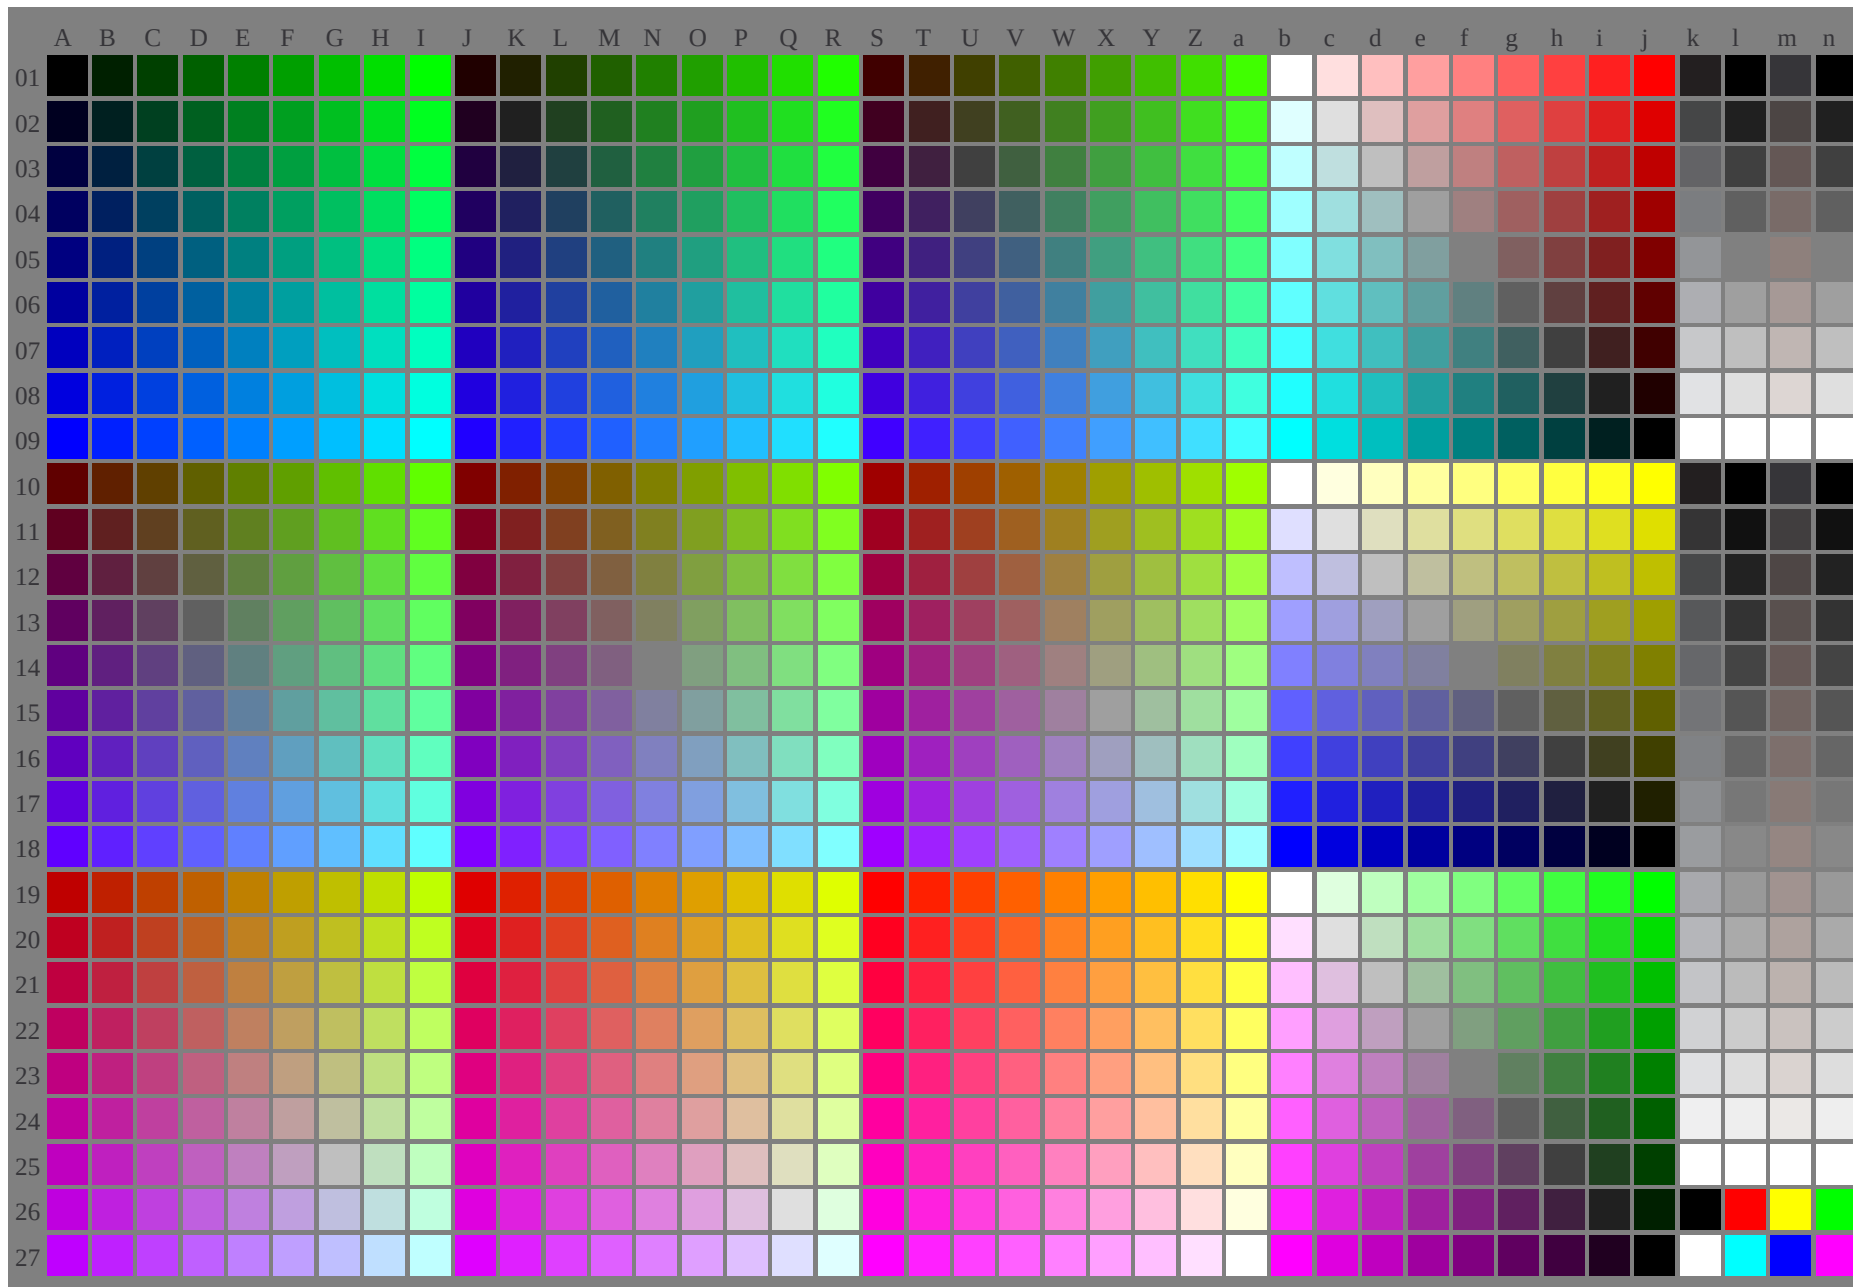

IE010-7N, Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): **rgb** (A-j, n), **000n** (k), **w** (l), **nnn0** (m), 5,4mm x 5,4mm, Page 1/1

TUB-test chart IE01; Colorimetric system G, Page 1/4


input: 000n / w / nnn0 / rgb set...

40x27=1080 colours for Measurement: **rgb** / **w** / **cmY0** / **000n** output: no change compared to input

TUB registration: 20090901-IE01/IE01L0NP.PDF /.PS
application for measurement of printer or monitor systems

TUB material: code=rha4ta

IE010-7N, Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): **rgb** (A-j, n), **000n** (k), **w** (l), **nnn0** (m), 5,4mm x 5,4mm, Page 2/1

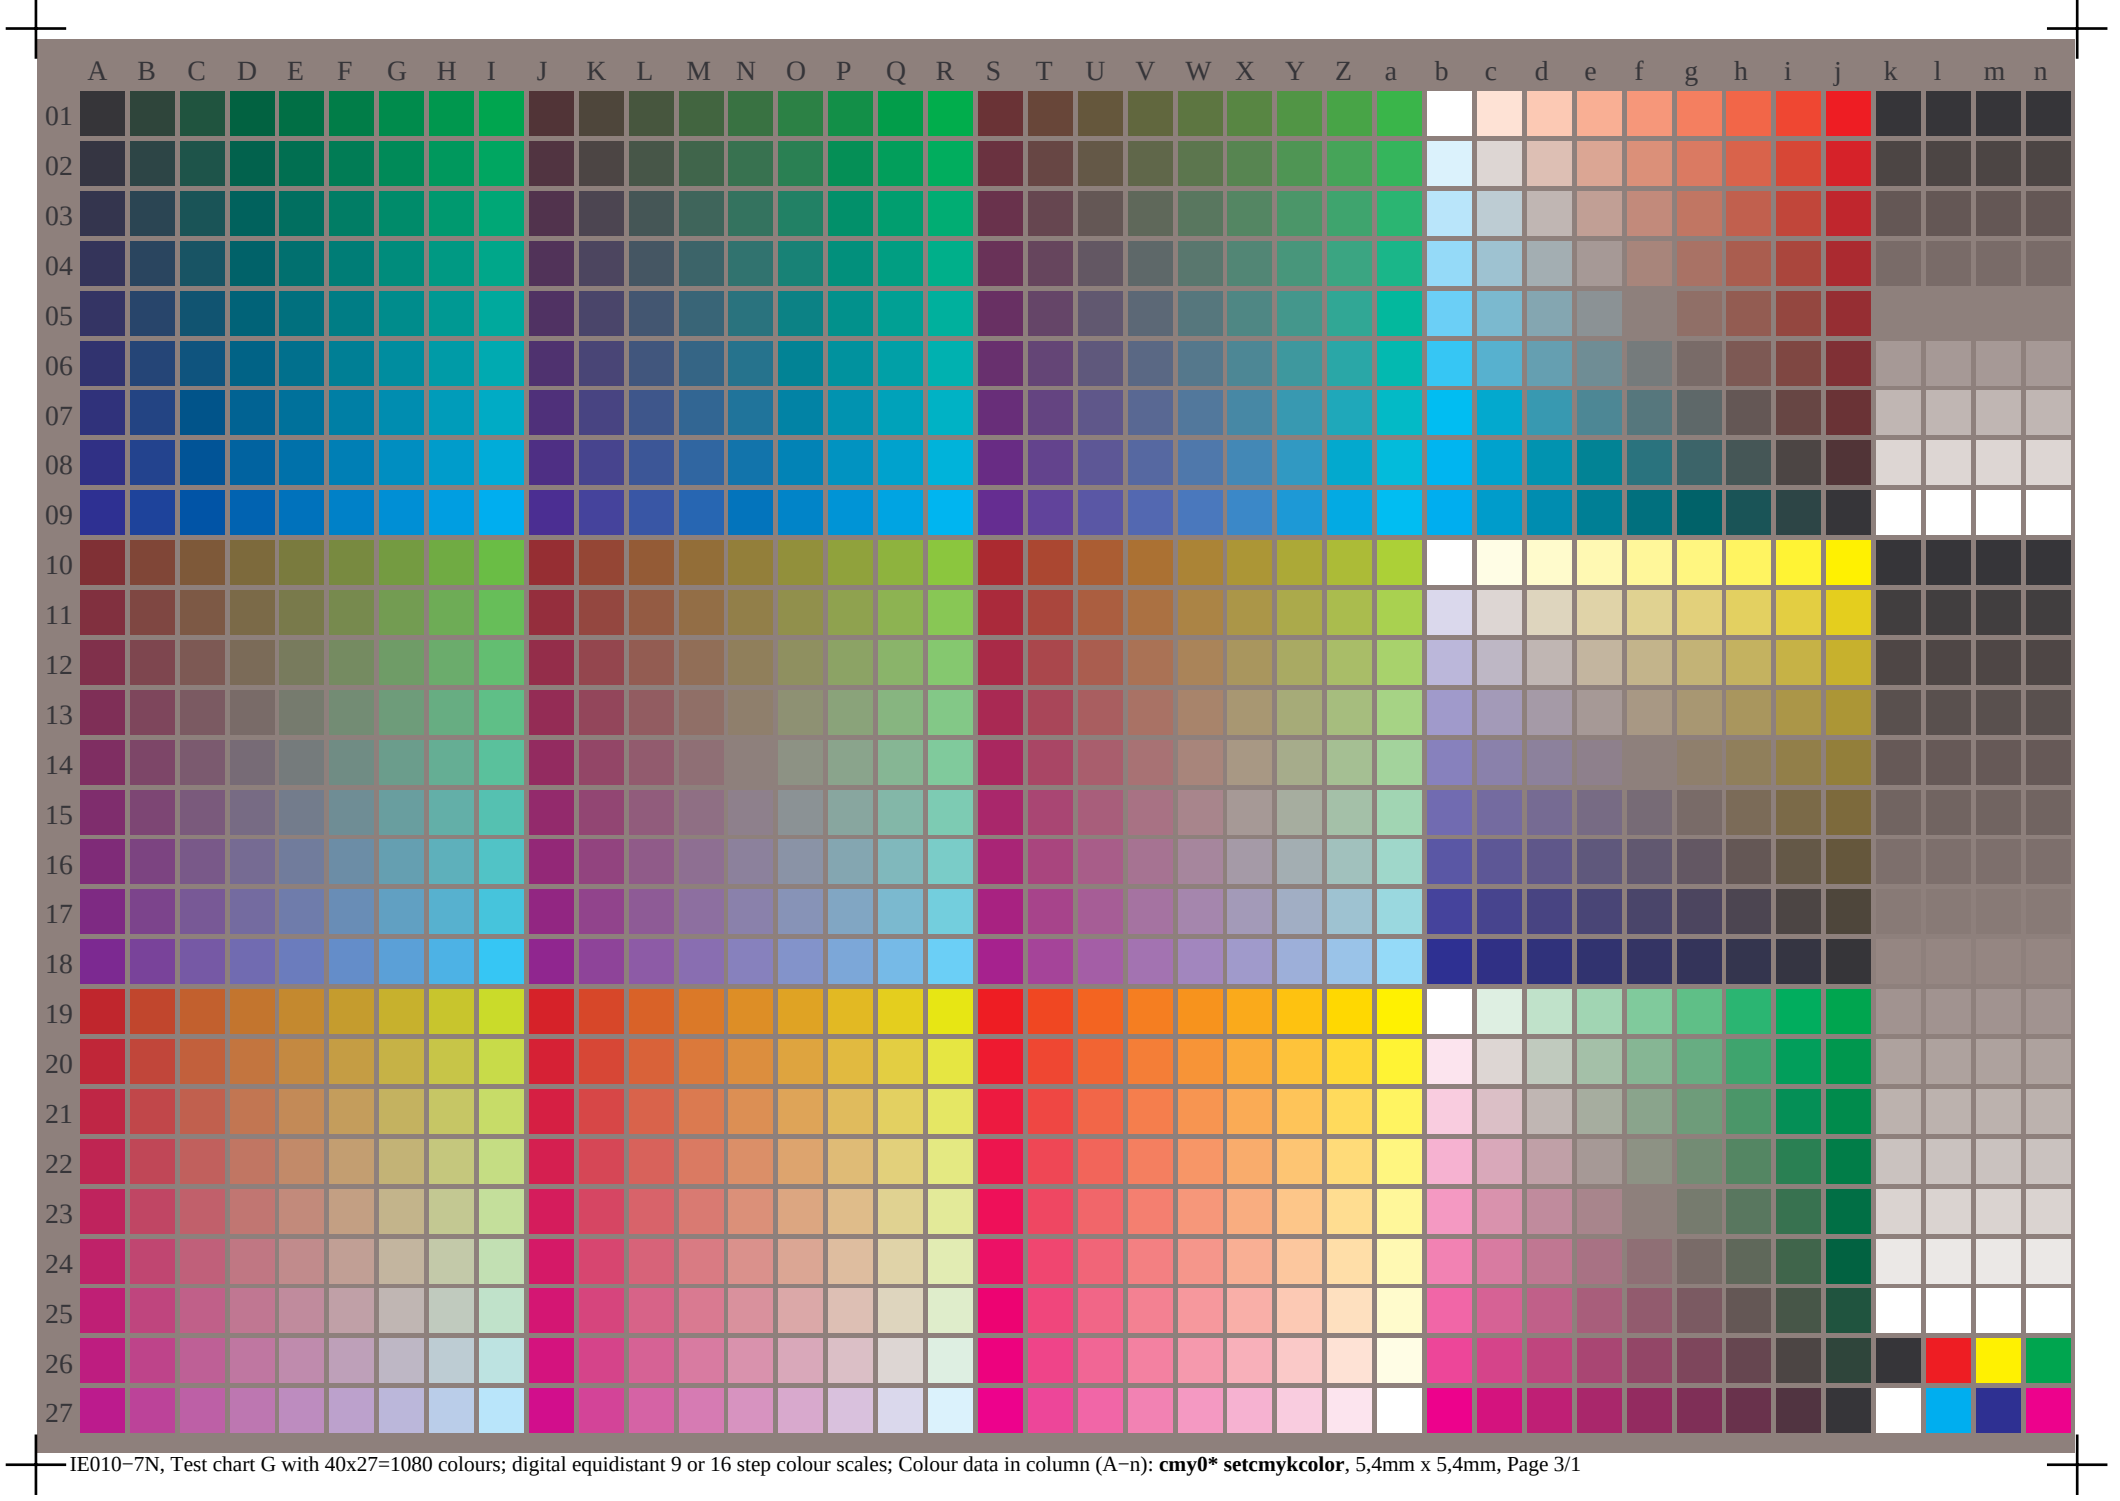

[illegible]