
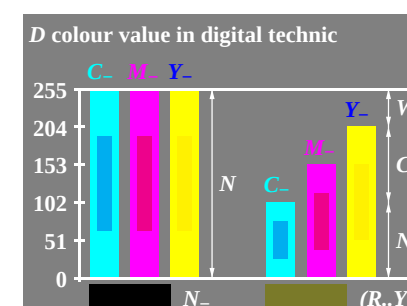
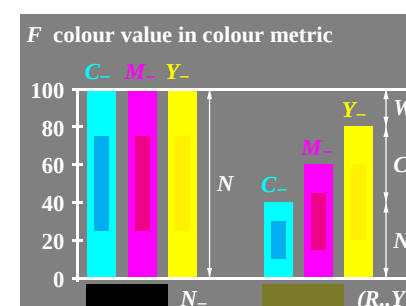
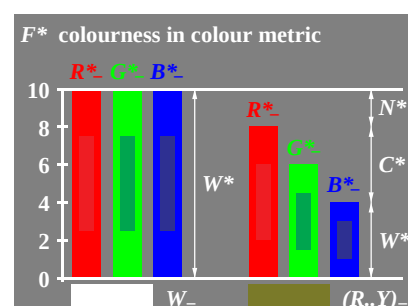
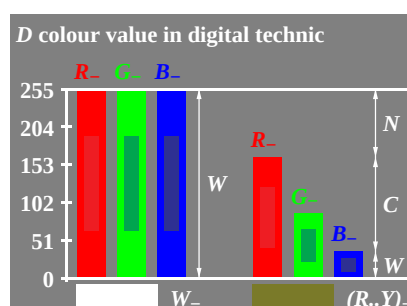
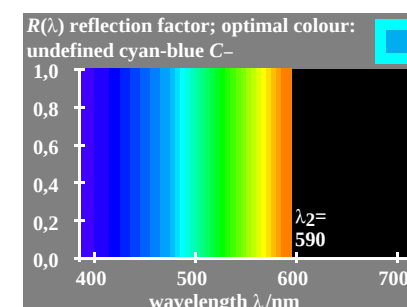
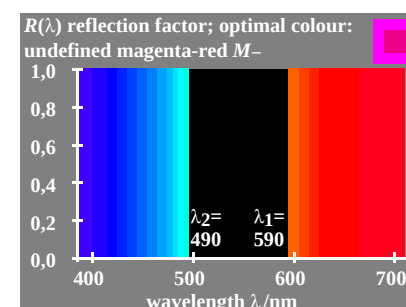
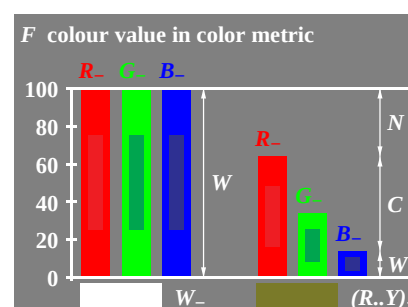
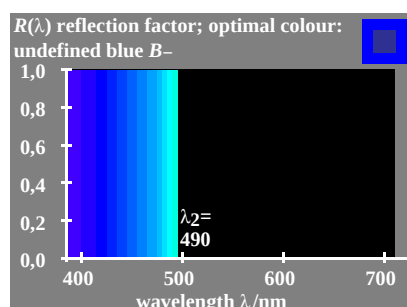
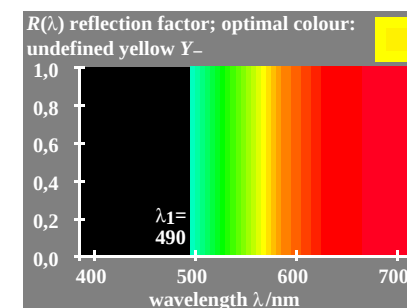
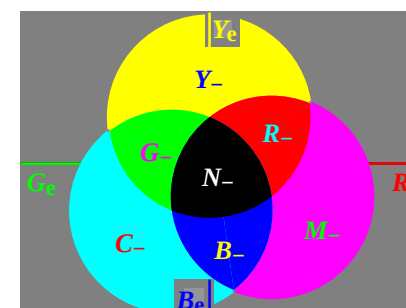
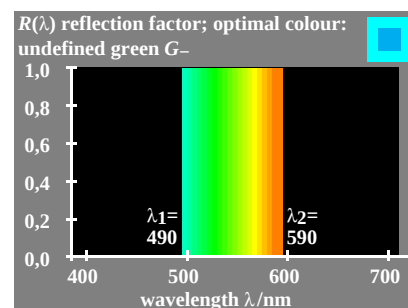
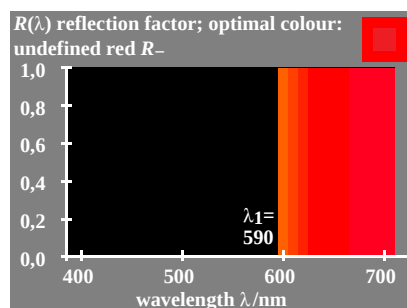
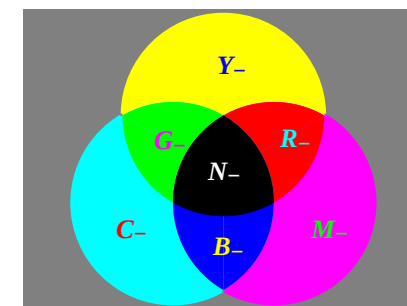
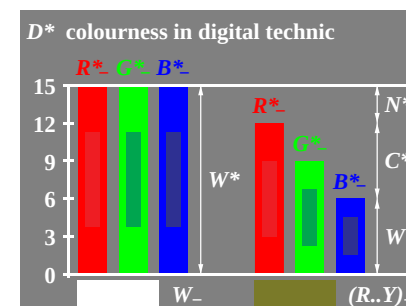
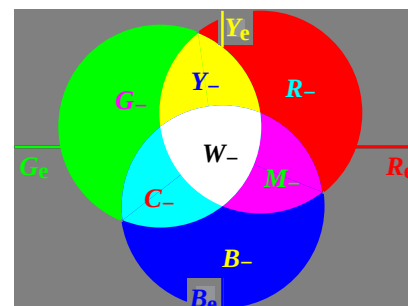


http://130.149.60.45/~farbmetrik/ME05/ME05L0NP.PDF /.PS; start output  
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://130.149.60.45/~farbmetrik/ME05/ME05.HTM>  
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

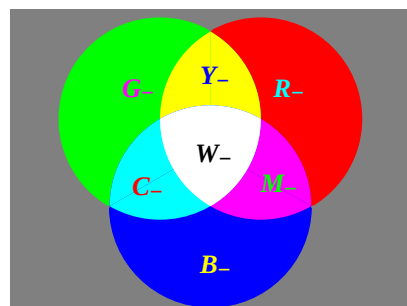

















TUB-test chart ME05; Computer graphics and colorimetry  
Image series ME05, 3D=0, de=0

input: rgb/cmyk -> rgb/cmyk  
output: no change



http://130.149.60.45/~farbmeterik/ME05/ME05L0NP.PDF /.PS; transfer output  
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://130.149.60.45/~farbmeterik/ME05/ME05.HTM>  
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmeterik>

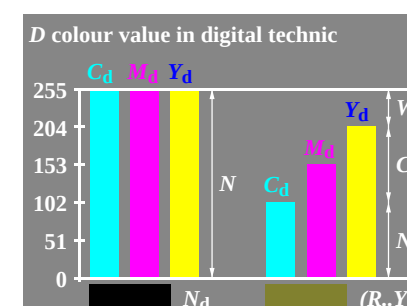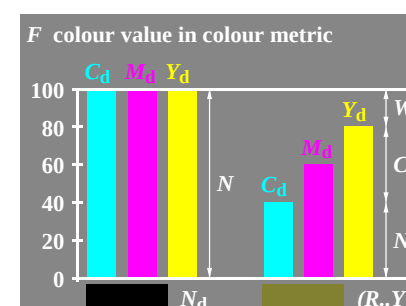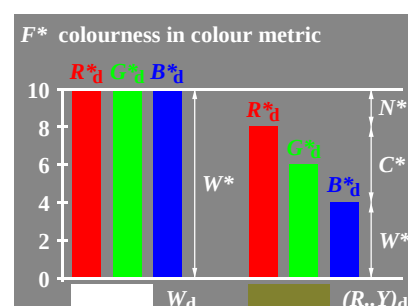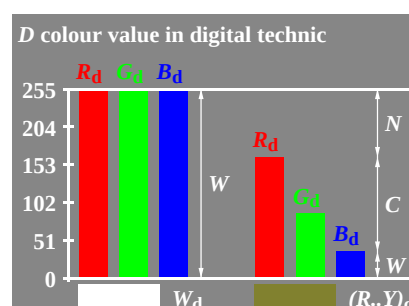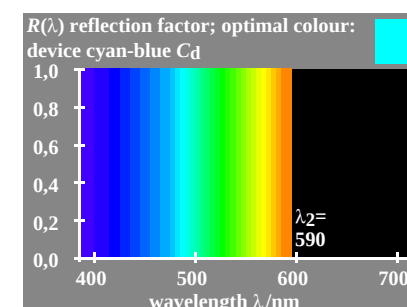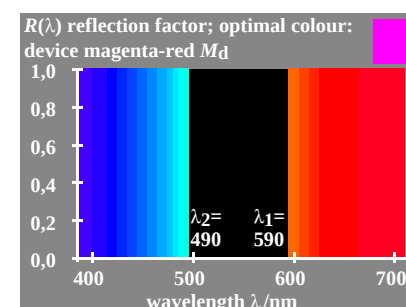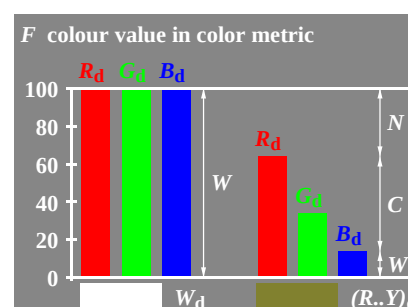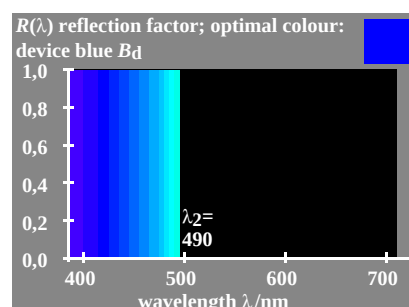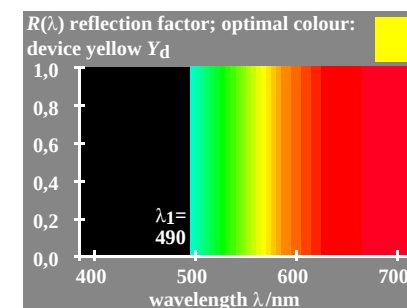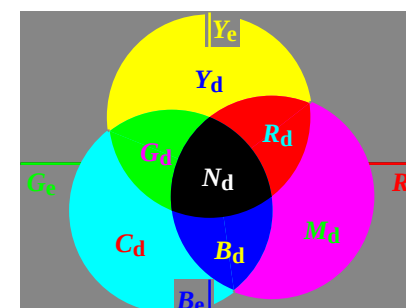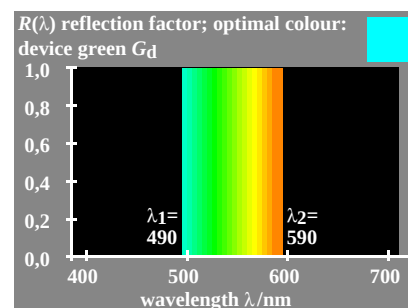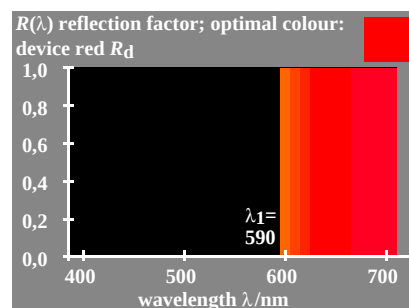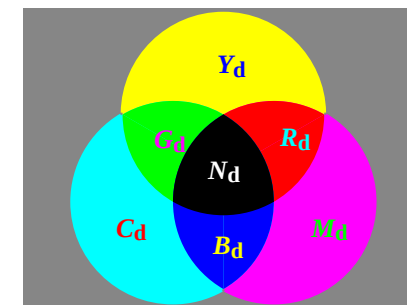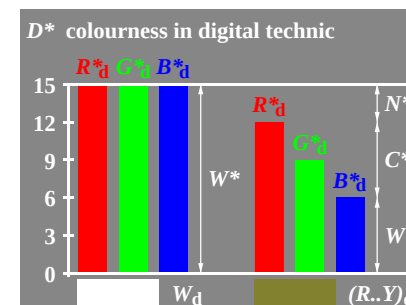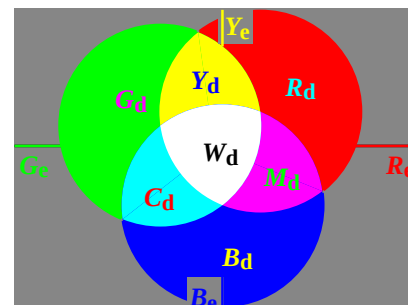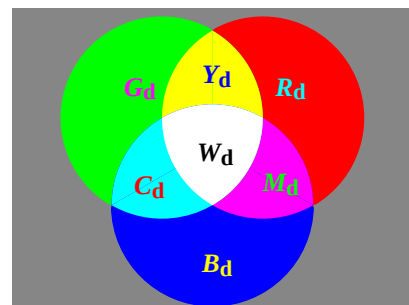

TUB-test chart ME05; Computer graphics and colorimetry  
Image series ME05, 3D=0, de=0, sRGB

input: rgb/cmyk -> rgbd  
output: transfer to rgbd

http://130.149.60.45/~farbmetrik/ME05/ME05L0NP.PDF /.PS; start output  
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://130.149.60.45/~farbmetrik/ME05/ME05.HTM>  
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

















ME05s0s

TUB registration: 20130201-ME05/ME05L0NP.PDF /.PS  
application for measurement of display output

TUB material: code=rha4ta

















input: *rgb/cmyk* -> *rgb/cmyk*  
output: no change

TUB-test chart ME05; Computer graphics and colorimetry  
Image series ME05, 3D=0, de=1

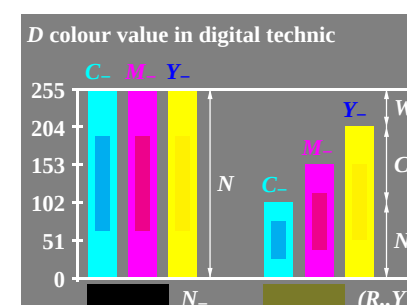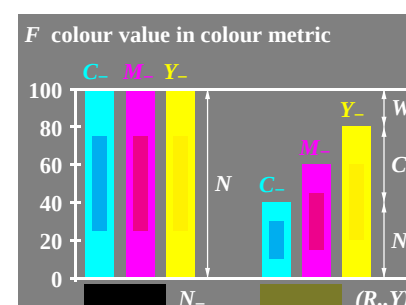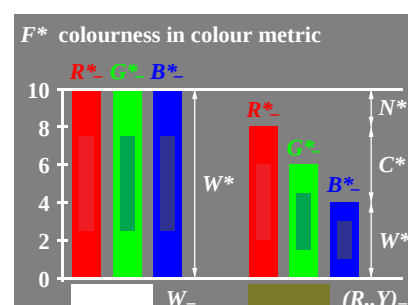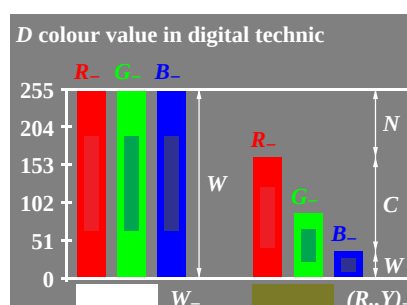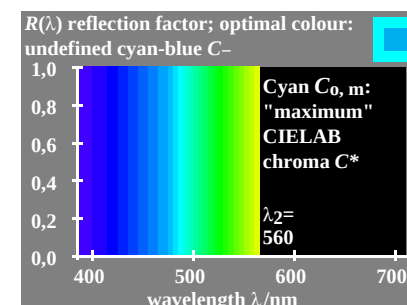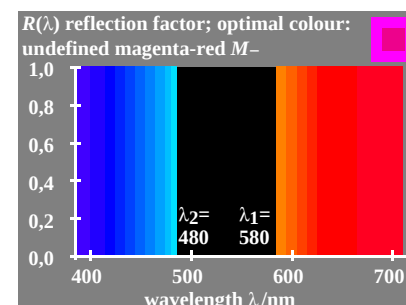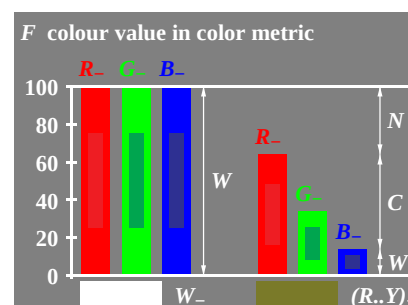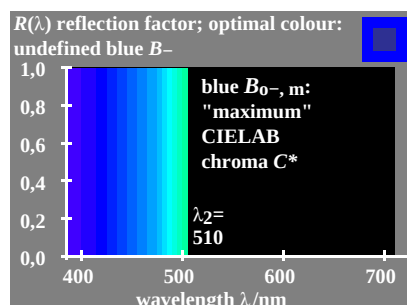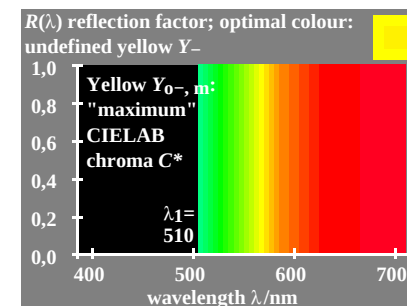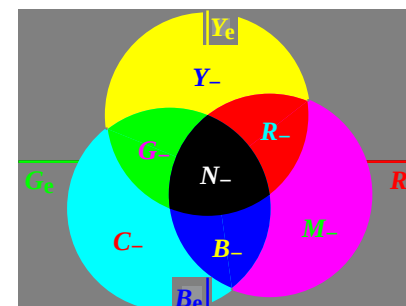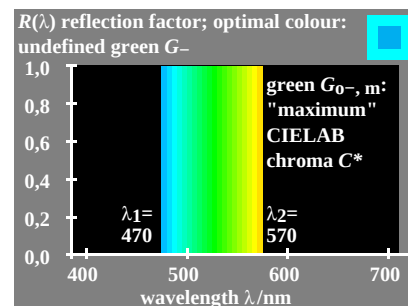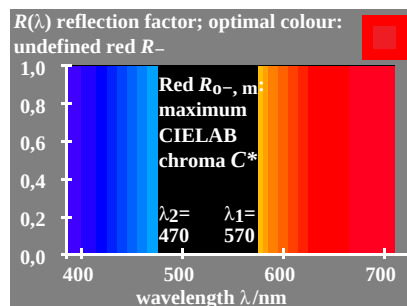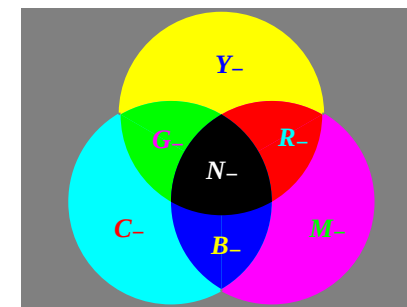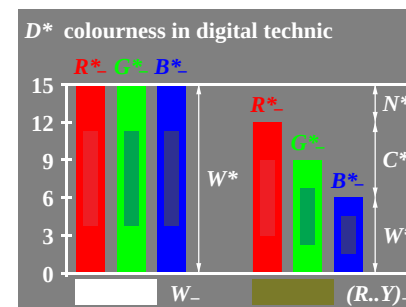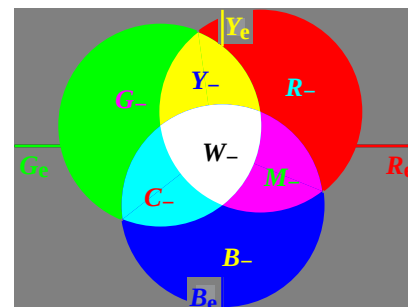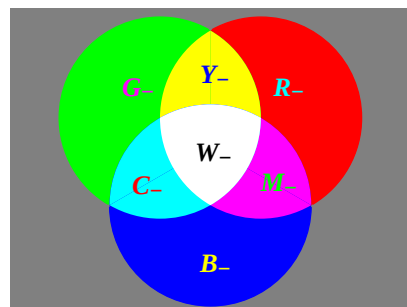

http://130.149.60.45/~farbmetrik/ME05/ME05L0NP.PDF /.PS; transfer output  
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://130.149.60.45/~farbmetrik/ME05/ME05.HTM>  
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

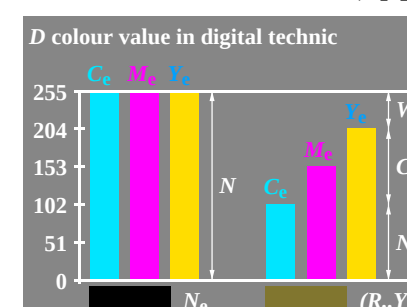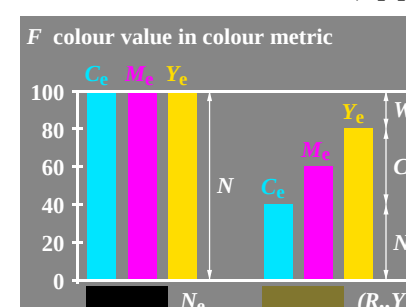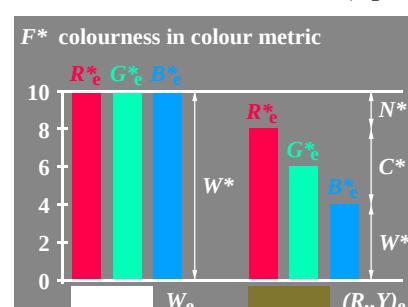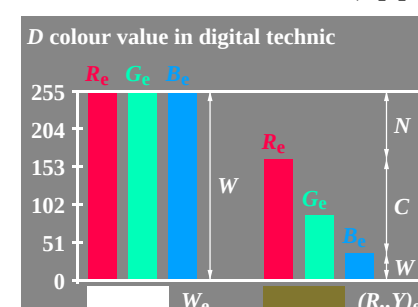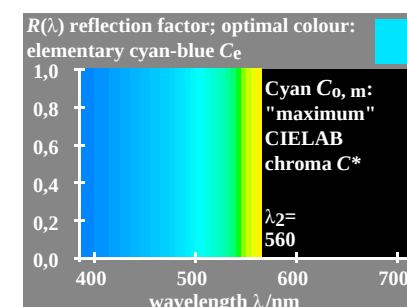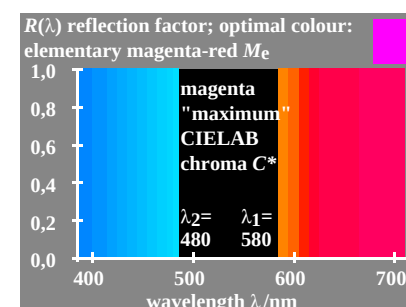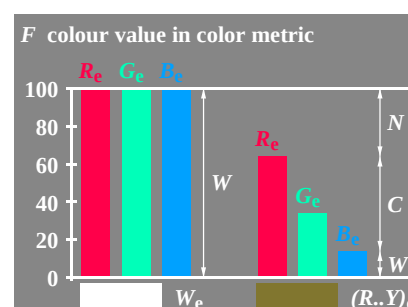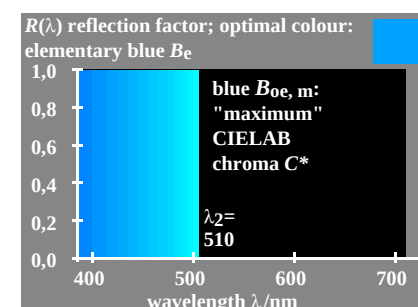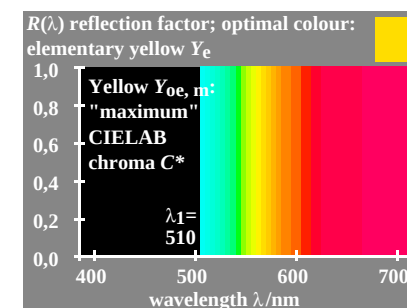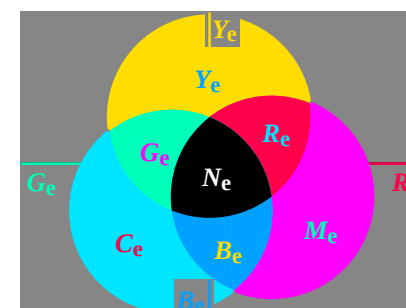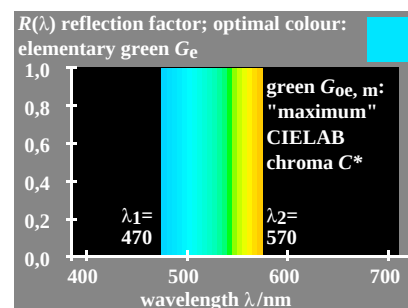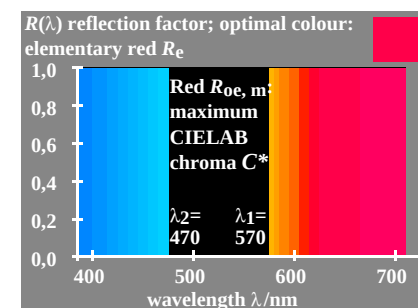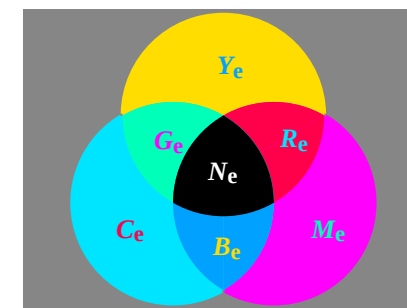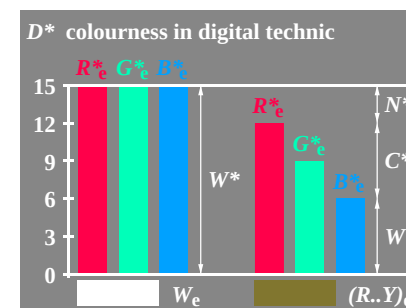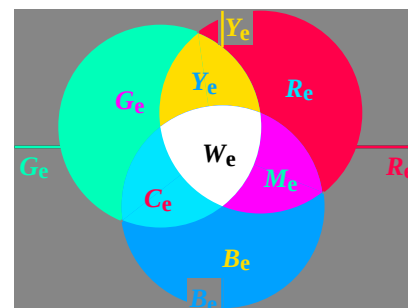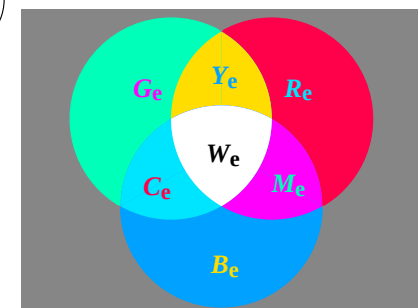

TUB-test chart ME05; Computer graphics and colorimetry  
Image series ME05, 3D=0, de=1, sRGB

input: *rgb/cmyk* -> *rgb<sub>e</sub>*  
output: transfer to *rgb<sub>e</sub>*