
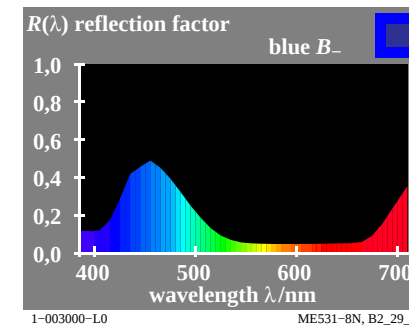
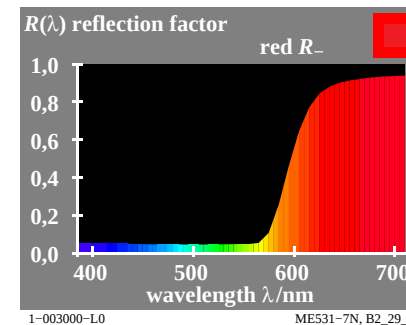
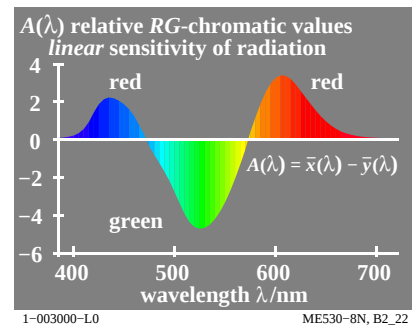
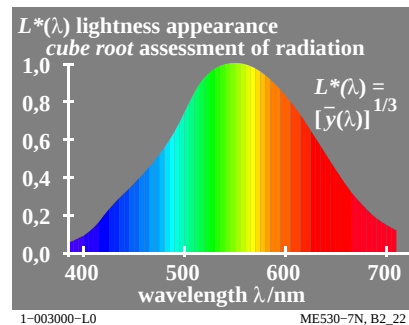
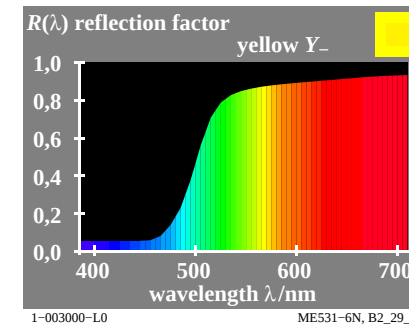
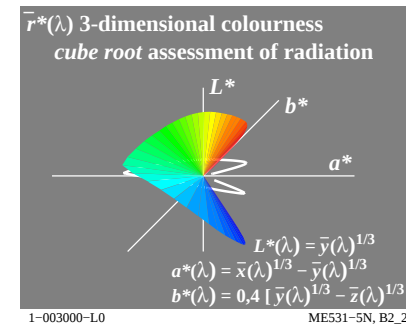
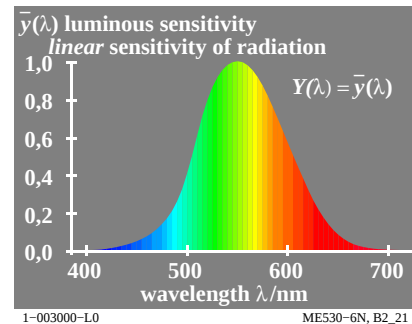
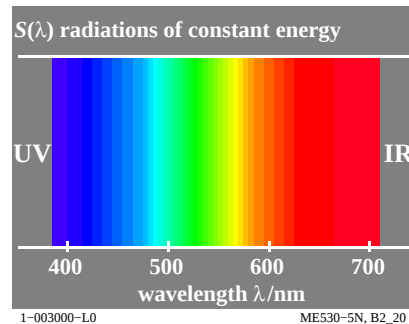
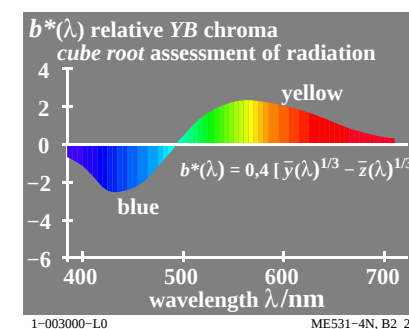
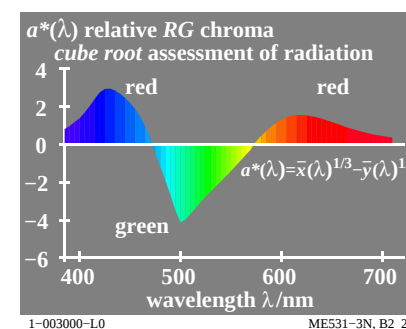
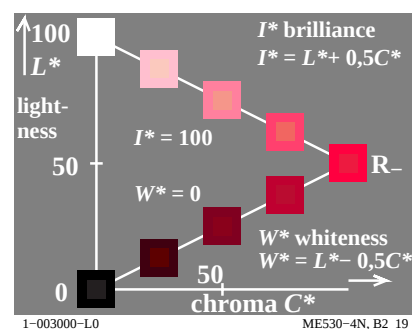
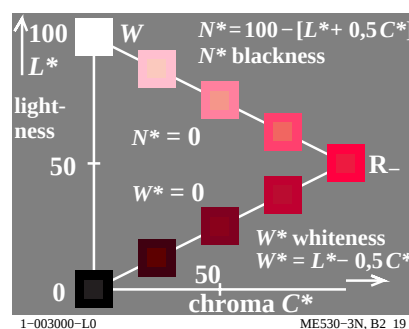
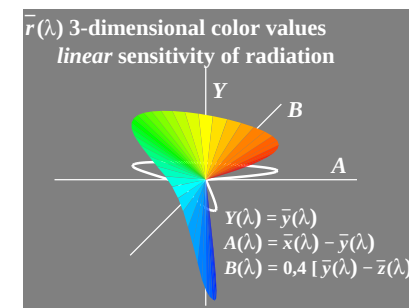
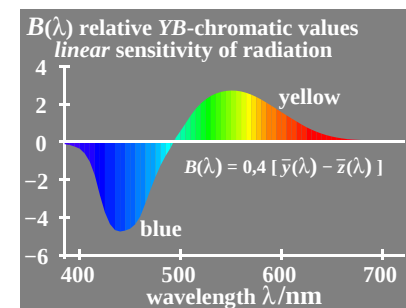
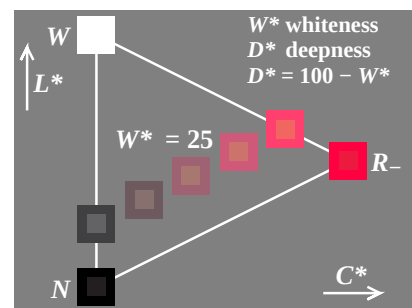


<http://farbe.li.tu-berlin.de/ME53/ME53L0NP.PDF> /PS; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://farbe.li.tu-berlin.de/ME53/ME53.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME53/ME53L0NP.PDF /PS
application for measurement of display output

TUB material: code=rha4ta

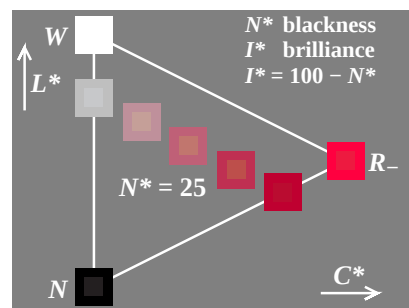

















TUB-test chart ME53; Computer graphics and colorimetry
Image series ME53, 3D=0, de=0

input: rgb/cmyk -> rgb/cmyk
output: no change



<http://farbe.li.tu-berlin.de/ME53/ME53L0NP.PDF> /.PS; transfer output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2


see similar files: <http://farbe.li.tu-berlin.de/ME53/ME53L0NP.PDF> /.PS
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

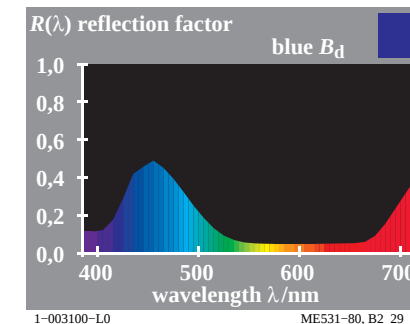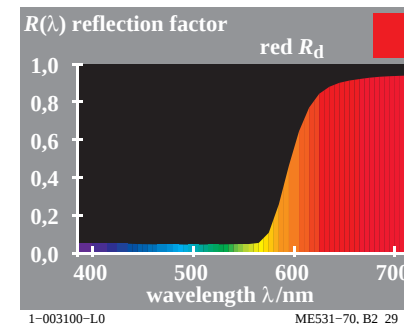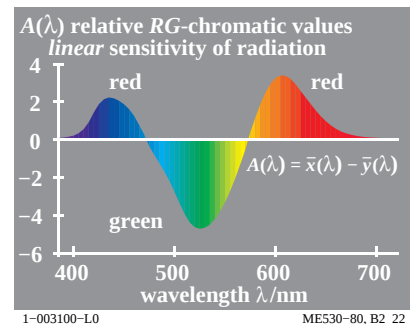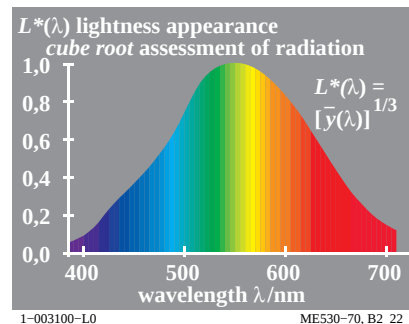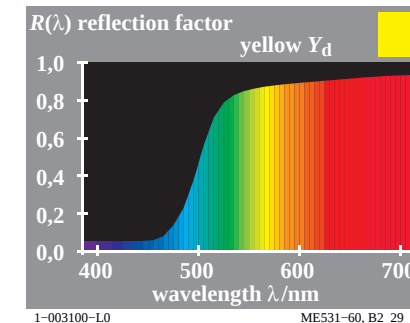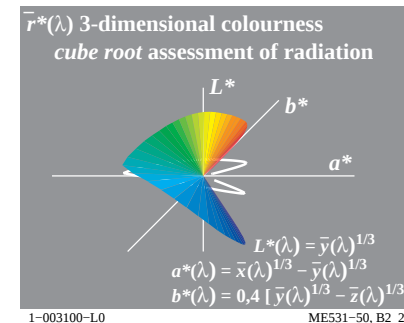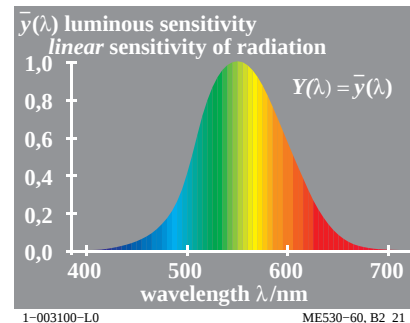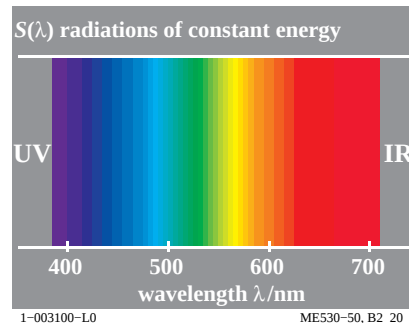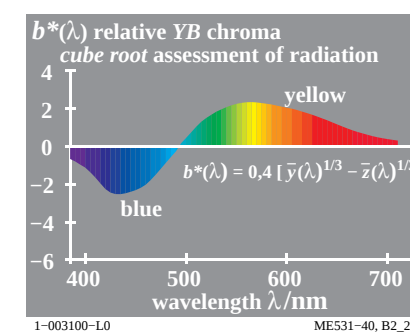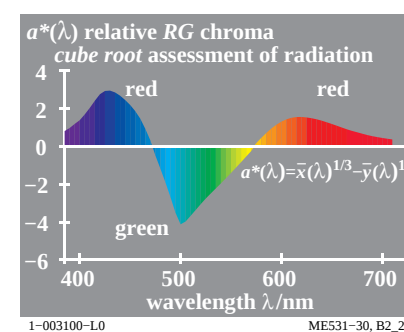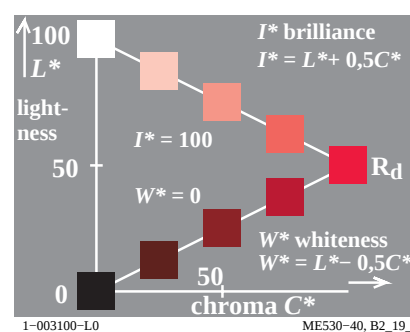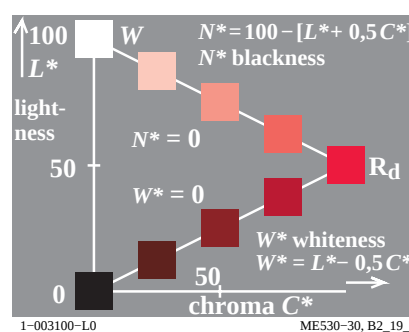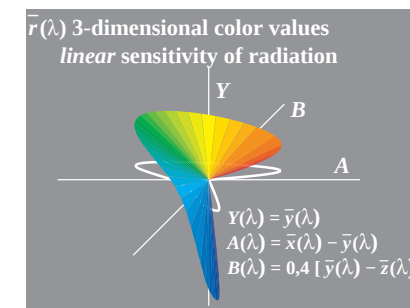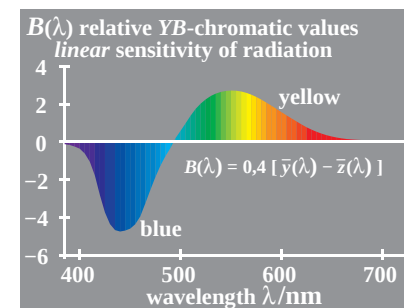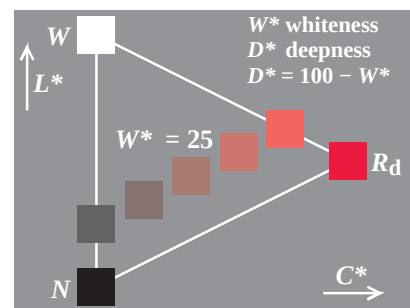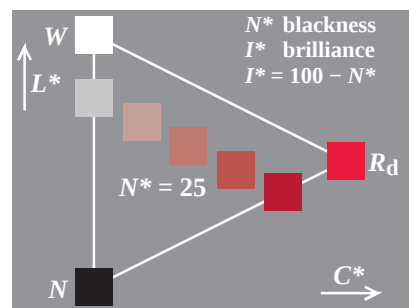

TUB-test chart ME53; Computer graphics and colorimetry
Image series ME53, 3D=0, de=0, L^* -cmyn6

PE4300L_120830.TXT, 1080 colors, Separation cmyn6*
input: $rgb/cmyk \rightarrow rgb_d$
output: transfer to rgb_d





















<http://farbe.li.tu-berlin.de/ME53/ME53L0NP.PDF> /.PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://farbe.li.tu-berlin.de/ME53/ME53L0NP.PDF> /.PS
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

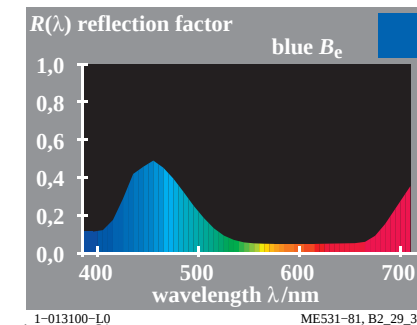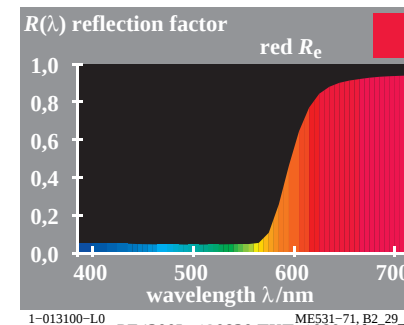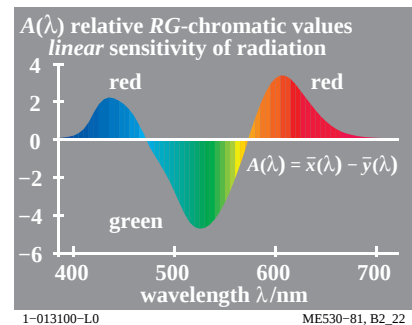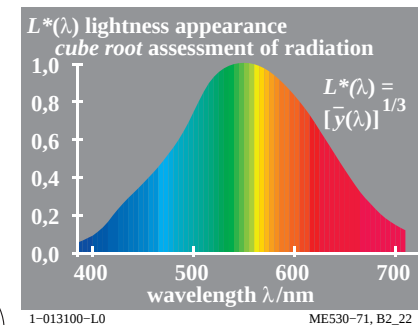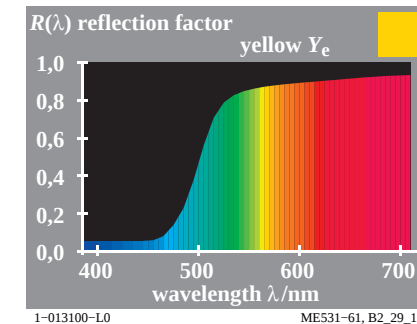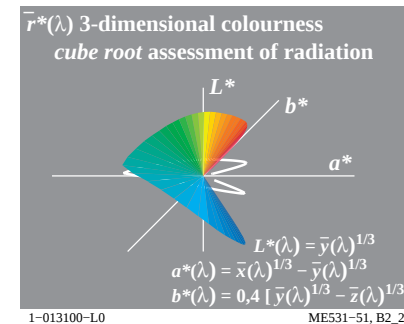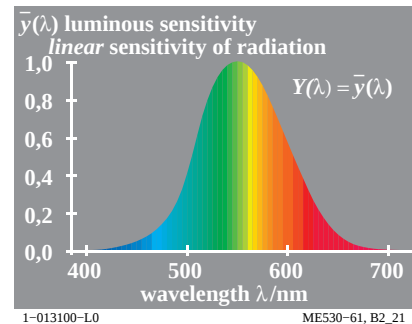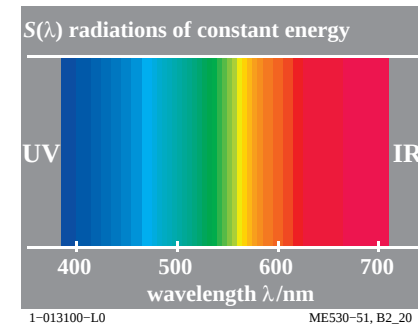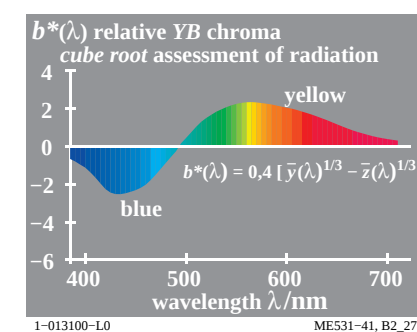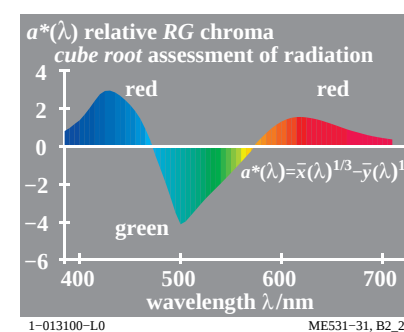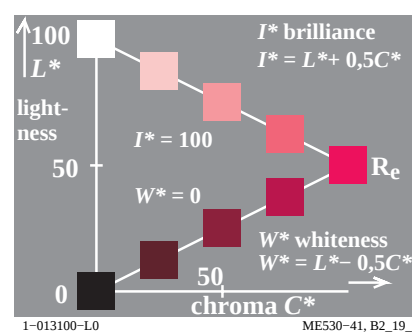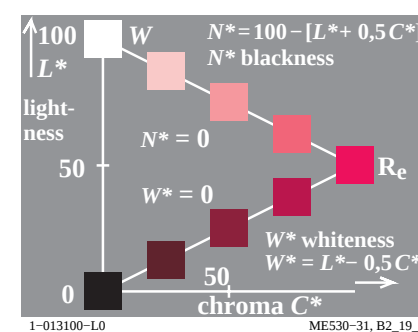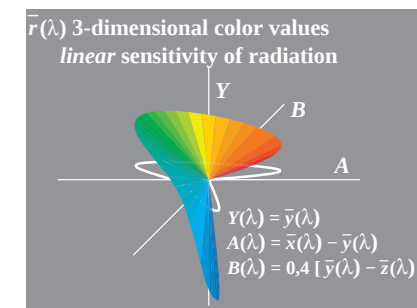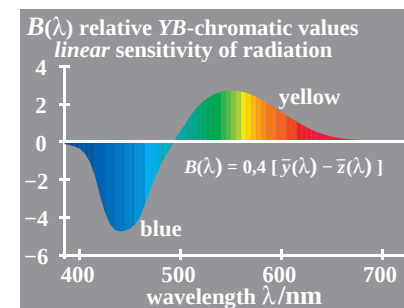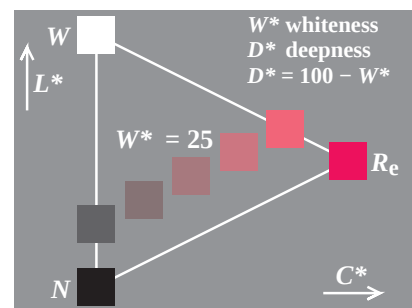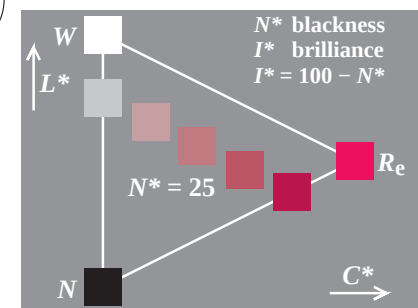

TUB-test chart ME53; Computer graphics and colorimetry
Image series ME53, 3D=0, de=1, L^* -cmyn6

PE4300L_120830.TXT, 1080 colors, Separation cmyn6*
input: $rgb/cmyk \rightarrow rgb_e$
output: transfer to rgb_e

