


See original or copy: <http://web.me.com/klaus.richter/LE75/LE75L0NA.TXT> /.PS  
Technical information: <http://www.ps.barn.de> or <http://130.149.60.45/~farbmetrik>

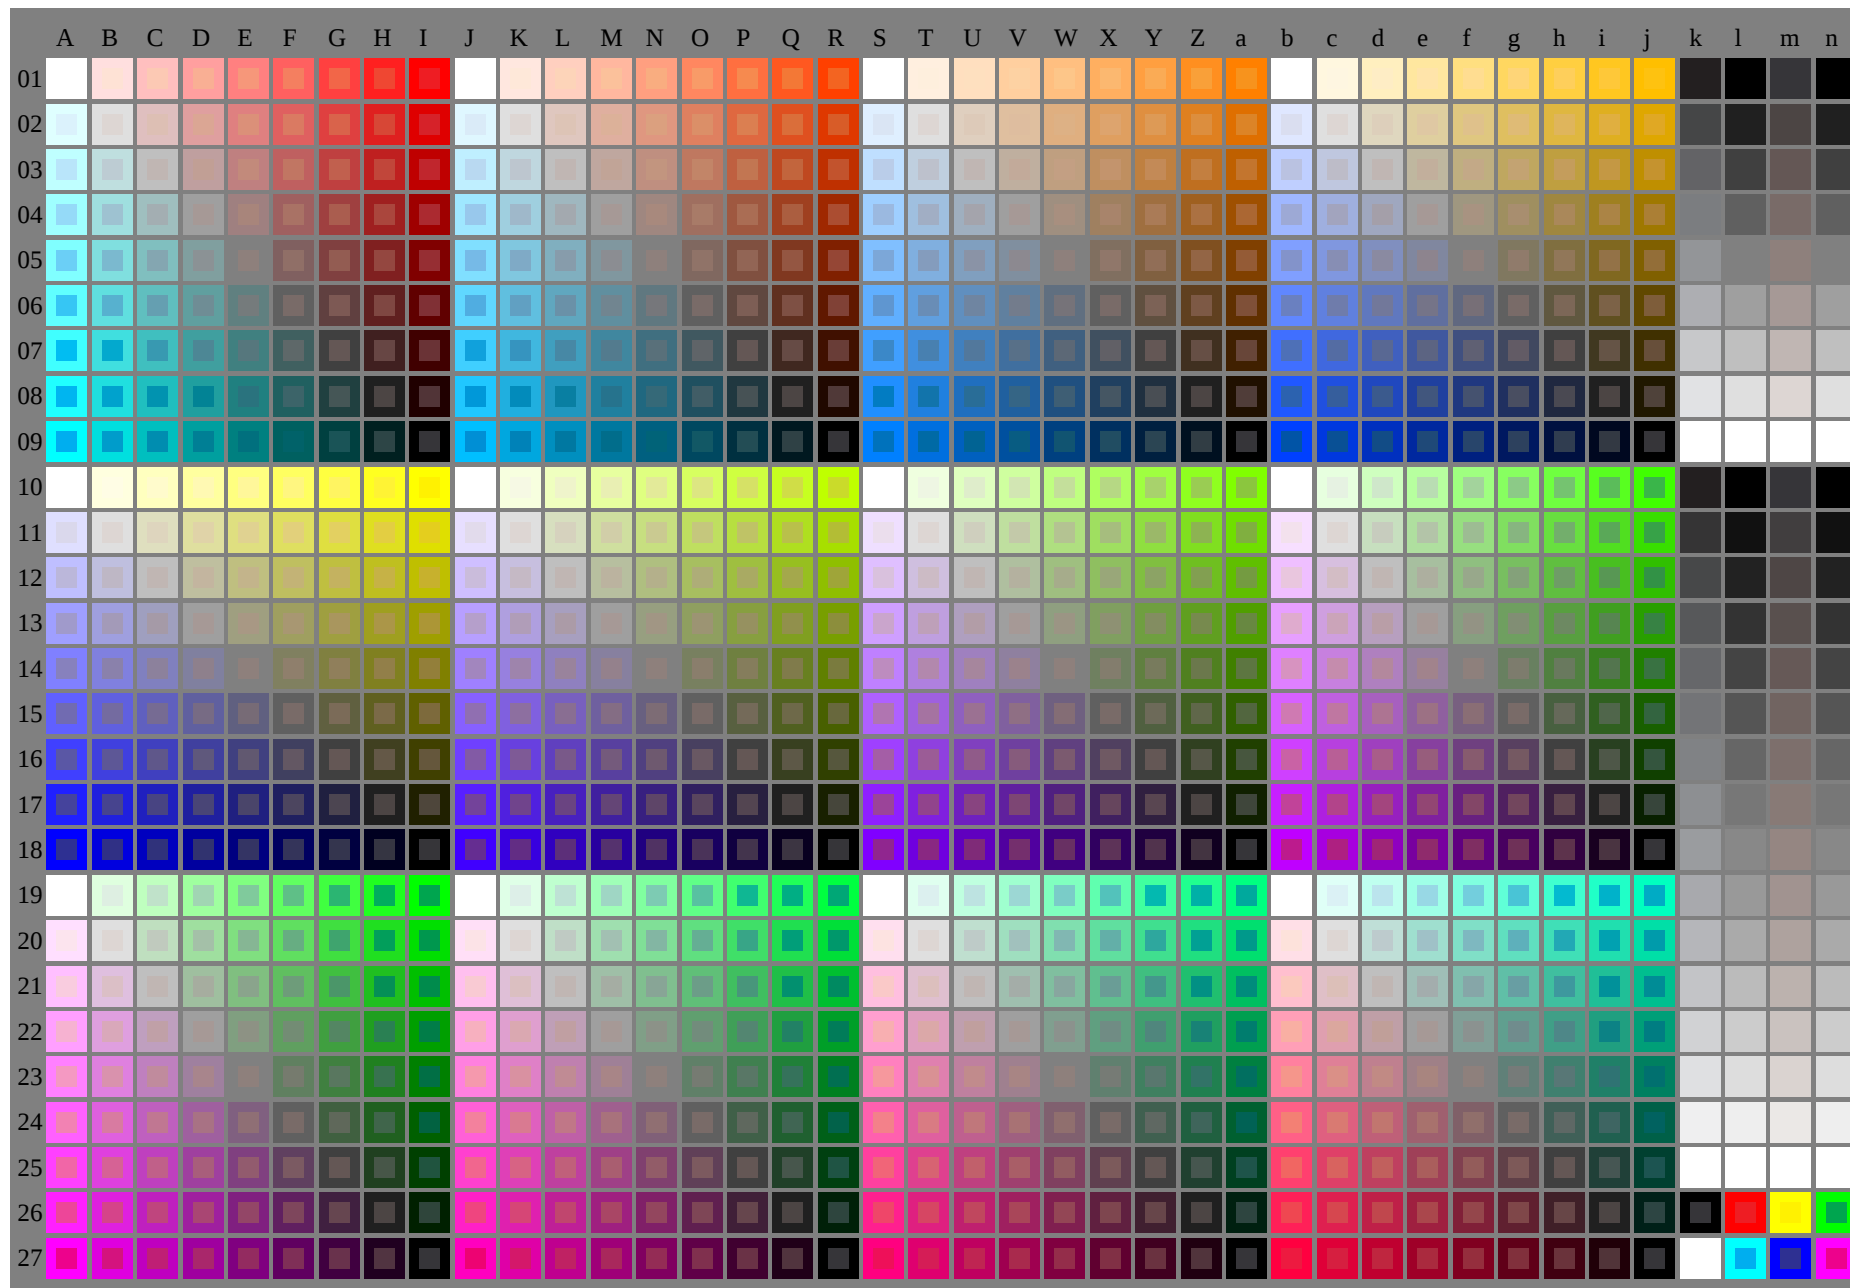

TUB registration: 20110301-LE75/LE75L0NA.TXT /.PS  
application for measurement of printer or monitor systems

TUB material: code=rha4ta

LE750-7N, 1/3, Test chart O with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): **rgb + cmy0 (A\_j + k26\_n27), 000n (k), w (l), nnn0 (m), www (n), colorm = 0, separation = A**

TUB-test chart LE75; Colorimetric system O, Page 1/1

40x27=1080 colours for Measurement: **rgb/000n/w/nnn0/www**

input: **rgb/000n/w/nnn0/www**


output: no change compared to input

http://130.149.60.45/~farbmetrik/LE75/LE75L0NA.TXT /.PS; start output  
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)

See original or copy: <http://web.me.com/klaus.richter/LE75/LE75L0NA.TXT> /.PS  
Technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20110301-LE75/LE75L0NA.TXT /.PS  
application for measurement of printer or monitor systems

TUB material: code=rha4ta

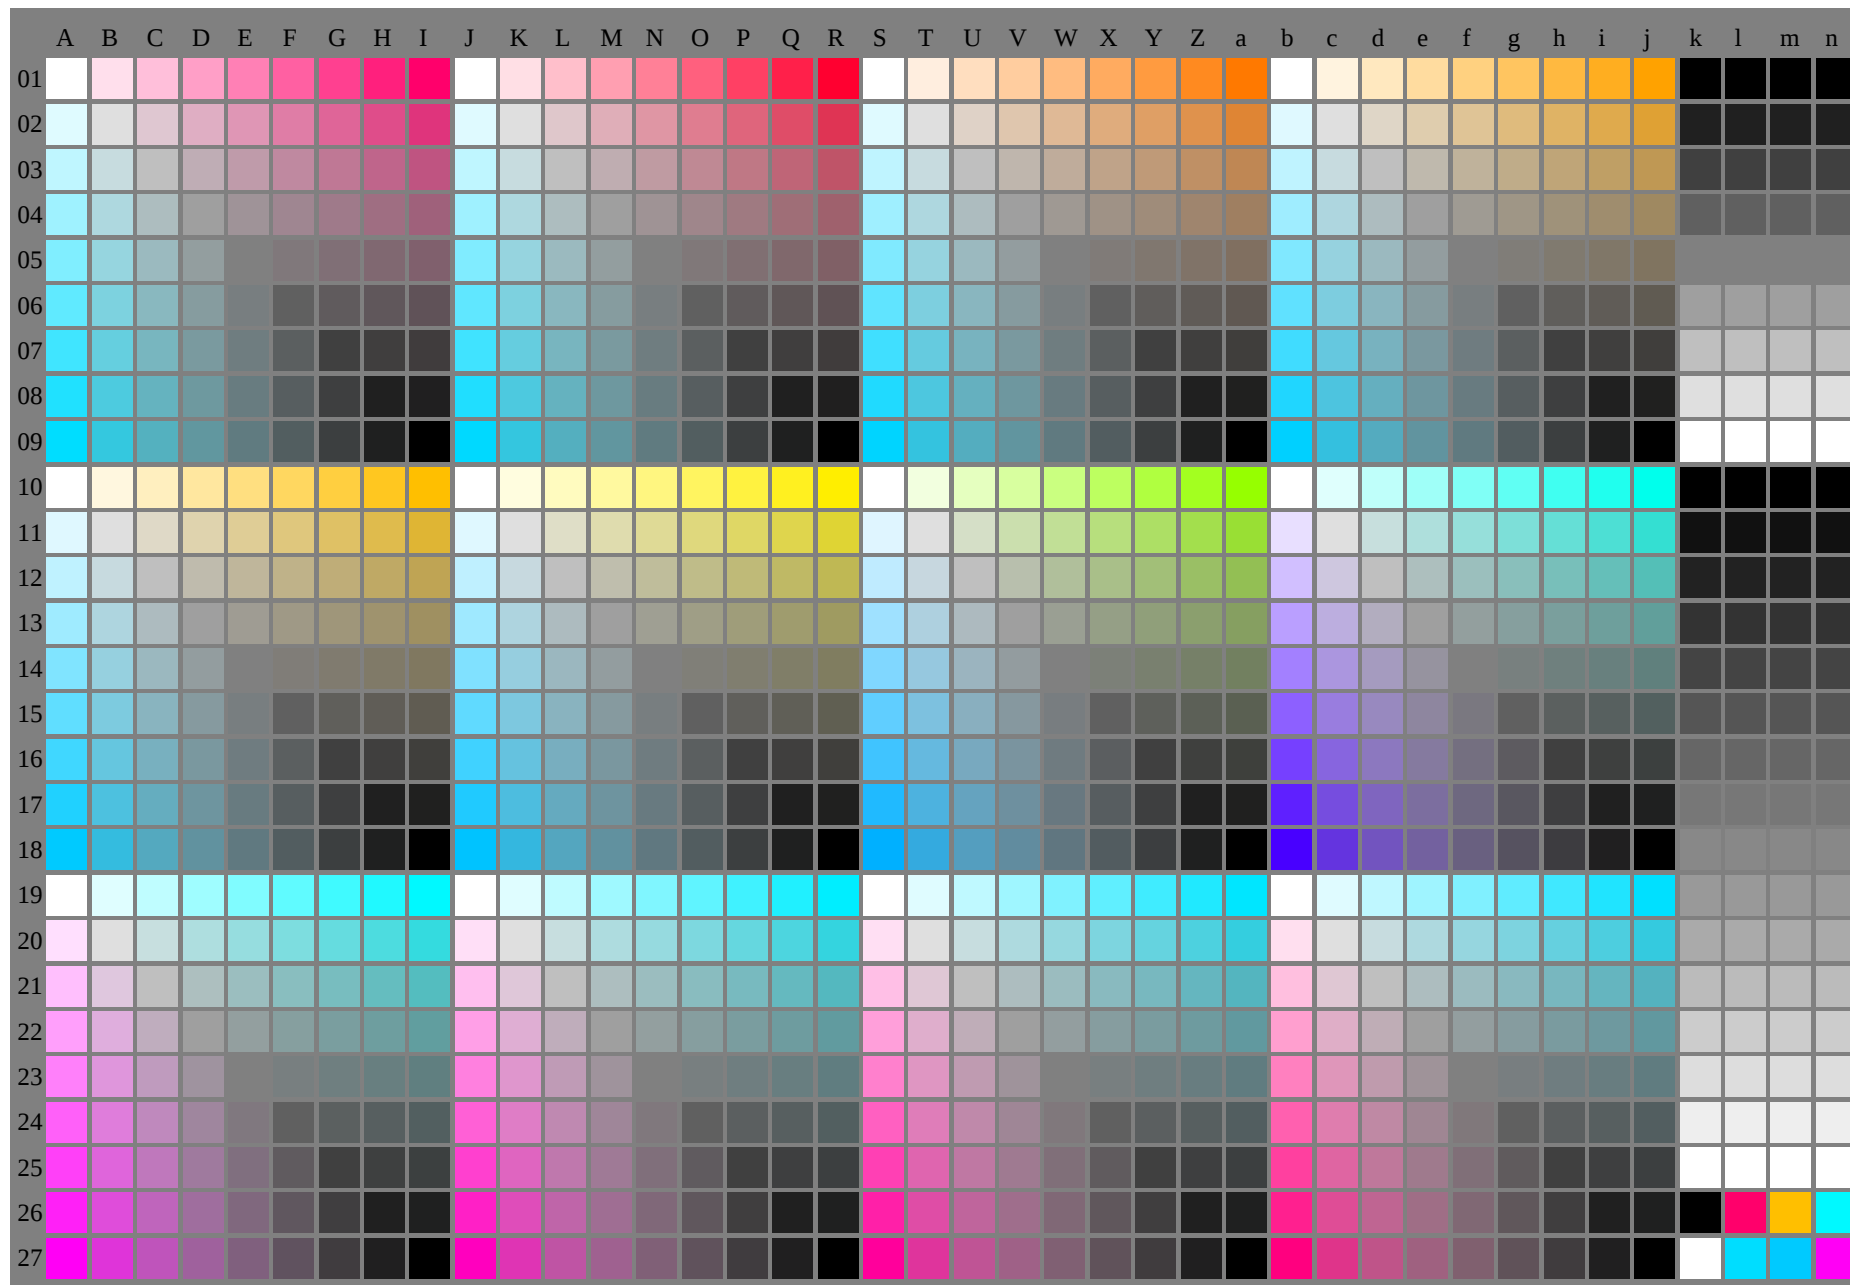

LE750-7N, 1/3, Test chart O with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n):  $rgb^*$  (A\_n),  $colorim = 1$ ,  $separation = A$ ,  $cmy0^*$

TUB-test chart LE75; Colorimetric system O, Page 1/1

input:  $rgb/000n/w/nnn0/www$

40x27=1080 colours for Measurement:  $rgb/000n/w/nnn0/www$

output: no change compared to input