


See similar ISO test charts: <http://www.ps.bam.de/24705TE>, <http://www.ps.bam.de/9241E>
Technical information: <http://www.ps.bam.de/33872E> Version 2.1, io=1,1

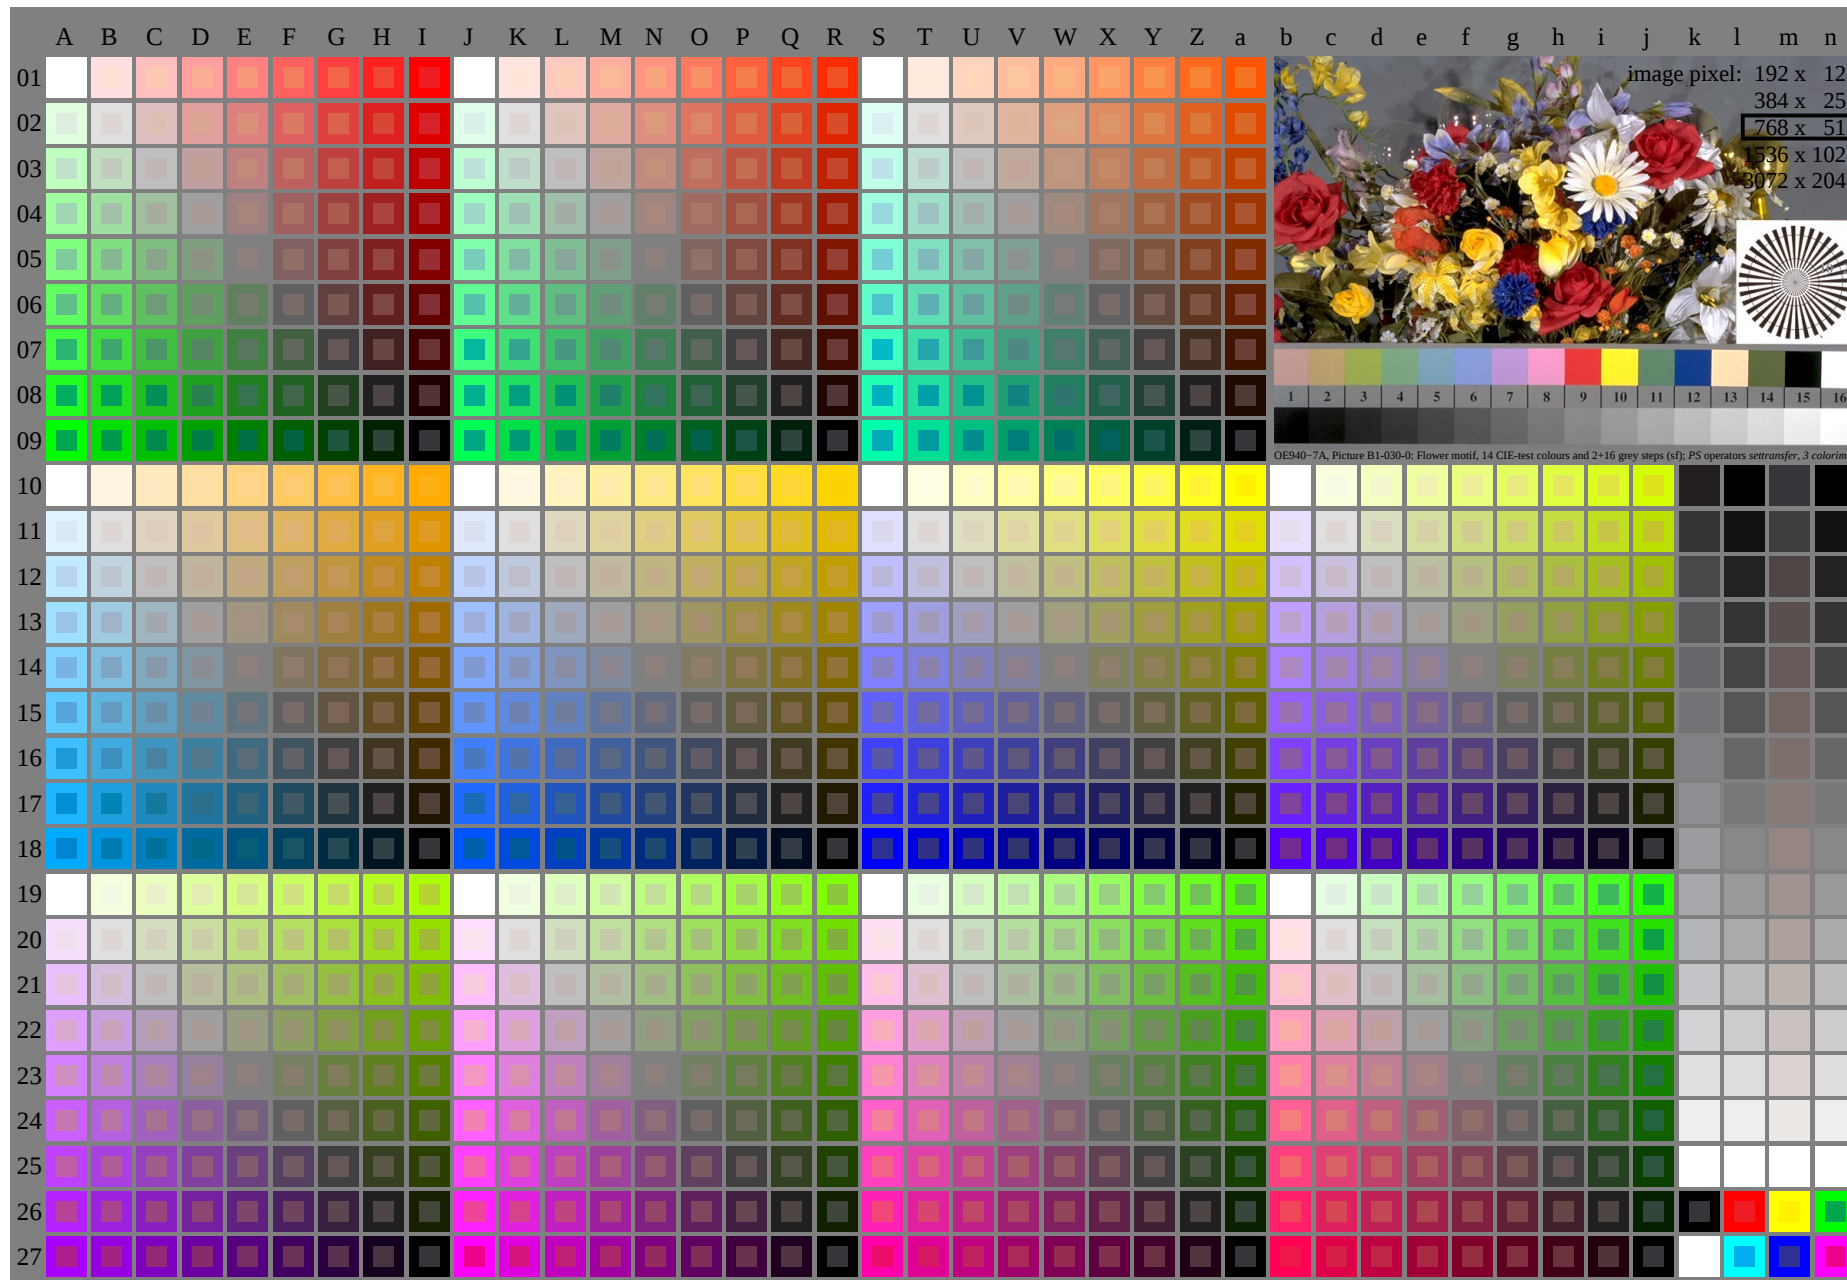

OE94: Test chart 2E with 40x27=1080 colours; DH
Digital equidistant 9 or 16 step colour scales

input: 000n/w/cmy0/rgb (->rgb*d
output 030-0: no change

TUB registration: 20110801-OE94/OE94L0NA.TXT /.PS
application for output of displays: monitor systems or data projector systems
TUB material: code=rha4ta

http://130.149.60.45/~farbmetrik/OE94/OE94L0NA.TXT /.PS; start output, Page 2/3
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)

TUB registration: 20110801-OE94/OE94LONA.TXT / PS TUB material: code=rha4ta
application for output of displays: monitor systems or data projector systems

See similar ISO test charts: <http://www.ps.bam.de/24705TE>, <http://www.ps.bam.de/33872E> Version 2.1, io=1, Technical information: <http://www.ps.bam.de/33872E>

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X	Y	Z	a	b	c	d	e	f	g	h	i	j	k	l	m	n													
0000 A01	0009 B01	0018 C01	0027 D01	0036 E01	0045 F01	0054 G01	0063 H01	0072 I01	0081 J01	0090 K01	0099 L01	0108 M01	0117 N01	0126 O01	0135 P01	0144 Q01	0153 R01	0162 S01	0171 T01	0180 U01	0189 V01	0198 W01	0207 X01	0216 Y01	0225 Z01	0234 a01																											
0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.125	0.125	0.125	0.125	0.125	0.125	0.125	0.125	0.125	0.125	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25							
0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0
0.0125	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375	0.5	0.625	0.75	0.875	1.0	0.0	0.125	0.25	0.375														

OE940-70, Page 2/16, Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): rgb (A_j + k26_n27), 000n (k), w (l), nnn0 (m), www (n), colorm = 0, xchart = 0, pchart = 1

OE94: Test chart 2E with 40x27=1080 colours; DH Digital equidistant 9 or 16 step colour scales	input: 000n/w/cmy0/rgb (->rgb*d) output 030-1: no change
---	---

See similar ISO test charts: <http://www.ps.bam.de/24705ITE>, <http://www.ps.bam.de/9241E>
Technical information: <http://www.ps.bam.de/33872E> Version 2.1, io=1,1

i	LAB*ref	L*out	LAB*out	LAB*out/c-ref	ΔE*
1	0.0	0.0	0.0	0.0	0.01
2	6.36	0.0	0.07	6.36	0.01
3	12.72	0.0	0.13	12.72	0.01
4	19.08	0.0	0.2	19.08	0.01
5	25.44	0.0	0.27	25.44	0.01
6	31.8	0.0	0.33	31.8	0.01
7	38.16	0.0	0.4	38.16	0.01
8	44.52	0.0	0.47	44.52	0.01
9	50.89	0.0	0.53	50.89	0.01
10	57.25	0.0	0.6	57.25	0.01
11	63.61	0.0	0.67	63.61	0.01
12	69.97	0.0	0.73	69.97	0.01
13	76.33	0.0	0.8	76.33	0.01
14	82.69	0.0	0.87	82.69	0.01
15	89.05	0.0	0.93	89.05	0.01
16	95.41	0.0	1.0	95.41	0.01
17	0.0	0.0	0.0	0.0	0.01
18	23.85	0.0	0.25	23.85	0.01
19	47.71	0.0	0.5	47.71	0.01
20	71.56	0.0	0.75	71.56	0.01
21	95.41	0.0	1.0	95.41	0.01


Start output S1
Specification according to
ISO/IEC 15775 Annex G
and DIN 33866-1 Annex G

Mean lightness difference (16 steps)
 $\Delta E^*_{CIELAB} = 0.0$

Mean lightness difference (5 steps)
 $\Delta L^*_{CIELAB} = 0.0$

Mean colour reproduction index:
 $R^*_{ab,m} = 100$

OE940-3A-030-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

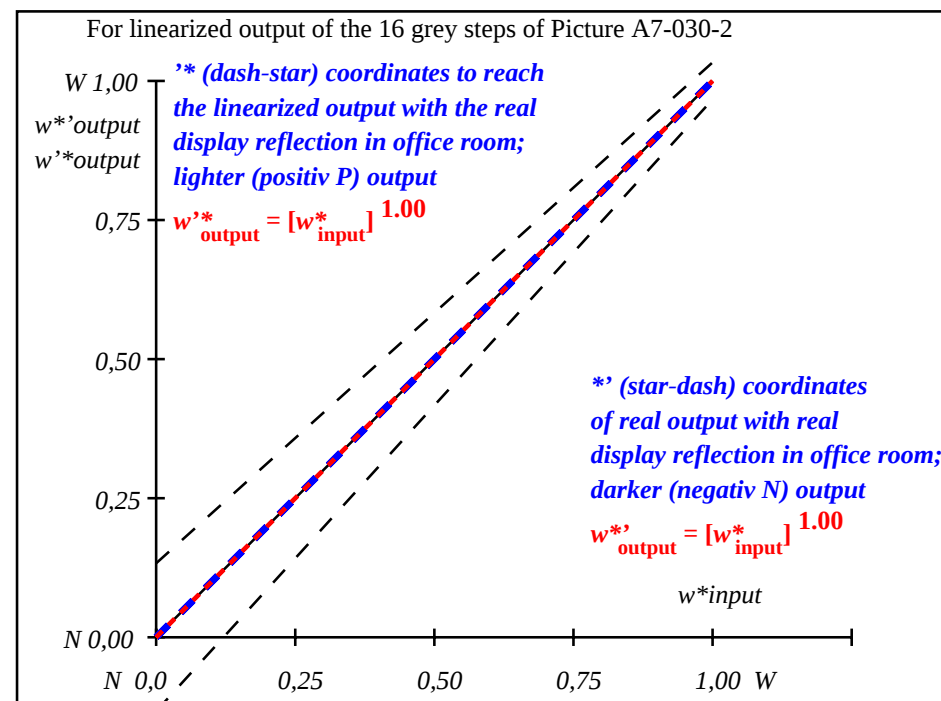

OE941-3N-030-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

$L^*/Y_{intended}$ (absolute)	0.0/0.0	6.4/0.7	12.7/1.5	19.1/2.8	25.4/4.6	31.8/7.0	38.2/10.2	44.5/14.2	50.9/19.2	57.2/25.2	63.6/32.3	70.0/40.7	76.3/50.4	82.7/61.6	89.0/74.3	95.4/88.6
$w^* w^* w^*$ setrgb $g_p=1.00$																
No. and Hex code	00;F	01;E	02;D	03;C	04;B	05;A	06;9	07;8	08;7	09;6	10;5	11;4	12;3	13;2	14;1	15;0
$w^*=L^*/$ CIE_{LAB}, r (relative)																
$w^*_{intended}$	0,000	0,067	0,133	0,200	0,267	0,333	0,400	0,467	0,533	0,600	0,667	0,733	0,800	0,867	0,933	1,000
w^*_{out}	0,0	0,067	0,133	0,2	0,267	0,333	0,4	0,467	0,533	0,6	0,667	0,733	0,8	0,867	0,933	1,0

OE940-7N, Picture A7-030-2: 16 visual equidistant L^* -grey steps; PS operator: $w^* w^* w^* setrgbcolor$

OE94: In-output relation according to ISO 9241-306; DH
Viewing Y contrast $Y_W:Y_N=88,9:0,31$; Y_N range 0,0 to <0,46

input: 000n/w/cmy0/rgb (->rgb*a)
output 030-2: no change