

i	LAB*ref		L*out	LAB*out		LAB*out/c-ref	ΔE*
1	0.0	0.0	0.0	0.0	0.0	0.0	0.01
2	6.36	0.0	0.07	6.36	0.0	0.0	0.01
3	12.72	0.0	0.13	12.72	0.0	0.0	0.01
4	19.08	0.0	0.2	19.08	0.0	0.0	0.01
5	25.44	0.0	0.27	25.44	0.0	0.0	0.01
6	31.8	0.0	0.33	31.8	0.0	0.0	0.01
7	38.16	0.0	0.4	38.16	0.0	0.0	0.01
8	44.52	0.0	0.47	44.52	0.0	0.0	0.01
9	50.89	0.0	0.53	50.89	0.0	0.0	0.01
10	57.25	0.0	0.6	57.25	0.0	0.0	0.01
11	63.61	0.0	0.67	63.61	0.0	0.0	0.01
12	69.97	0.0	0.73	69.97	0.0	0.0	0.01
13	76.33	0.0	0.8	76.33	0.0	0.0	0.01
14	82.69	0.0	0.87	82.69	0.0	0.0	0.01
15	89.05	0.0	0.93	89.05	0.0	0.0	0.01
16	95.41	0.0	1.0	95.41	0.0	0.0	0.01
17	0.0	0.0	0.0	0.0	0.0	0.0	0.01
18	23.85	0.0	0.25	23.85	0.0	0.0	0.01
19	47.71	0.0	0.5	47.71	0.0	0.0	0.01
20	71.56	0.0	0.75	71.56	0.0	0.0	0.01
21	95.41	0.0	1.0	95.41	0.0	0.0	0.01


Start-Ausgabe S1
Kennzeichnung nach
ISO/IEC 15775 Anhang G
und DIN 33866-1 Anhang G

Mittlerer Helligkeitsabstand (16 Stufen)
 $\Delta E^*_{CIELAB} = 0.0$

Mittlerer Helligkeitsabstand (5 Stufen)
 $\Delta L^*_{CIELAB} = 0.0$

Mittlerer Farbwiedergabe-Index: $R^*_{ab,m} = 100$

OG770-3N-020-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

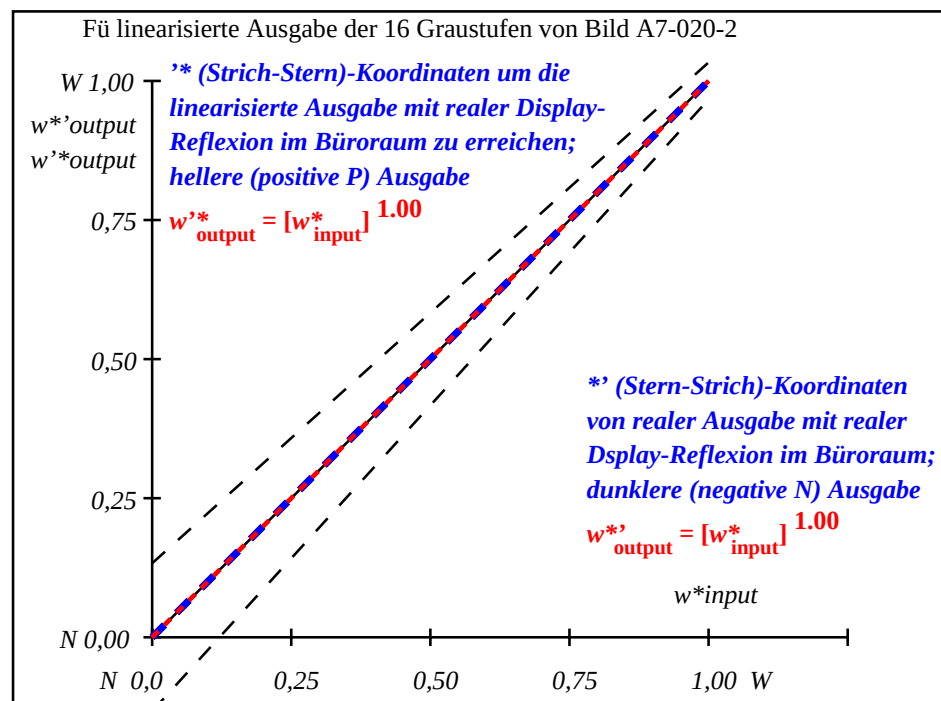

OG771-3N-020-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

$L^*/Y_{intended}$ (absolut)	0.0/0.0	6.4/0.7	12.7/1.5	19.1/2.8	25.4/4.6	31.8/7.0	38.2/10.2	44.5/14.2	50.9/19.2	57.2/25.2	63.6/32.3	70.0/40.7	76.3/50.4	82.7/61.6	89.0/74.3	95.4/88.6
$n^* n^* n^* 0$ setcmyk $g_P=1.00$ Nr.-und Hex-Code	00;F	01;E	02;D	03;C	04;B	05;A	06;9	07;8	08;7	09;6	10;5	11;4	12;3	13;2	14;1	15;0
$w^*=l^*$ (relativ)	0.000	0.067	0.133	0.200	0.267	0.333	0.400	0.467	0.533	0.600	0.667	0.733	0.800	0.867	0.933	1.000
$w^*_{intended}$ w^*_{out}	0.000 0.0	0.067 0.067	0.133 0.133	0.200 0.2	0.267 0.267	0.333 0.333	0.400 0.4	0.467 0.467	0.533 0.533	0.600 0.6	0.667 0.667	0.733 0.733	0.800 0.8	0.867 0.867	0.933 0.933	1.000 1.0

OG770-7N, Bild A7-020-2: 16 visuell gleichabständige L^* -Graustufen; PS-Operator: $n^* n^* n^* 0$ setcmykcolor

OG77: Ein-Ausgabe-Beziehung nach ISO 9241-306; DH
Gesehener Y-Kontrast $Y_W:Y_N=88,9:0,31$; Y_N -Bereich 0,0 to <0,46

Eingabe: $cmy0$ ($\rightarrow cmy0_d$) setcmyk

Ausgabe 020-2: keine Änderung