



Tavola 3 di campioni di colore per la resa del colore: colori matamerici sotto illuminanti A e P4000; display standard (sRGB)

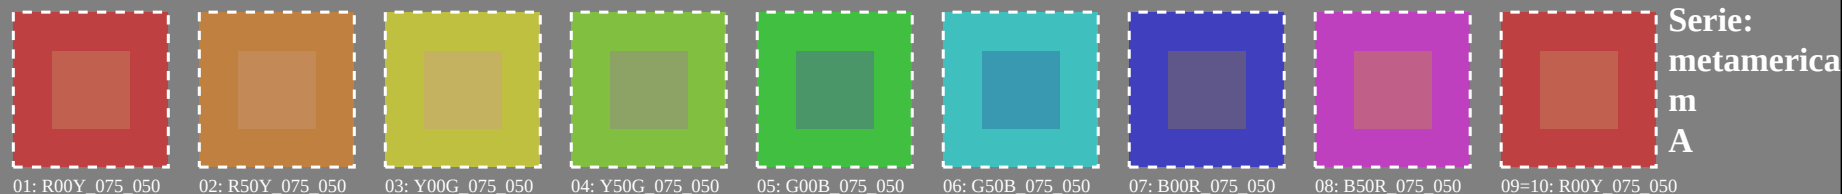


Serie:
metamerica
m
A

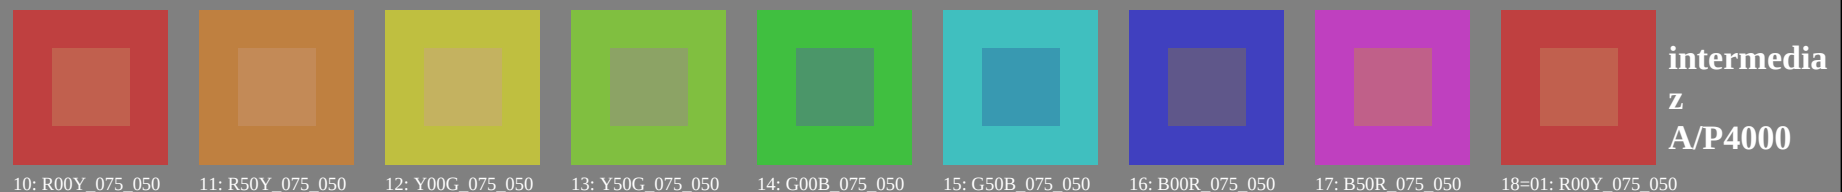


intermedia
z
A/P4000

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

metamerica
m
P4000

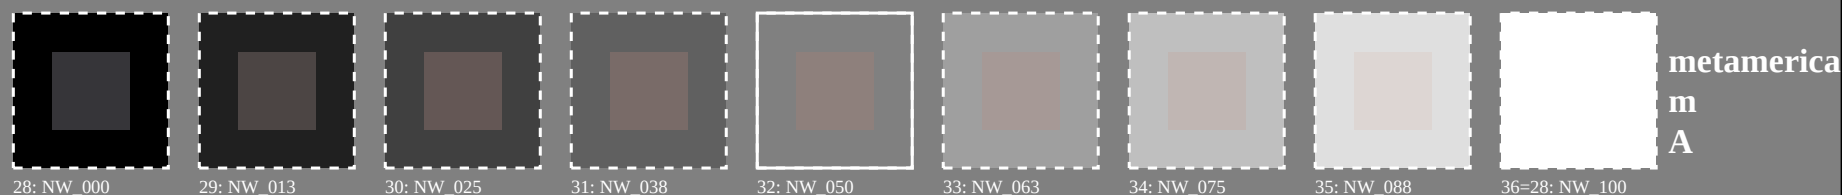

metamerica
m
A

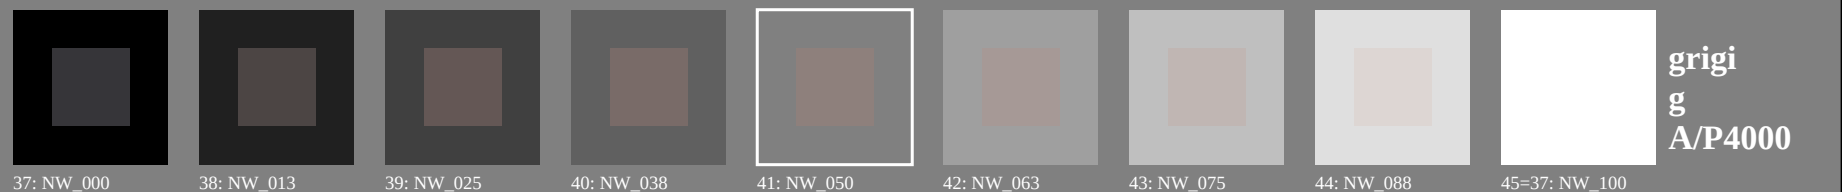


grigi
g
A/P4000



metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

metamerica
m
P4000

Tavola 3 di campioni di colore per la resa del colore: colori matamerici sotto illuminanti A e P4000; display standard (sRGB); rg

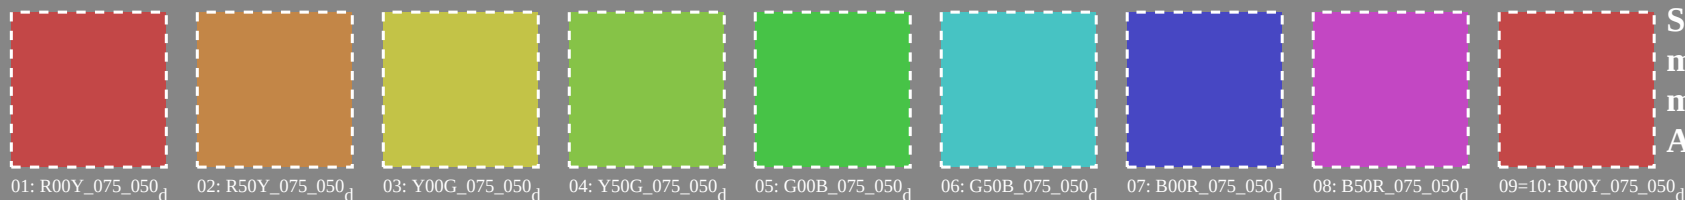

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

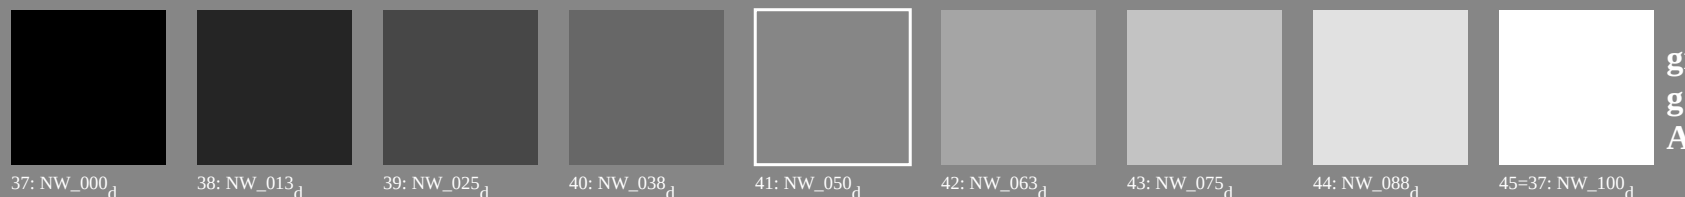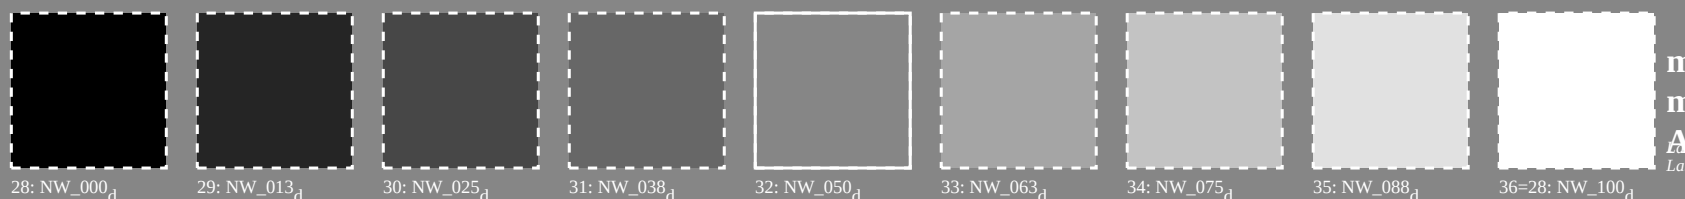

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

Serie: metamerica m A

intermedia z A/P4000

metamerica m P4000

metamerica m A
Lab*N=0.0, 0.0, 0.0
Lab*W=95.4, 0.0, 0.0

grigi g A/P4000


metamerica m P4000

vedi file simili: <http://farbe.li.tu-berlin.de/PI30/PI30L0NA.TXT> / .PS
informazioni tecniche: <http://www.ps.bam.de> o <http://130.149.60.45/~farbmetrik>


PI3000s
iscrizione TUB: 20160501-PI30/PI30L0NA.TXT /.PS
Applicazione per la misura dell'output su display, nessuna separazione

TUB materiale: code=rha4ta

Tavola 3 di campioni di colore per la resa del colore: colori matamerici sotto illuminanti A e P4000; display standard (sRGB)

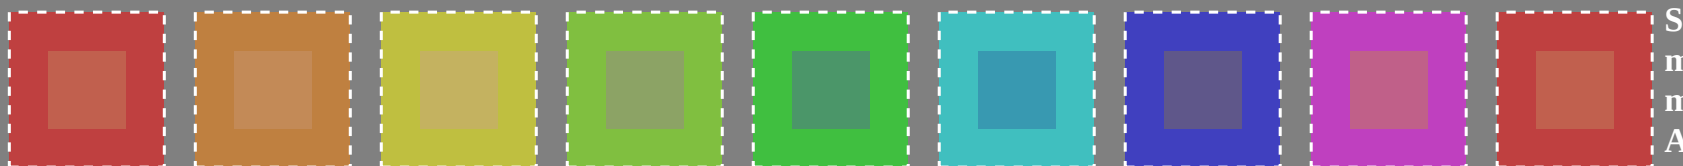

01: R00Y_075_050_ 02: R50Y_075_050_ 03: Y00G_075_050_ 04: Y50G_075_050_ 05: G00B_075_050_ 06: G50B_075_050_ 07: B00R_075_050_ 08: B50R_075_050_ 09=10: R00Y_075_050_

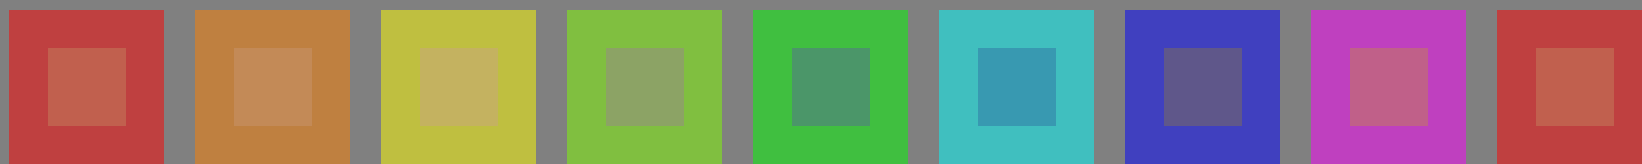


10: R00Y_075_050_ 11: R50Y_075_050_ 12: Y00G_075_050_ 13: Y50G_075_050_ 14: G00B_075_050_ 15: G50B_075_050_ 16: B00R_075_050_ 17: B50R_075_050_ 18=01: R00Y_075_050_

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*




28: NW_000_ 29: NW_013_ 30: NW_025_ 31: NW_038_ 32: NW_050_ 33: NW_063_ 34: NW_075_ 35: NW_088_ 36=28: NW_100_

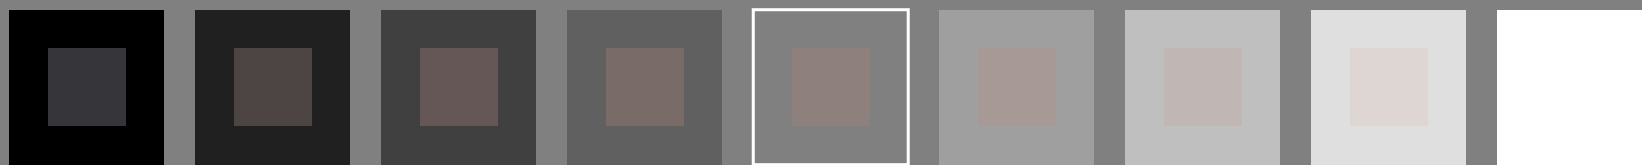



37: NW_000_ 38: NW_013_ 39: NW_025_ 40: NW_038_ 41: NW_050_ 42: NW_063_ 43: NW_075_ 44: NW_088_ 45=37: NW_100_

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

Tavola 3 di campioni di colore per la resa del colore: colori matamerici sotto illuminanti A e P4000; display standard (sRGB); rg

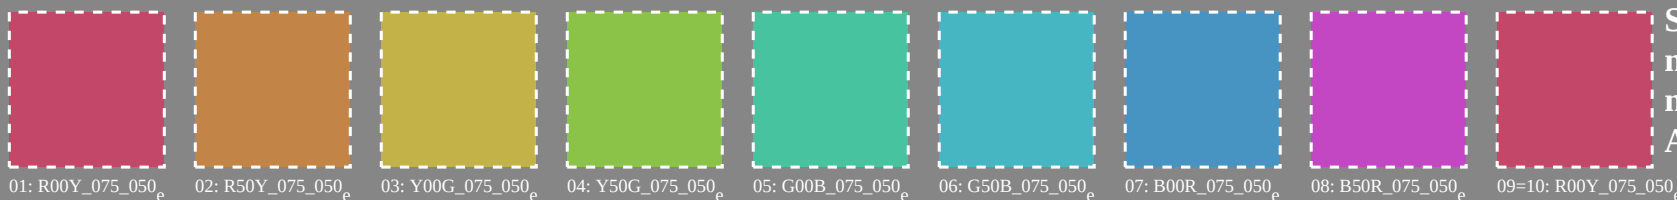

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

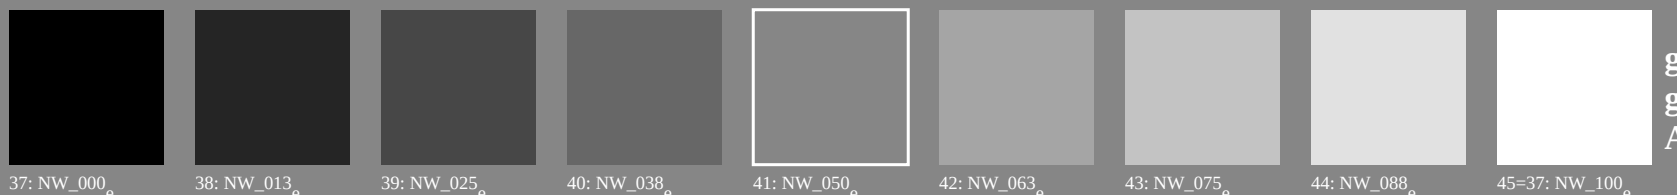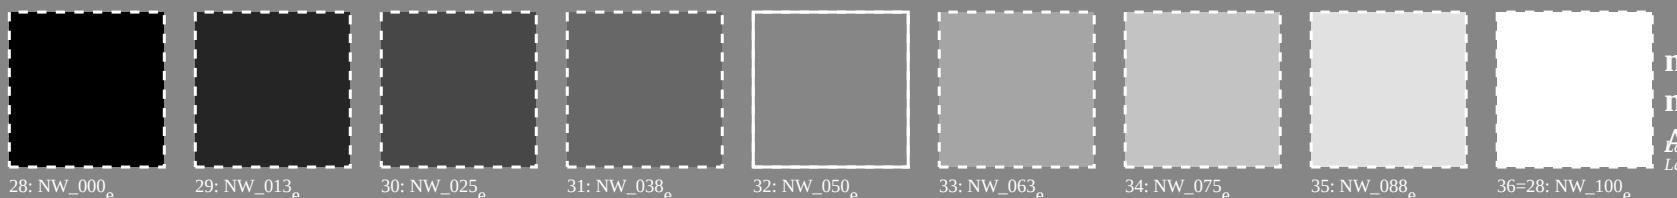

metameric colours only possible for offset print and colour printers
with at least four basic colours, either *CMYK* or *CMY0*

Serie:
metamerica
m
A

intermedia
z
A/P4000

metamerica
m
P4000

metamerica
m
A
 $L^*a^*b^*$: N=0.0, 0.0, 0.0
Lab*W=95.4, 0.0, 0.0

grigi
g
A/P4000

metamerica
m
P4000

vedi file simili: <http://farbe.li.tu-berlin.de/PI30/PI30L0NA.TXT> / .PS
informazioni tecniche: <http://www.ps.bam.de> o <http://130.149.60.45/~farbmetrik>

PI3001s
iscrizione TUB: 20160501-PI30/PI30L0NA.TXT /.PS
Applicazione per la misura dell'output su display, nessuna separazione

TUB materiale: code=rh4ta