

http://130.149.60.45/~farbmetrik/RE23/RE23L0NP.PDF /.PS; transfer output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

Input and Output: Offset Reflective System ORS18a for relative CIELAB hue $h_{ab,a,rel} = h_{ab}/360 = 333/360 = 0.92$


$H^*_d = B25R_d$

Data for any device (d) or elementary (e) colour:

HIC^*_d
hue text for the colours
of this page:

$H^*_d = B25R_d$

triangle lightness T^*



ORS20a; adapted (a) CIELAB data

name	$L^*=L^*_a$	a^*_a	b^*_a	$C^*_{ab,a}$	$h^*_{ab,a}$
R _d ,Ma	47.3	63.8	41.2	76.0	32
Y _d ,Ma	88.3	-11.9	95.1	95.8	97
G _d ,Ma	51.9	-68.8	28.1	74.3	157
C _d ,Ma	58.3	-29.2	-43.7	52.6	236
B _d ,Ma	25.3	23.5	-47.3	52.8	296
M _d ,Ma	48.2	72.8	-8.5	73.3	353
N _d ,Ma	17.7	0.0	0.0	0.0	0
W _d ,Ma	95.4	0.0	0.0	0.0	0
R _d ,CIE	39.9	58.7	27.9	65.0	25
Y _d ,CIE	81.2	-2.8	71.5	71.6	92
G _d ,CIE	52.2	-42.4	13.6	44.5	162
B _d ,CIE	30.5	1.4	-46.4	46.4	271

Data for maximum colour (Ma):

$LabCh^*_{d,Ma}$: 37 53 -26 59 333

$HIC^*_{d,Ma}$: B25R_100_100_d

$rgbic^*_{d,Ma}$:

0.5 0.0 1.0 1.0 1.0

triangle lightness T^*

% Gamut

$u^*_{rel} = 92$



% Regularity

$g^*_{H,rel} = 57$

$g^*_{C,rel} = 58$

ORS20a; adapted (a) CIELAB data

H^*_d	$L^*=L^*_a$	a^*_a	b^*_a	$C^*_{ab,a}$	$h^*_{ab,a}$
R00Y_100_100 _d	47.3	63.8	41.2	76.0	32
R25Y_100_100 _d	55.3	45.8	52.2	69.5	48
R50Y_100_100 _d	67.2	22.6	67.6	71.2	71
R75Y_100_100 _d	79.9	1.0	83.9	83.9	89
Y00G_100_100 _d	88.3	-11.9	95.1	95.8	97
Y25G_100_100 _d	83.3	-19.2	83.7	85.9	102
Y50G_100_100 _d	72.7	-31.3	66.0	73.1	115
Y75G_100_100 _d	60.4	-48.8	46.7	67.6	136
G00B_100_100 _d	51.9	-68.8	28.1	74.3	157
G25B_100_100 _d	54.8	-51.0	-12.3	52.5	193
G50B_100_100 _d	58.3	-29.2	-43.7	52.6	236
G75B_100_100 _d	42.7	-6.0	-45.0	45.4	262
B00R_100_100 _d	25.3	23.5	-47.3	52.8	296
B25R_100_100 _d	37.8	53.8	-26.3	59.9	333
B50R_100_100 _d	48.2	72.8	-8.5	73.3	353
B75R_100_100 _d	47.7	67.7	14.0	69.1	11

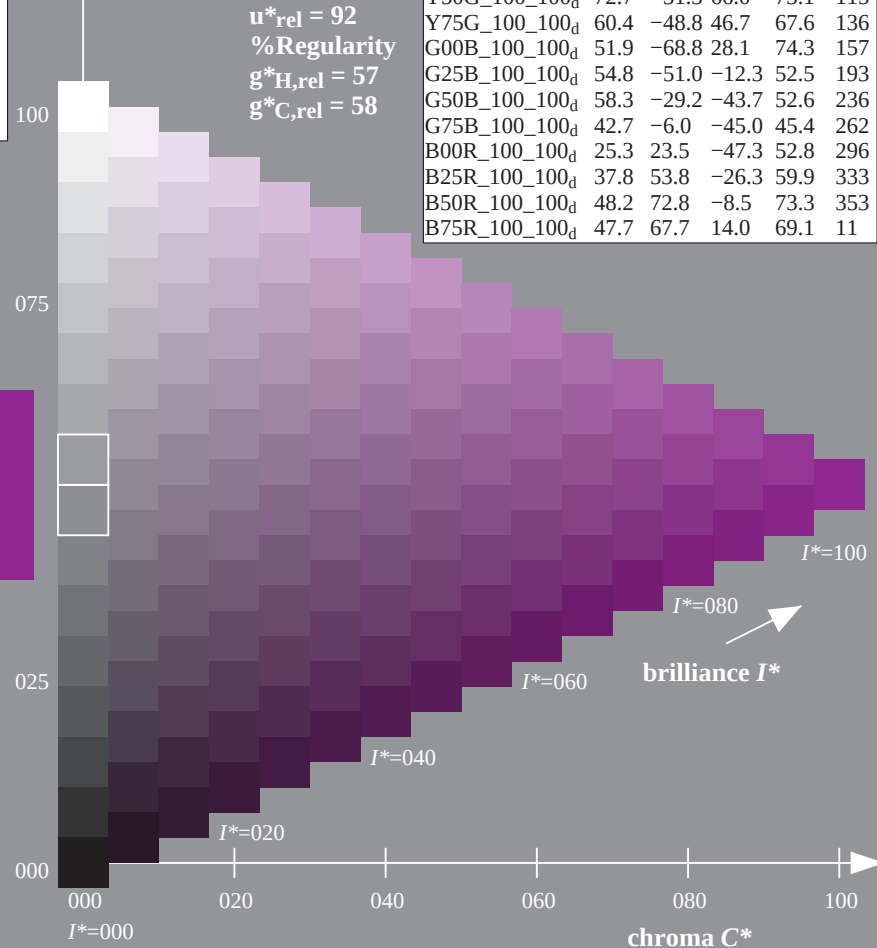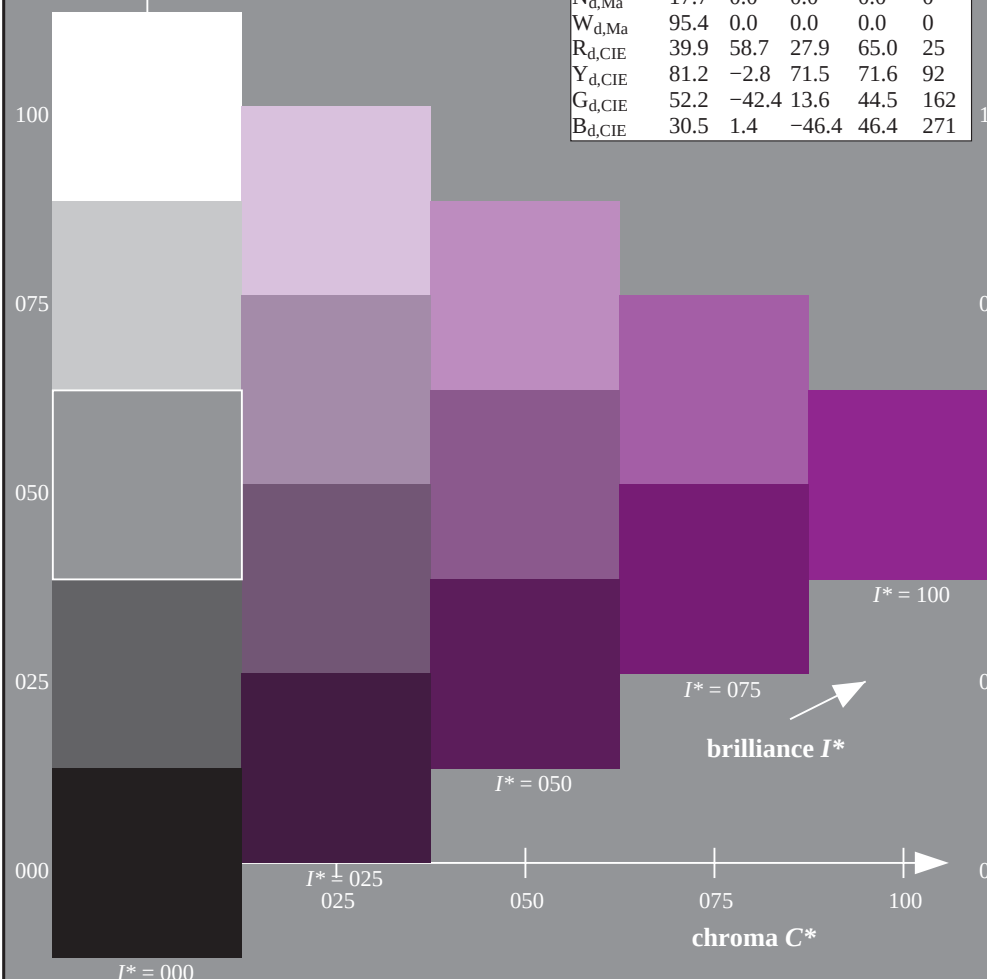

1-003130-L0 RE230-70

TUB-test chart RE23; hue code: $H^*_d = B25R_d$
Test chart according to DIN 33872, 3D=0, de=0, cmyk

input: $rgb/cmyk \rightarrow rgb_d$
output: transfer to $cmyk_d$

TUB registration: 20150701-RE23/RE23L0NP.PDF /.PS
application for measurement of offset print output, separation cmyk6 (CMYK)

TUB material: code=rha4ta