


<http://130.149.60.45/~farbmetrik/RE56/RE56L0NP.PDF> /.PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://130.149.60.45/~farbmetrik/RE56/RE56L0NP.PDF> /.PS
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20150701-RE56/RE56L0NP.PDF /.PS
application for measurement of offset print output, separation cmy0 (CMY0)

TUB material: code=rha4ta

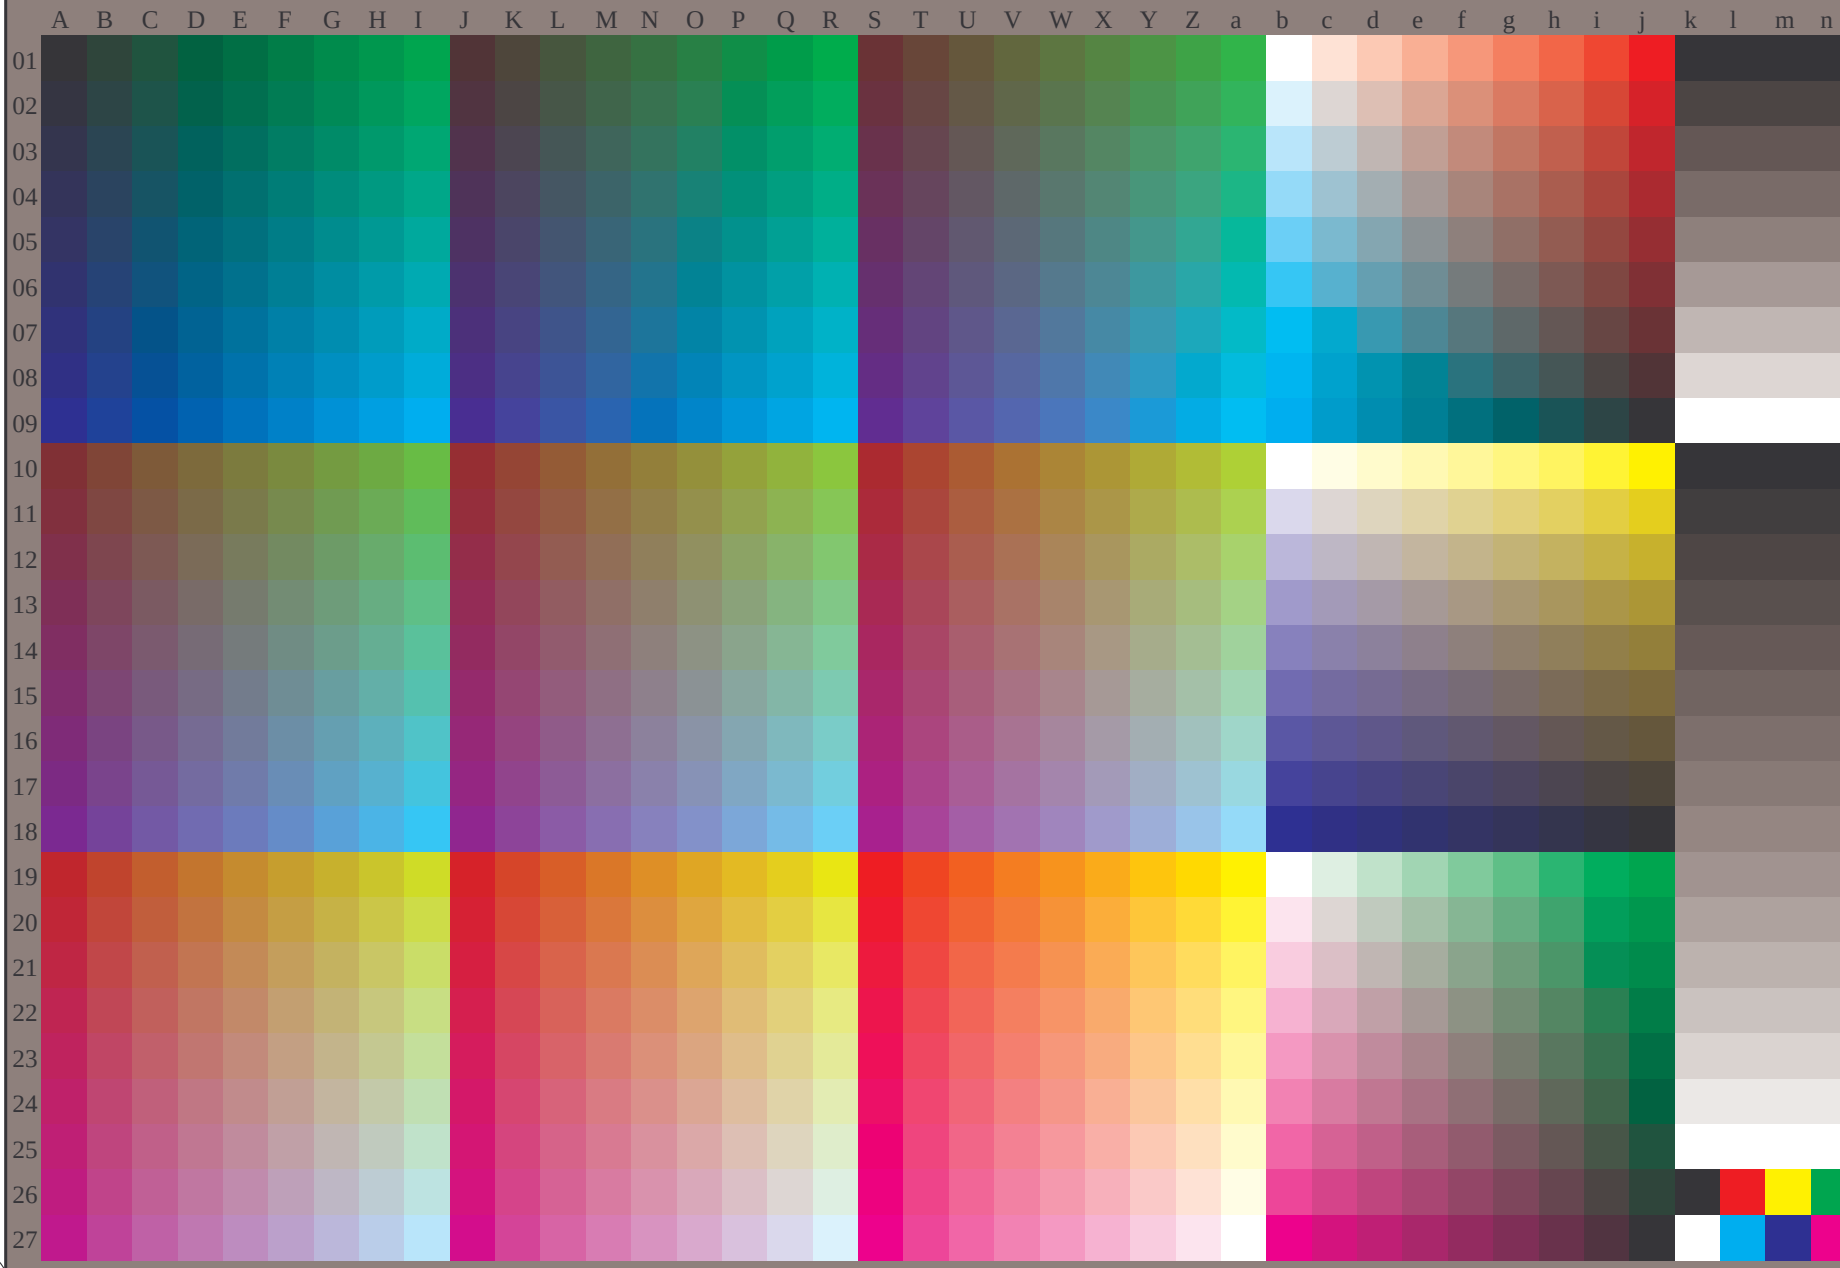

1-003131-L0 RE560-70

Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): $rgb(A_n)$, $3D=0$

TUB-test chart RE56; 1080 standard colours

Test chart according to DIN 33872, $3D=0$, $de=0$, $cmy0$

input: $rgb/cmyk \rightarrow rgb_d$

output: transfer to $cmy0_d$

1-003131-F0