


<http://130.149.60.45/~farbmetrik/RE72/RE72L0NP.PDF> /.PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/1

see similar files: <http://130.149.60.45/~farbmetrik/RE72/RE72L0NP.PDF> /.PS; transfer output
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-RE72/RE72L0NP.PDF /.PS
application for measurement of laser printer output, separation cmyk6 (CMYK)

TUB material: code=th4ta

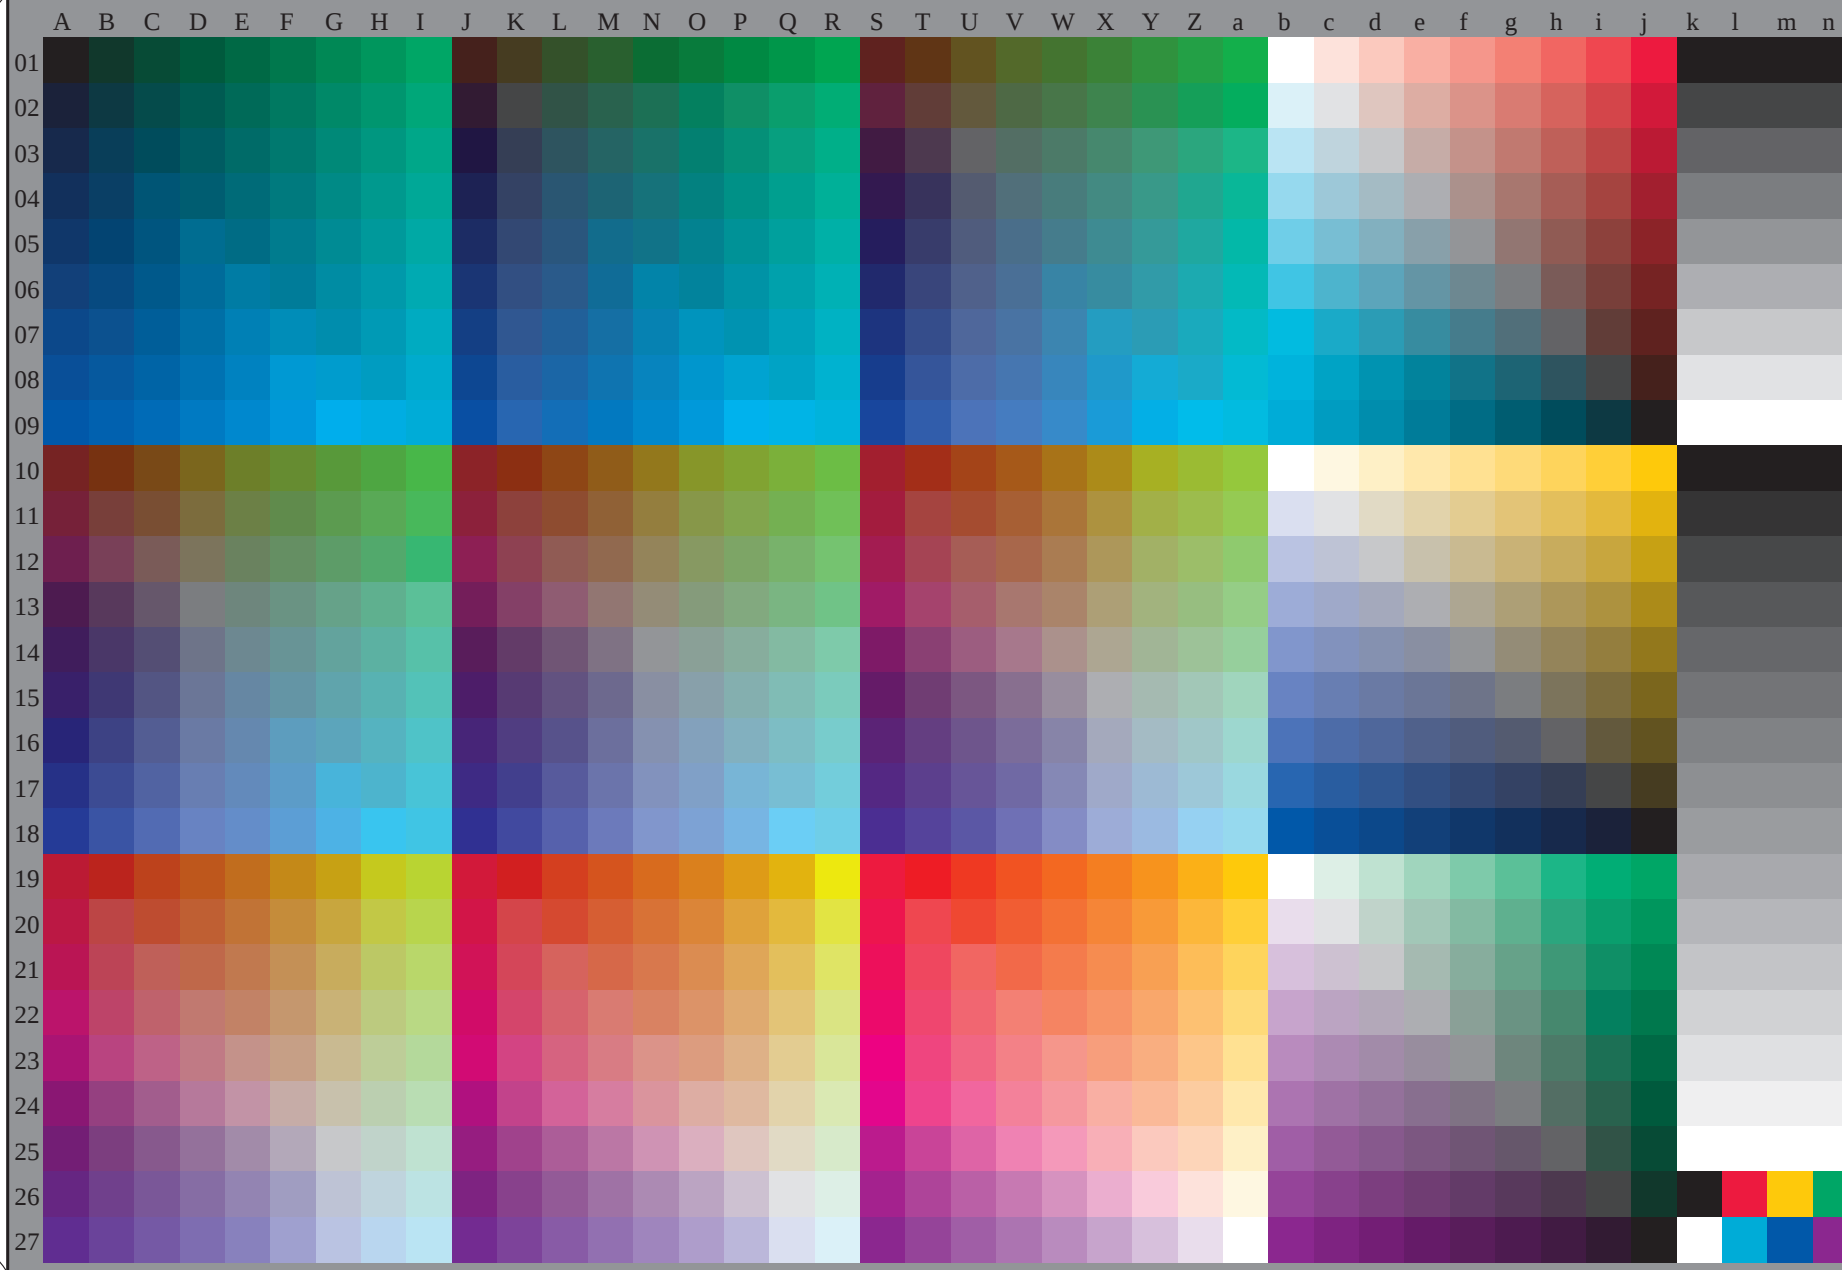

RE720-71

1-013130-L0

TUB-test chart RE72; 1080 standard colours, $cf=0,9$
Test chart according to DIN 33872, 3D=0, $de=1$, cmyk

input: $rgb/cmyk \rightarrow rgb_e$
output: transfer to $cmyk_e$

1-013130-F0