


<http://130.149.60.45/~farbmetrik/SE13/SE13L0NP.PDF> / .PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://130.149.60.45/~farbmetrik/SE13/SE13.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

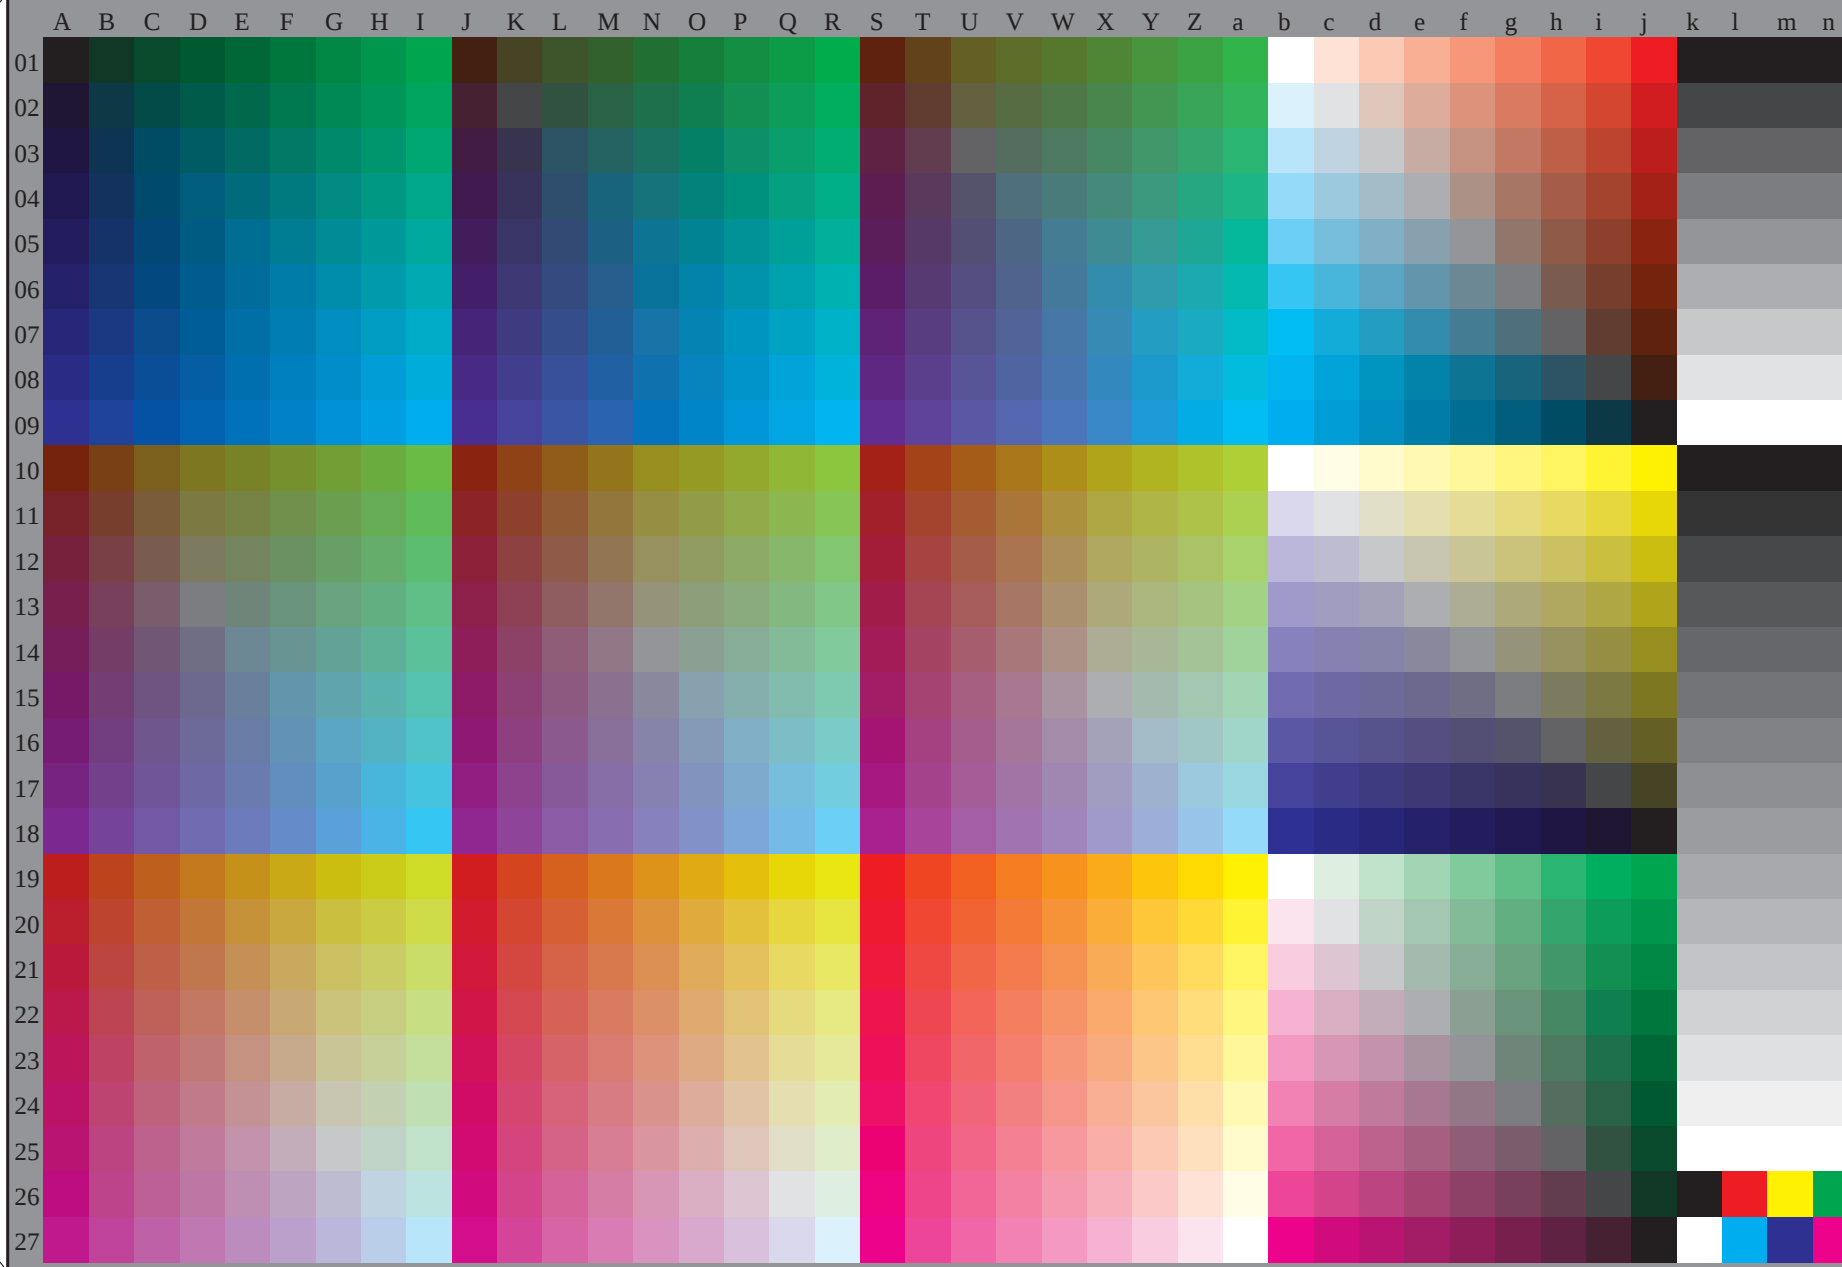

TUB registration: 20130201-SE13/SE13L0NP.PDF / .PS
application for measurement of offset print output, separationcmyn6 (CMYK)

TUB material: code=th4ta

1-003130-L0

SE130-70

Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): $rgb(A_n)$, 3D = 0

TUB-test chart SE13; 1080 colours, offset standard paper

Test chart according to DIN 33872, 3D=0, $de=0$, $cmYK$ input: $rgb/cmyk \rightarrow rgb_d$ output: transfer to $cmyk_d$

1-003130-F0