


http://130.149.60.45/~farbmetrik/SE16/SE16L0NA.TXT /.PS; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://130.149.60.45/~farbmetrik/SE16/SE16.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-SE16/SE16L0NA.TXT /.PS
application for measurement of offset print output

TUB material: code=rha4ta

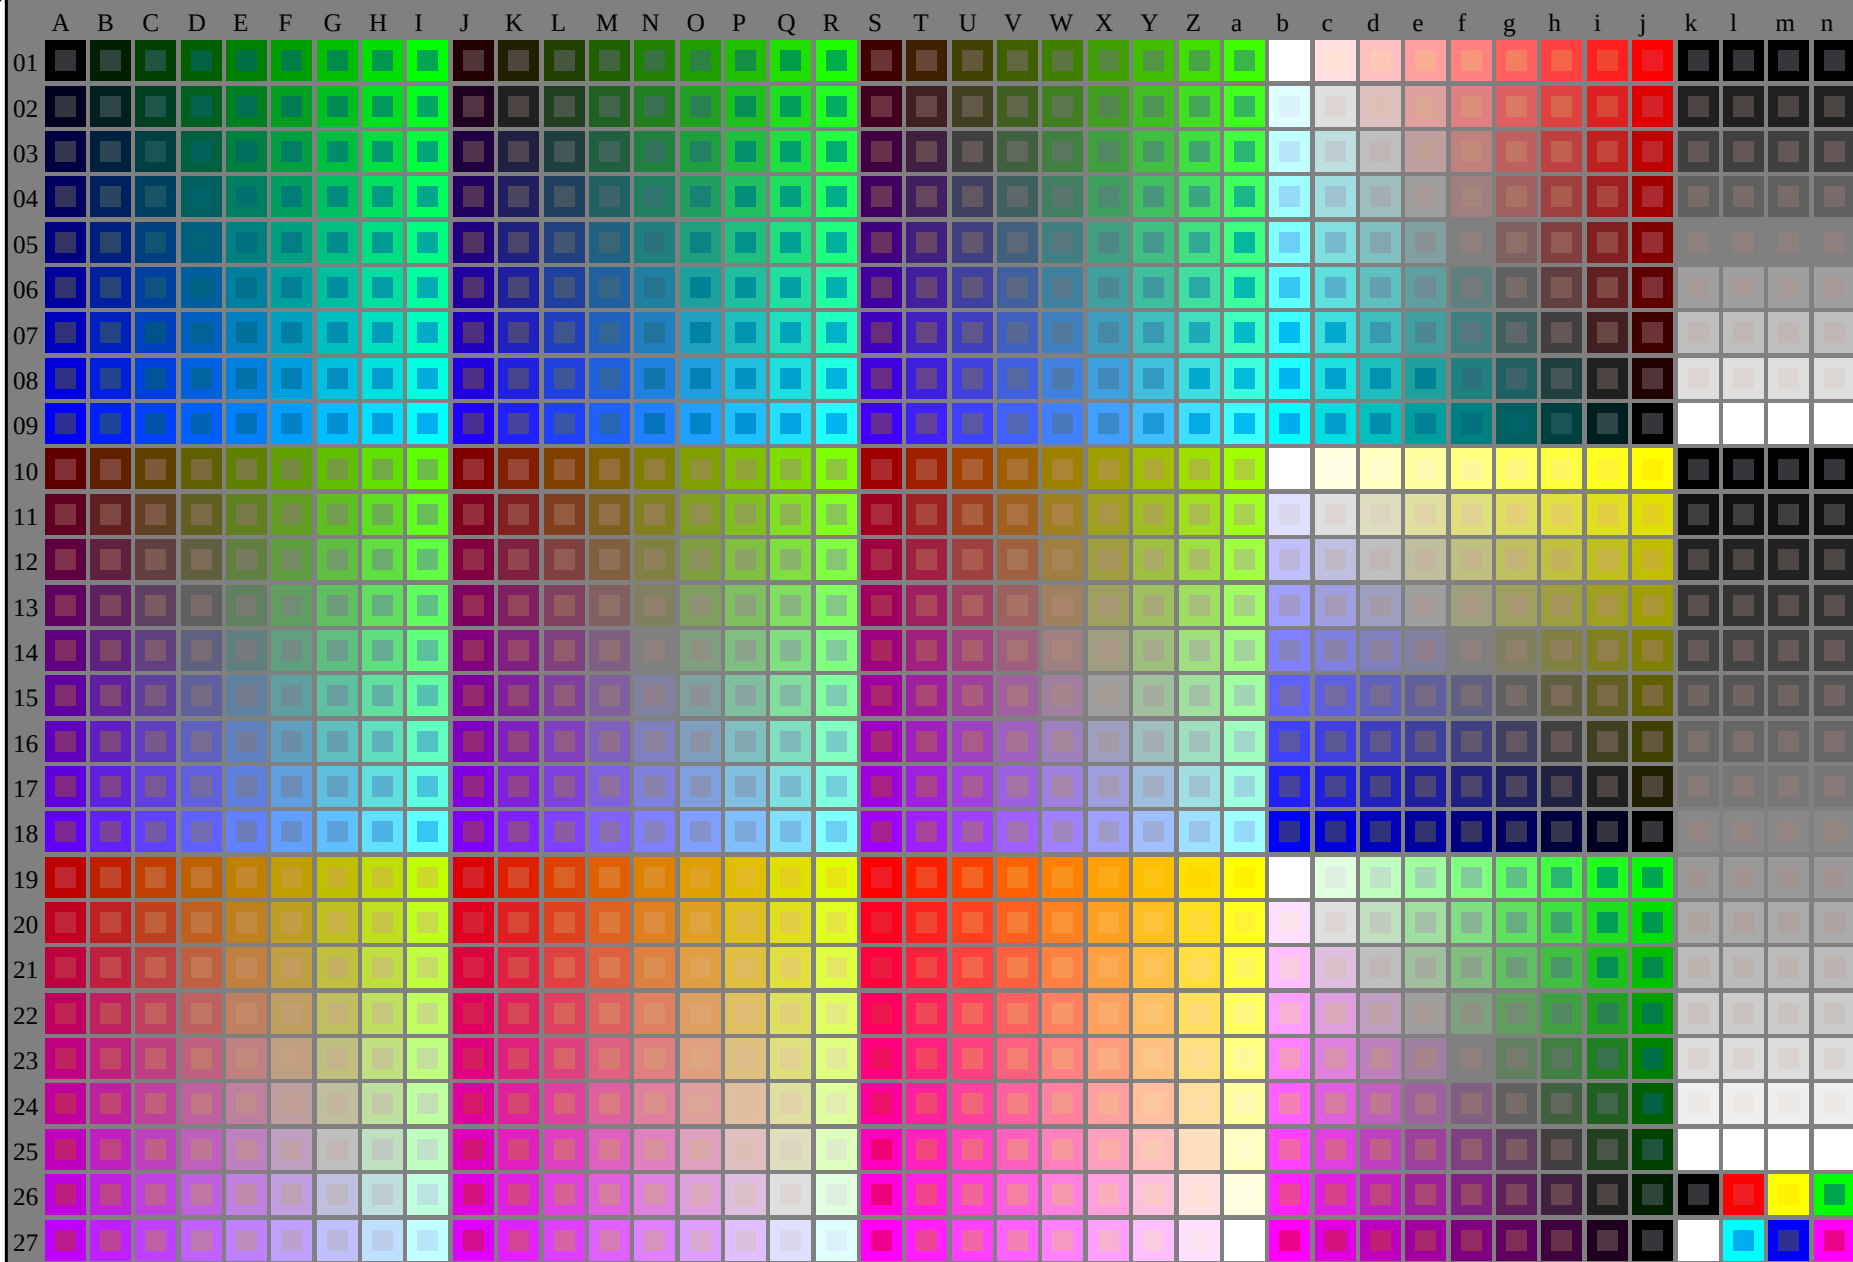

1-003031-L0

SE160-7N


Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): *rgb + cmy0* (A-j + k26_n27), 000n (k), w (l), nnn0 (m), www (n), 3D = 0

TUB-test chart SE16; 1080 colours, offset standard paper
Test chart according to DIN 33872

input: *rgb/cmyk* -> *rgb/cmyk*
output: no change

see similar files: <http://130.149.60.45/~farbmetrik/SE16/SE16.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-SE16/SE16L0NA.TXT /.PS
application for measurement of offset print output, separationcmy0 (CMY0)
TUB material: code=rha4ta

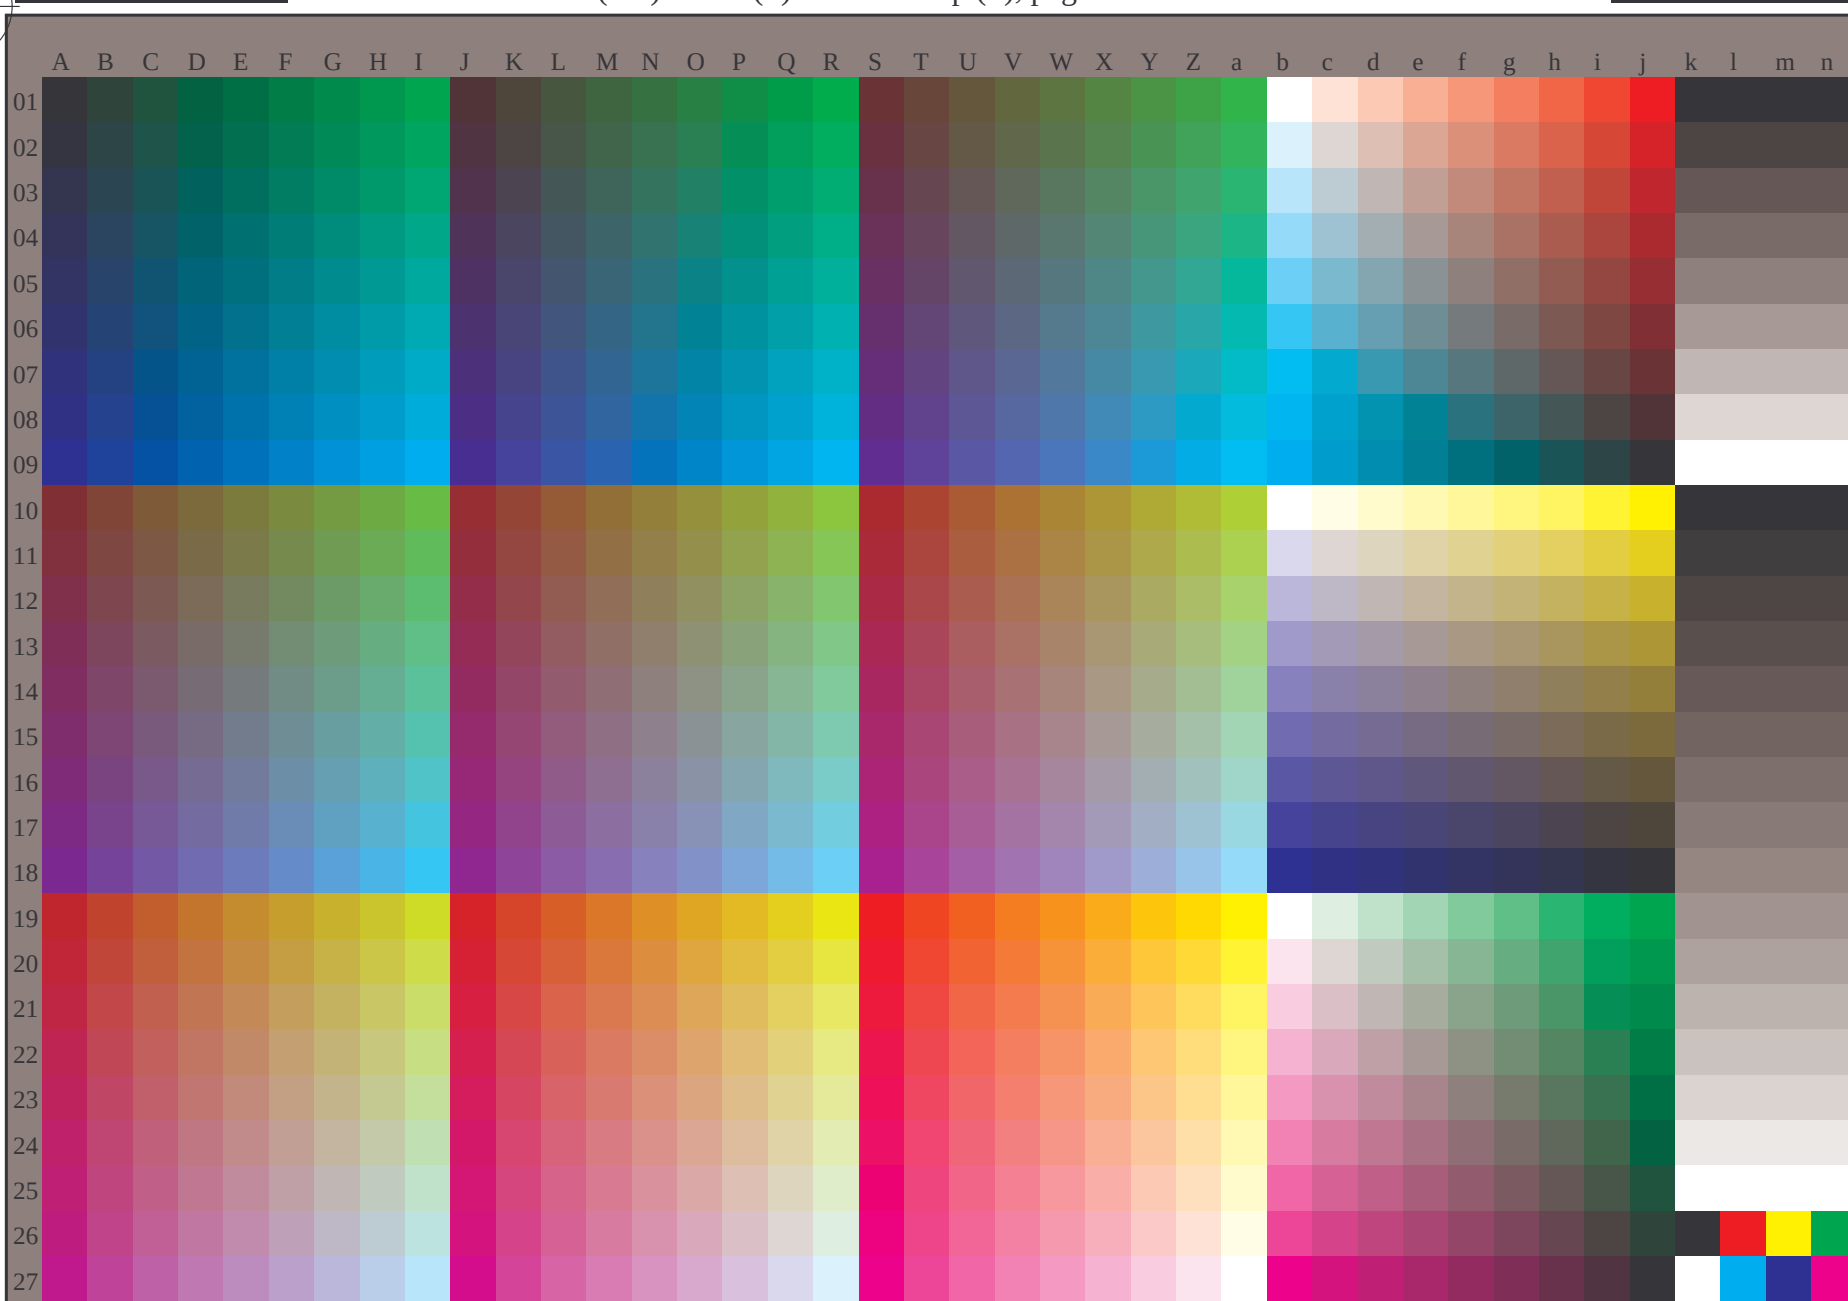

1-003131-L0

SE160-70

Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): $rgb(A_n, 3D=0)$

TUB-test chart SE16; 1080 colours, offset standard paper

Test chart according to DIN 33872, 3D=0, de=0, cmy0

input: $rgb/cmyk \rightarrow rgb_d$ output: transfer to $cmy0_d$

1-003131-F0

C

M

Y

O

L

V


C

http://130.149.60.45/~farbmetrik/SE16/SE16L0NA.TXT /.PS; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://130.149.60.45/~farbmetrik/SE16/SE16.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-SE16/SE16L0NA.TXT /.PS
application for measurement of offset print output

TUB material: code=rha4ta

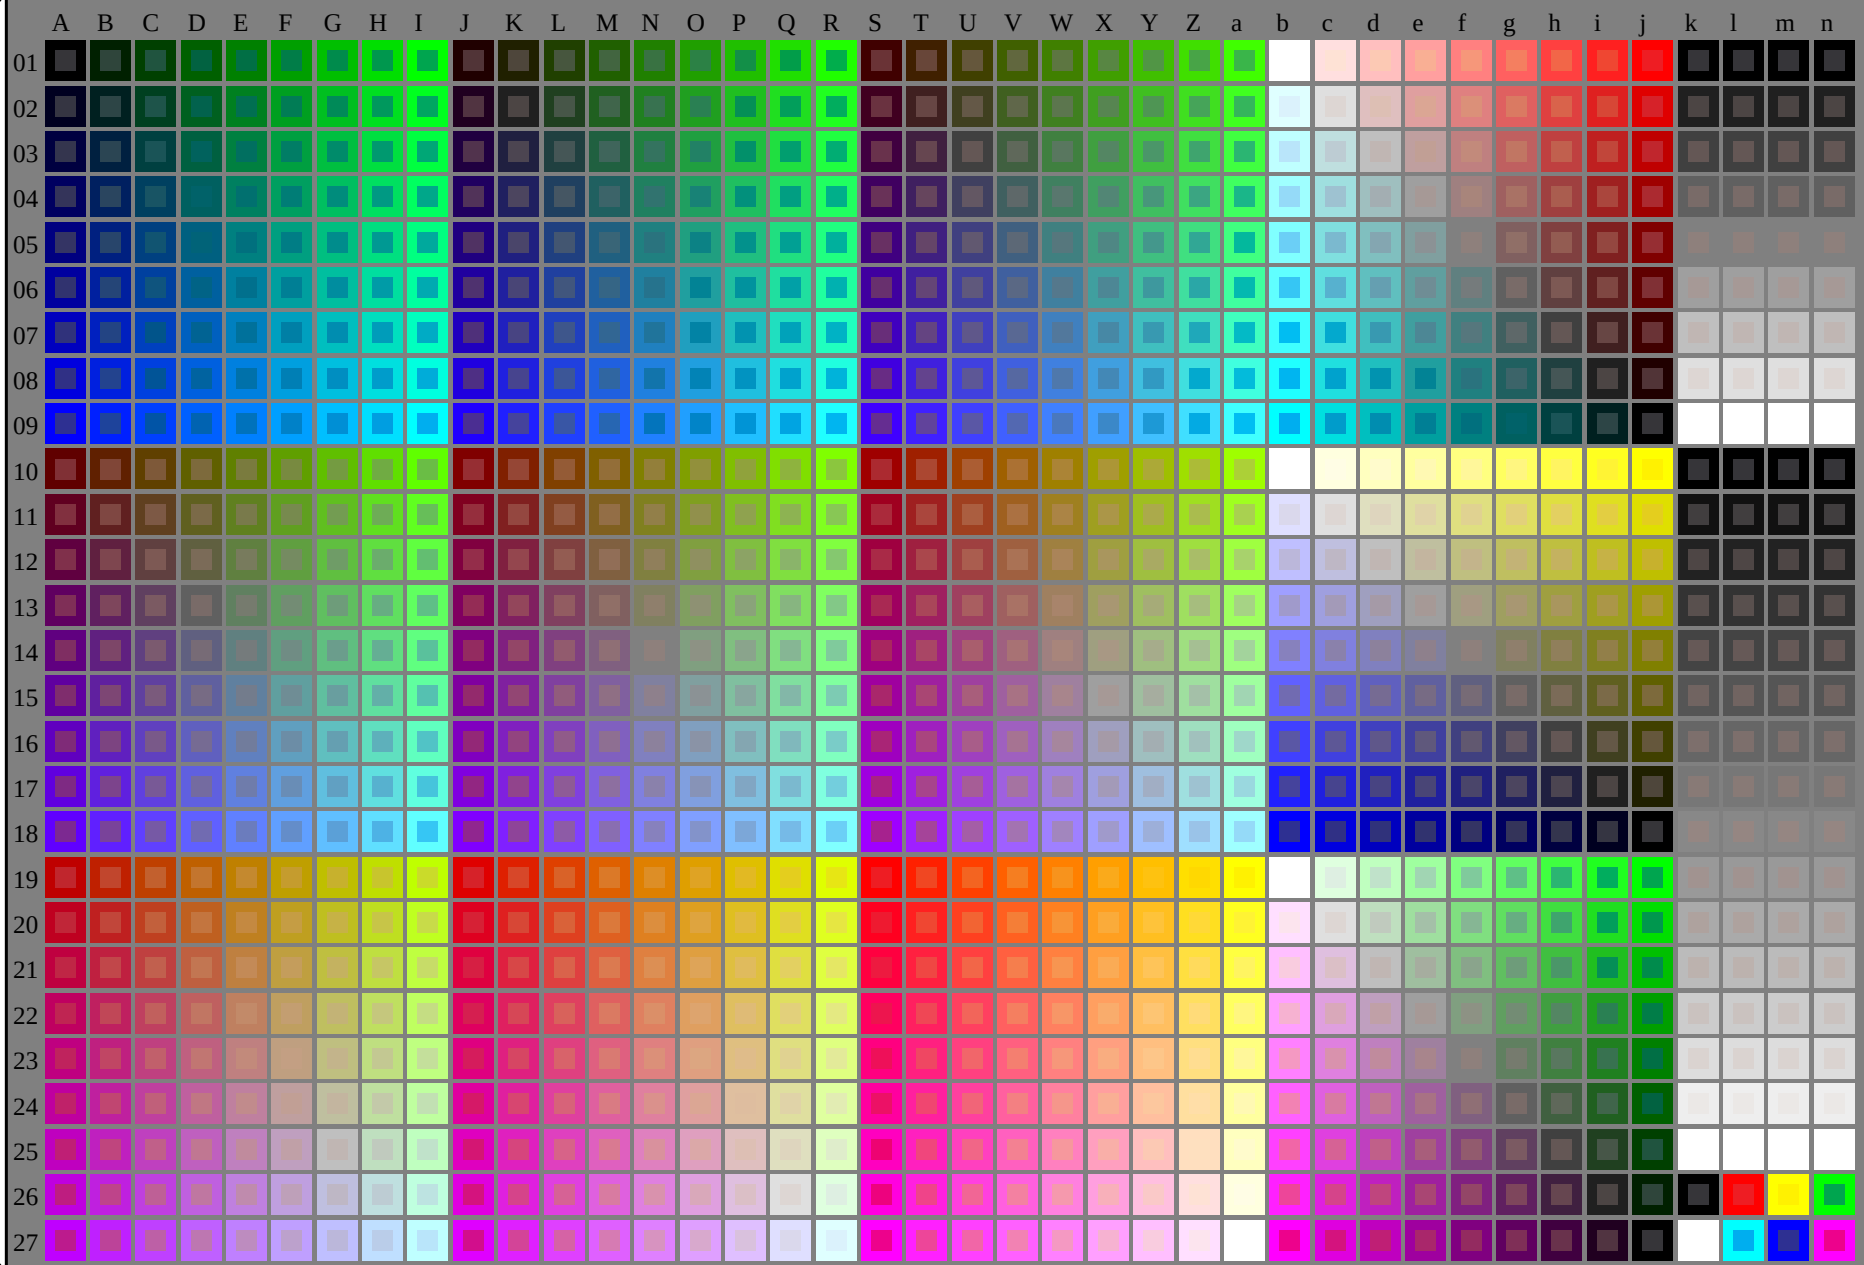

1-013031-L0

SE160-7N


Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): **rgb + cmy0** (A-j + k26_n27), 000n (k), w (l), nnn0 (m), www (n), 3D = 0

TUB-test chart SE16; 1080 colours, offset standard paper
Test chart according to DIN 33872

input: *rgb/cmyk* -> *rgb/cmyk*
output: no change

see similar files: <http://130.149.60.45/~farbmetrik/SE16/SE16.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-SE16/SE16L0NA.TXT /.PS
application for measurement of offset print output, separationcmy0 (CMY0)
TUB material: code=rha4ta

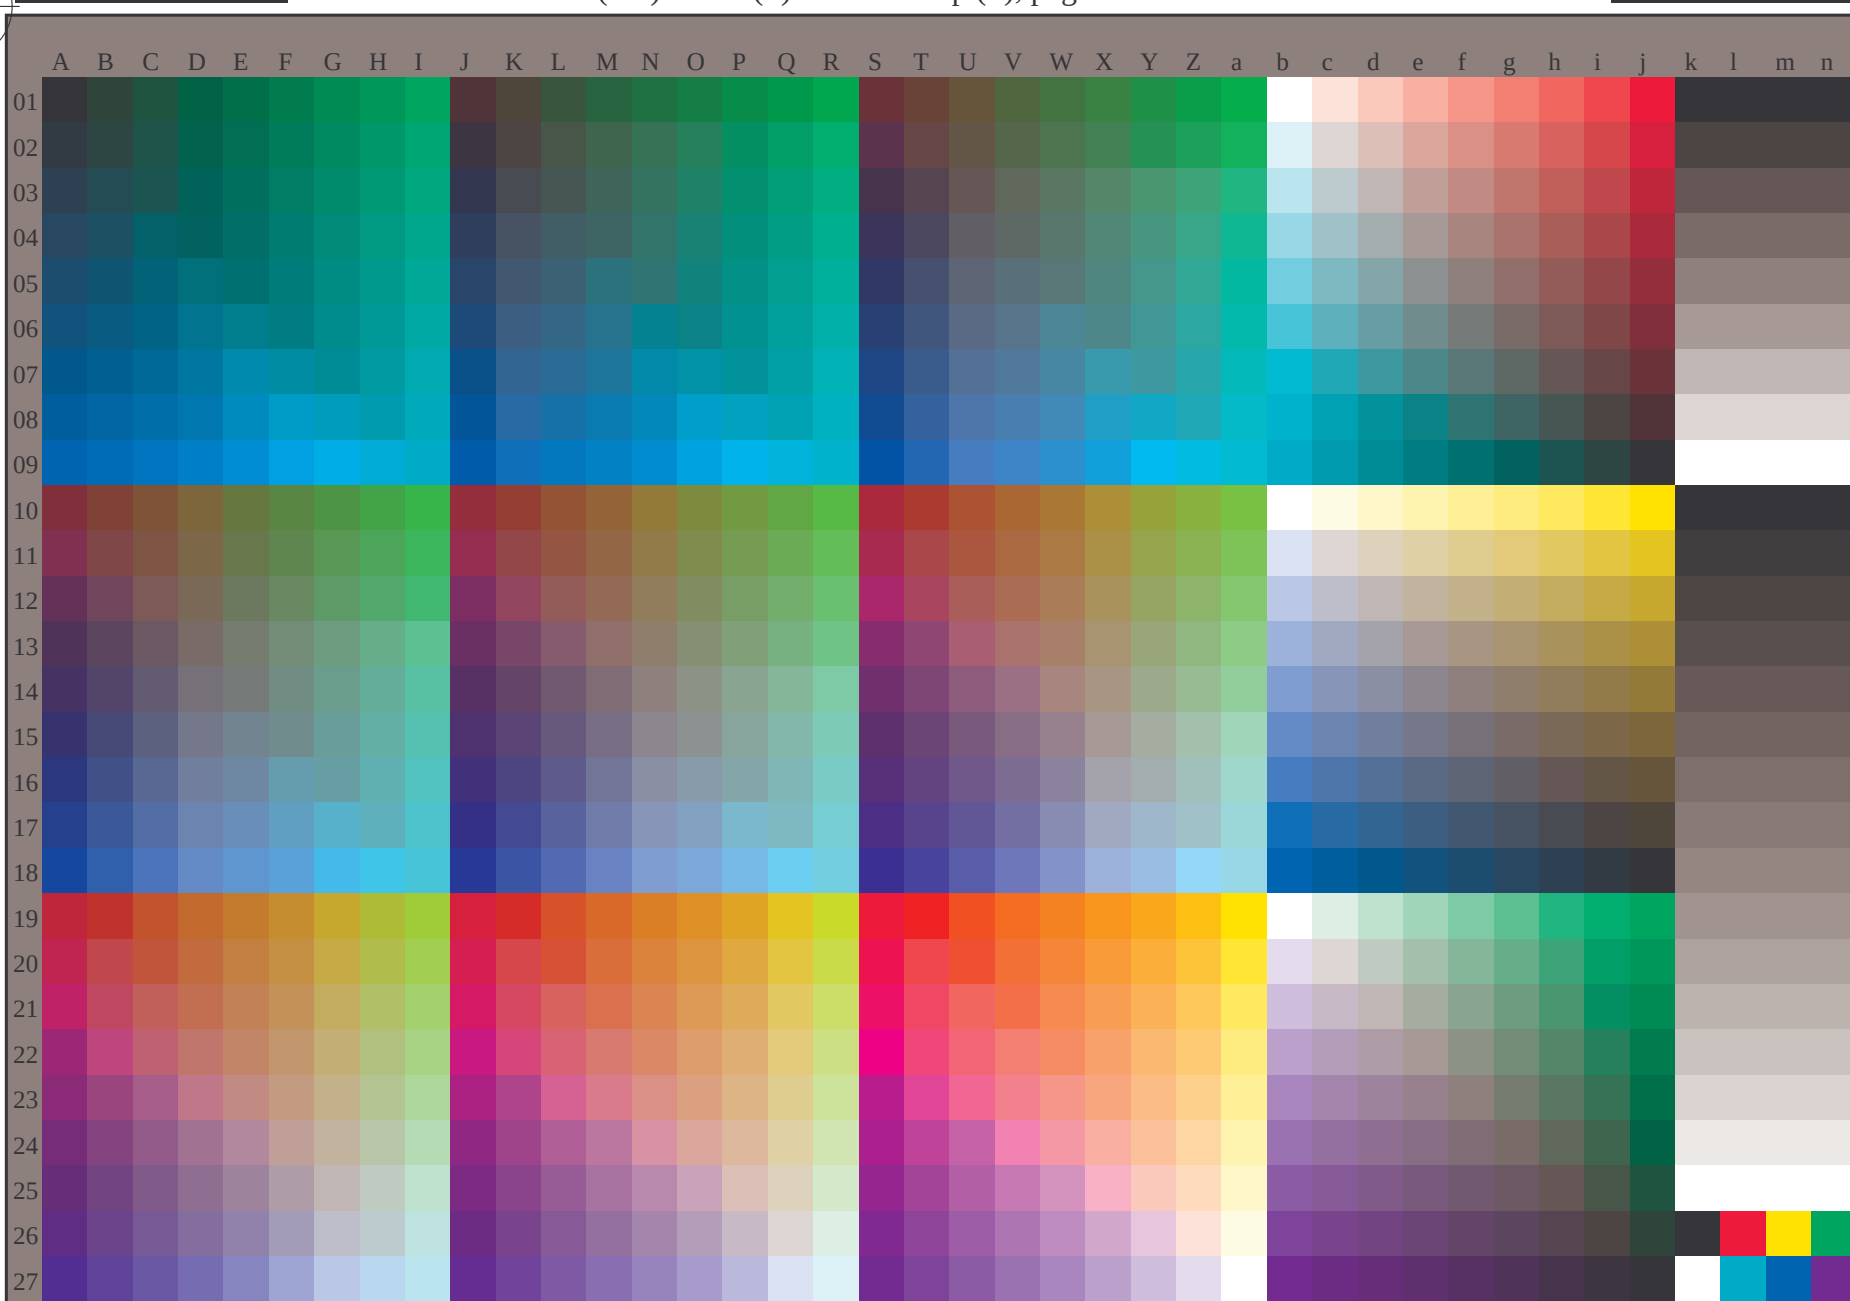

1-013131-L0

SE160-71

Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): $rgb(A_n)$, $3D=0$

TUB-test chart SE16; 1080 colours, offset standard paper
Test chart according to DIN 33872, $3D=0$, $de=1$, $cmy0$

input: $rgb/cmyk \rightarrow rgb_e$
output: transfer to $cmy0_e$

1-013131-F0

C

M

Y

O

L

V

C