


see similar files: <http://farbe.li.tu-berlin.de/AEA9/AEA9L0N1.TXT> /PS
technical information: <http://farbe.li.tu-berlin.de/AEA9/AEA9L0N1.TXT> /PS
or <http://130.149.60.45/~farbnetrik>

TUB registration: 20200201-AEA9/AEA9L0N1.TXT /PS
application for evaluation and measurement of display or print output

TUB material: code=rhata

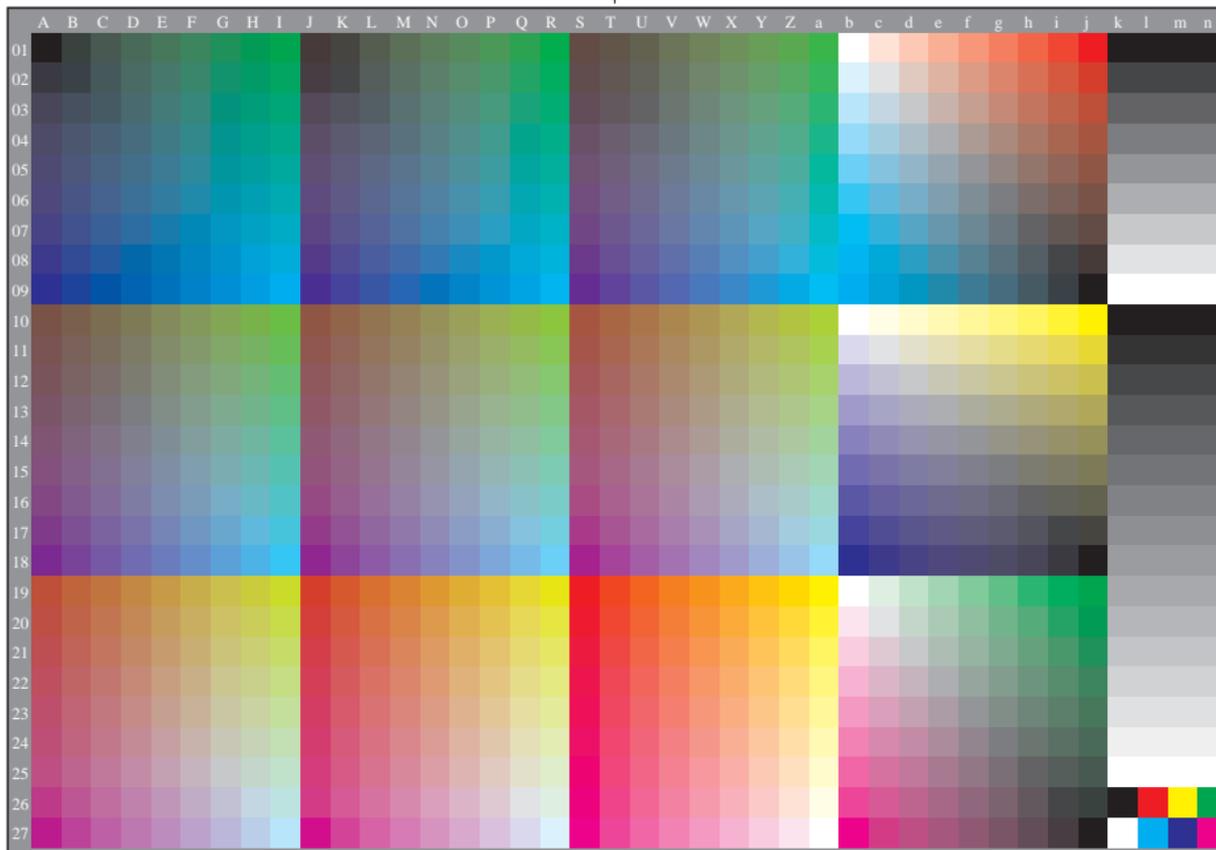

AEA90-7N. File transfer of figure-vector graphic (VG) in: <http://farbe.li.tu-berlin.de/AEA9/AEA90-7N.PDF>. Transfer to PG with `cmlyk setcmykcolor` not realized up to now with four values cmyk.

TUB-test chart AEA9; Frame file and figure file in VG input: `w/rgb/cmyk -> cmyk_`
Figure-vector graphic (VG) in standard position left and down output: relative gamma $\gamma_p = 1$