

Siehe ähnliche Dateien der ganzen Serie: <http://farbe.li.tu-berlin.de/fgis.htm>  
Technische Information: <http://farbe.li.tu-berlin.de/A/33872E.html>  
oder <http://standards.iso.org/9241/306/ed-2/index.html>

TUB-Registrierung: 20240301-fgi3/fgi310na.txt/.ps  
Anwendung für Beurteilung und Messung von Display- oder Druck-Ausgabe  
TUB-Material: Code=rh4ta

i	LAB*ref	L*out	LAB*out	LAB*out/c-ref	ΔE*
1	0.0 0.0	0.0 0.0	0.0 0.0	0.0 0.0	0.01
2	6.36 0.0	0.0 0.07	6.36 0.0	0.0 0.0	0.01
3	12.72 0.0	0.0 0.13	12.72 0.0	0.0 0.0	0.01
4	19.08 0.0	0.0 0.2	19.08 0.0	0.0 0.0	0.01
5	25.44 0.0	0.0 0.27	25.44 0.0	0.0 0.0	0.01
6	31.8 0.0	0.0 0.33	31.8 0.0	0.0 0.0	0.01
7	38.16 0.0	0.0 0.4	38.16 0.0	0.0 0.0	0.01
8	44.52 0.0	0.0 0.47	44.52 0.0	0.0 0.0	0.01
9	50.89 0.0	0.0 0.53	50.89 0.0	0.0 0.0	0.01
10	57.25 0.0	0.0 0.6	57.25 0.0	0.0 0.0	0.01
11	63.61 0.0	0.0 0.67	63.61 0.0	0.0 0.0	0.01
12	69.97 0.0	0.0 0.73	69.97 0.0	0.0 0.0	0.01
13	76.33 0.0	0.0 0.8	76.33 0.0	0.0 0.0	0.01
14	82.69 0.0	0.0 0.87	82.69 0.0	0.0 0.0	0.01
15	89.05 0.0	0.0 0.93	89.05 0.0	0.0 0.0	0.01
16	95.41 0.0	0.0 1.0	95.41 0.0	0.0 0.0	0.01
17	0.0 0.0	0.0 0.0	0.0 0.0	0.0 0.0	0.01
18	23.85 0.0	0.0 0.25	23.85 0.0	0.0 0.0	0.01
19	47.71 0.0	0.0 0.5	47.71 0.0	0.0 0.0	0.01
20	71.56 0.0	0.0 0.75	71.56 0.0	0.0 0.0	0.01
21	95.41 0.0	0.0 1.0	95.41 0.0	0.0 0.0	0.01


**Start-Ausgabe S1**  
**Kennzeichnung nach**  
**ISO/IEC 15775 Anhang G**  
**und DIN 33866-1 Anhang G**

Mittlerer Helligkeitsabstand (16 Stufen)  
 $\Delta E^*_{\text{CIELAB}} = 0.0$

Mittlerer Helligkeitsabstand (5 Stufen)  
 $\Delta L^*_{\text{CIELAB}} = 0.0$

Mittlerer Farbwiedergabe-Index:  $R^*_{\text{ab,m}} = 100$

fgi30-3A-030-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

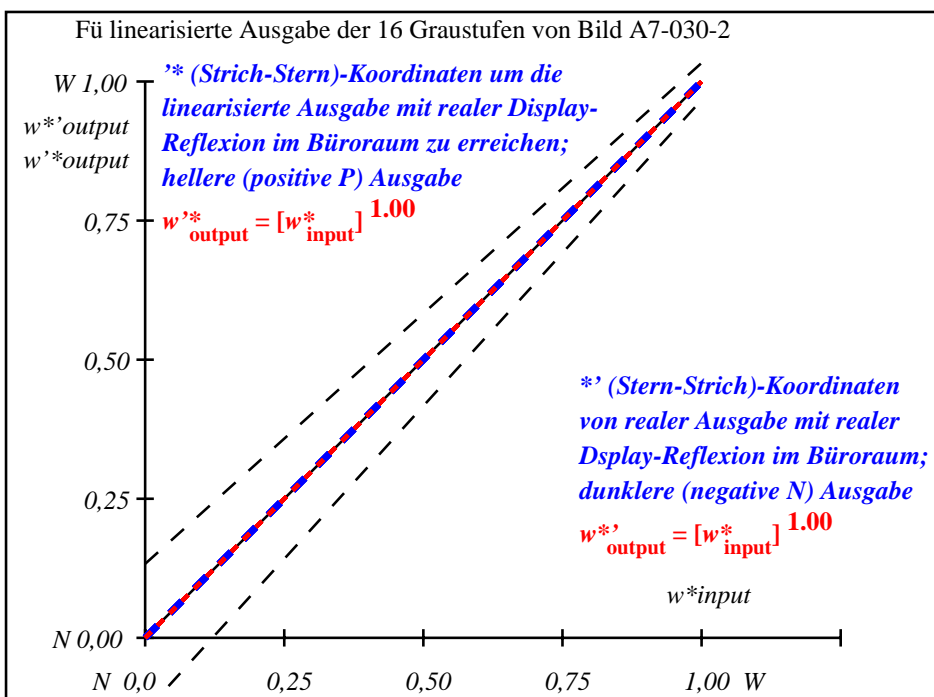

fgi31-3N-030-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

$L^*/Y^*_{\text{intended}}$ (absolut)	0.0/0.0	6.4/0.7	12.7/1.5	19.1/2.8	25.4/4.6	31.8/7.0	38.2/10.2	44.5/14.2	50.9/19.2	57.2/25.2	63.6/32.3	70.0/40.7	76.3/50.4	82.7/61.6	89.0/74.3	95.4/88.6
$w^* w^* w^*$ setrgb gp=1.00																
Nr. und Hex-Code	00;F	01;E	02;D	03;C	04;B	05;A	06;9	07;8	08;7	09;6	10;5	11;4	12;3	13;2	14;1	15;0
$w^* = L^*_{\text{CIELAB}, r}$ (relativ)																
$w^*_{\text{intended}}$	0,000	0,067	0,133	0,200	0,267	0,333	0,400	0,467	0,533	0,600	0,667	0,733	0,800	0,867	0,933	1,000
$w^*_{\text{out}}$	0.0	0.067	0.133	0.2	0.267	0.333	0.4	0.467	0.533	0.6	0.667	0.733	0.8	0.867	0.933	1.0

fgi30-7N, Bild A7-030-2: 16 visuell gleichabständige  $L^*$ -Graustufen; PS-Operator:  $w^* w^* w^*$  setrgbcolor

TUB-Prüfvorlage fgi3; Ein-Ausgabe-Beziehung nach ISO 9241-306; DH  
Gesehener Y-Kontrast  $Y_W:Y_N=88,9:0,31$ ;  $Y_N$ -Bereich 0,0 to <0,46

000n/w/cmy0/rgb  
→rgb\*d, 030-2: