



Colour management for output linearization of a 9 step grey scale

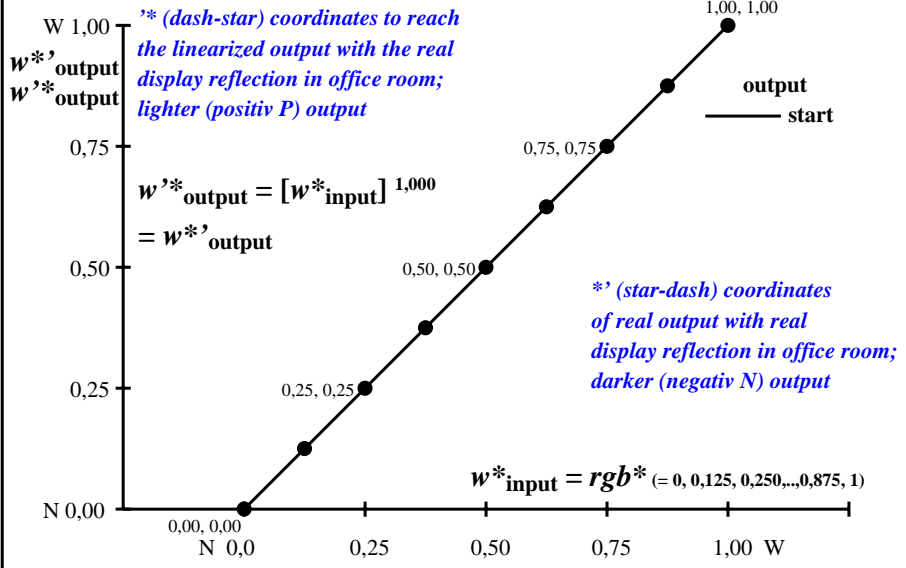


Colour management for output linearization of a 9 step grey scale

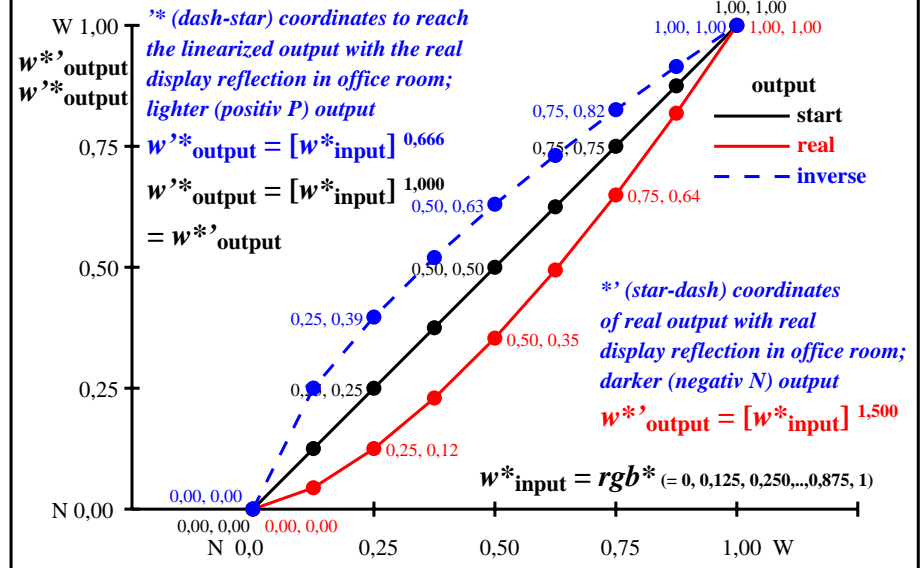


gen60-3n

gen61-3n

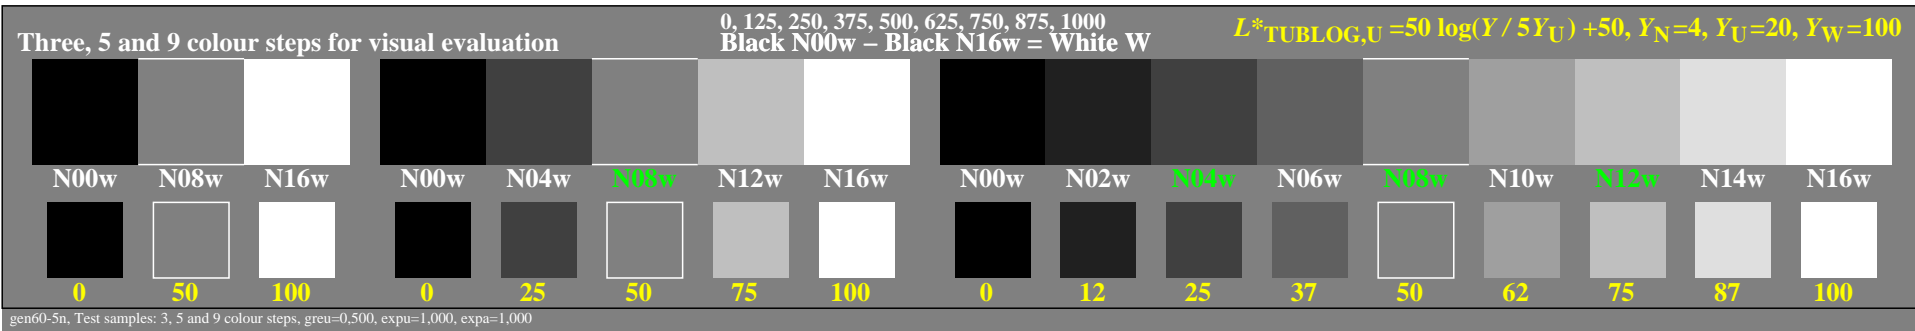

gen60-5n, Test samples: 3, 5 and 9 colour steps, greu=0,500, expu=1,000, expa=1,000

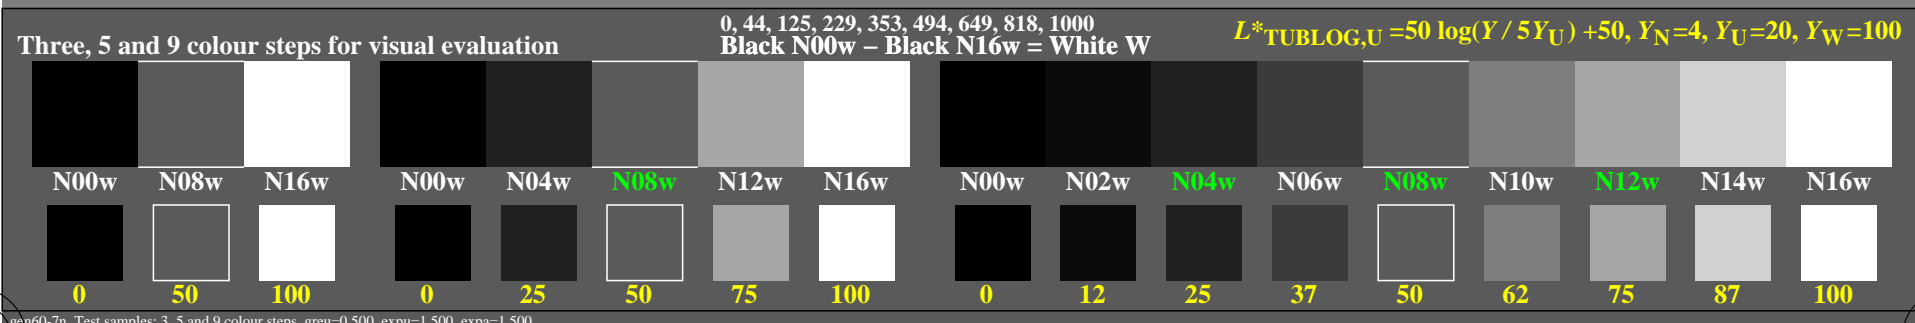

gen60-7n, Test samples: 3, 5 and 9 colour steps, greu=0,500, expu=1,500, expa=1,500

TUB-test chart gen6; Adjacent and separate colour samples for intervall scaling
 Gamma values 1 (start), 1,5 (real) and 0,667 (inverse); surrounds U=N08w und d=N04w

see similar files of the whole serie: <http://farbe.li.tu-berlin.de/gens.htm>
 technical information: <http://farbe.li.tu-berlin.de> OR <http://color.li.tu-berlin.de>

TUB registration: 20240701-gen6/gen610np.pdf / .ps
 application for evaluation and measurement of display or print output

TUB material: code=rhadata